

As a matter of proper business decorum, the Board of Commissioners respectfully request that all cell phones be turned off or placed on vibrate. To prevent any potential distraction of the proceeding, we request that side conversations be taken outside the meeting room.

AGENDA
REGULAR BOARD MEETING
VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
VICTORVILLE CITY HALL, CONFERENCE ROOM D
14343 CIVIC DRIVE, VICTORVILLE CA 92392

Thursday, July 15, 2021
7:30 a.m.

VVWRA is committed to protecting public health and the environment in the Victor Valley by providing effective and fiscally responsible wastewater collection, treatment, and recycling.

Call to Order

Holland

Roll Call

Casteel

Public Comments- Closed Session Agenda Items

Holland

CLOSED SESSION: During the course of conducting the business set forth on this agenda as a regular meeting of the Board, the Chair may convene the Board in closed session to consider matters of pending real estate negotiations, pending or potential litigation, or personnel matters, pursuant to Government Code Sections 54956.8, 54956.9, 54957 or 54957.6, as noted. Reports relating to (a) purchase and sale of real property; (b) matters of pending or potential litigation; or (c) employment actions, or which are exempt from public disclosure under the California Public Records Act, may be reviewed by the Board during a permitted closed session and are not available for public inspection. At such time the Board takes final action on any of these subjects, the minutes will reflect all required disclosures of information. Closed Session is scheduled to commence at 7:30 a.m.. If the matters discussed in closed session require additional time beyond 8:00 a.m., in deference to the public, the Board may continue the Closed Session discussion after Open Session is concluded. In that case, Closed Session will resume after the Commissioners Comments section and any reportable action will be reported after the continued Closed Session has concluded and before adjournment.

Closed Session

Item 1. (Gov. Code Sec. 54954.5-54956.9(d))- Government Tort Claim- City of Hesperia- Settlement Discussion

Item 2. (Gov. Code Sec. 54957(b)(1))- Conference with Legal Counsel- Public Employee Discipline

Call to Order & Pledge of Allegiance

Holland

Report from Closed Session

Legal

Public Comment (Government Code Section 54954.3)

Holland

Opportunity for members of the public to directly address the Board on items of public interest within its

jurisdiction. The public may also address the Board on items being considered on this agenda. VVWRA requests that all public speakers complete a speaker's card and provide it to the Secretary. Persons desiring to submit paperwork to the Board of Commissioners shall provide a copy of any paperwork to the Board Secretary for the official record. We request that remarks be limited to five minutes or less. Pursuant to Government Code Section 54954.3, if speaker is utilizing a translator, the total allotted time will be doubled.

Possible Conflicts of Interest

Holland

Consent Calendar

Holland

All matters placed on the Consent Calendar are considered as not requiring discussion or further explanation and unless any particular item is requested to be removed from the Consent Calendar by a Commissioner, staff member or member of the public in attendance, there will be no separate discussion of these items. All items on the Consent Calendar will be enacted by one action approving all motions and casting a unanimous ballot for resolutions included on the consent calendar. All items removed from the Consent Calendar shall be considered in the regular order of business.

Item 3. Receive, Approve and File Minutes

- Regular Board Meeting 06/17/2021

Item 4. Receive, Approve and File June 2021 Disbursement

- Warrant Summary Disbursements

Poulsen

Board Action Required

Staff Recommendation: Approve as presented

Recycled Water/Subregional Billing Workshop

Holland

Public Hearing

Holland

Item 5. First Reading of Ordinance 001: Rules and Regulations for Sewer Service

Action Items

The Executive Leadership Team will provide brief updates on existing matters under their purview and will be available to respond to any questions thereof.

Item 6. Recommendation to Move Forward with Second Reading of Ordinance 001: Rules and Regulations for Sewer Service

It is recommended that the Board of Commissioners authorize the General Manager to schedule the second reading of Ordinance 001- Rules and Regulations for Sewer Service for August 19, 2021, at 8:00 AM.

Poulsen

Board Action Required

Staff Recommendation: Approve as Presented

<p><u>Item 7.</u> Recommendation to Approve the Second Amendment to the Gas Collection Facilities Lease and Energy Services Agreement</p> <p>It is recommended that the Board of Commissioners approve the General Manager to execute the Second Amendment to the Gas Collection Facilities Lease and Energy Service Agreement with SoCal Biomethane, LLC upon approval of the amendment by the VVWRA Attorneys.</p>	<p>Poulsen</p>
<p><u>Board Action Required</u></p> <p>Staff Recommendation: Approve as Presented</p>	
<p><u>Item 8.</u> Recommendation to Extend the Professional Services Agreement for Owner’s Representative and Construction Management Services for the Renewable Natural Gas Project to Biogas Engineering in the Amount of \$75,000.00</p> <p>It is recommended that the Board of Commissioners approve the General Manager to extend the Professional Services Agreement (PSA) for Owner’s Representative and Construction Management Services for the Renewable Natural Gas Project to Biogas Engineering (BGE) in the amount of \$75,000.00 upon review and approval by legal counsel.</p>	<p>Adams</p>
<p><u>Board Action Required</u></p> <p>Staff Recommendation: Approve as Presented</p>	
<p><u>Item 9.</u> Recommendation to Approve Annual On-Call Contracts Not to Exceed \$55,000 for Public Project Services to Selected Contractors Upon Review and Approval by Legal Counsel</p> <p>It is recommended that the Board of Commissioners approve the General Manager to execute multiple on-call service contracts not to exceed \$55,000.00 for public project services to the selected contractor(s) listed below upon review and approval by legal counsel.</p>	<p>Poulsen</p>
<p><u>Board Action Required</u></p> <p>Staff Recommendation: Approve as Presented</p>	
<p><u>Item 10.</u> Recommendation to the Amendment of Trimax’s PLC Replacement Project Contract to Include Phase 3</p> <p>It is recommended that the Board of Commissioners approve an amendment of Trimax’s Programmable Logic Controllers (PLC) replacement project contract to include phase 3 in the amount of \$536,000.00 pending legal review.</p>	<p>Laari</p>
<p><u>Board Action Required</u></p> <p>Staff Recommendation: Approve as Presented</p>	
<p><u>Item 11.</u> Recommendation to Amend Board Schedule</p> <p>It is recommended that the Board of Commissioners approve the amended 2021 Board Meeting Schedule.</p>	<p>Casteel</p>
<p><u>Board Action Required</u></p> <p>Staff Recommendation: Approve as Presented</p>	

Staff Reports

Reports are submitted as presented by Staff on a Quarterly Basis.

Report Range	Board Meeting Date (Thursday)
1st Quarter January 2021-March 2021	May 20, 2021
2nd Quarter April 2021-June 2021	September 16, 2021
3rd Quarter July 2021- September 2021	November 18, 2021
4th Quarter October 2021- December 2021	February Board 2022

Adjournment

Holland

American Disabilities Act Compliance Statement

Government Code Section 54954.2(a)



Any request for disability-related modifications or accommodations (including auxiliary aids or services) sought to participate in the above public meeting should be directed to the VVWRA's Secretary at (760) 246-8638 at least 72 hours prior to the scheduled meeting. Requests must specify the nature of the disability and the type of accommodation requested.

Agenda posting

Government Code Section 54954.2

This agenda has been posted in the main lobby of the Authority's Administrative offices not less than 72 hours prior to the meeting date and time above. All written materials relating to each agenda item are available for public inspection in the office of the Board Secretary.

Agenda items received after posting

Government Code Section 54957.5

Materials related to an item on this agenda submitted after distribution of the agenda packet are available for public review at the VVWRA office located at, 20111 Shay Road, Victorville CA 92394. The materials will also be posted on the VVWRA website at www.vvwra.com.

Items Not Posted

Government Code Section 54954.2(b)

In the event any matter not listed on this agenda is proposed to be submitted to the Board for discussion and/or action, it will be done as an emergency item or because there is a need to take immediate action, which came to the attention of the Board subsequent to the posting of the agenda, or as set forth on a supplemental agenda posted in the manner as above, not less than 72 hours prior to the meeting date.

Items Continued

Government Section 54954.2(b)(3)

Items may be continued from this meeting without further notice to a Committee or Board meeting held within five (5) days of this meeting

Meeting Adjournment

This meeting may be adjourned to a later time and items of business from this agenda may be considered at the later meeting by Order of Adjournment and Notice

VVWRA's Board Meeting packets and agendas are available for review on its website at www.vvwra.com. The website is updated on Friday preceding any regularly scheduled board meeting.

MINUTES OF A REGULAR MEETING
REGULAR MEETING OF THE BOARD OF COMMISSIONERS
VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY (VWRA)
June 17, 2021

CALL TO ORDER: Chair Debra Jones called the meeting to order at 7:34 AM; via teleconference with the following members present:

CITY OF VICTORVILLE
CITY OF HESPERIA
ORO GRANDE (CSA 42) AND
SPRING VALLEY LAKE (CSA 64)
TOWN OF APPLE VALLEY

Debra Jones, Chair
Larry Bird, Vice-Chair
Dakota Higgins, Secretary

Scott Nassif, Treasurer

VWRA Staff and Legal Counsel:

Darron Poulsen, General Manager
Kristi Casteel, Secretary to GM/Board
Piero Dallarda, Legal Counsel (BB&K)

Robert Coromina, Director of Administration
Chieko Keagy, Controller

Guest Present:

Brian Gengler, City of Victorville
Doug Robertson, Town of Apple Valley

Nils Bentsen, City of Hesperia
Janele Davidson, City of Victorville

Chair Jones read the following statement:

Welcome to the VWRA June 17, 2021, regular meeting. I hope that you can all hear us. If you are following us and you are unable to speak for any reason or encounter any difficulties, please contact via e-mail our Board clerk, Kristi Casteel, her contact information is printed on the first page of the agenda. She or another VWRA employee will try to assist you. Please note that we will be having a closed session shortly after 7:30 a.m. telephonically though a different line so this line maybe silent until we come back from closed session.

I am sure that all the participants have noticed the COVID 19 notice on the first page of our agenda. Public participation in our democracy is really fundamental to the health of our democracy. We wish we could hold our meeting in person but given the current COVID19 contagion concerns and our Governor's order and the Order of the Public Health officer for the County of San Bernardino, we are holding our meeting via Internet and telephonically. We will do our best to conduct the meeting in an orderly fashion and make sure that anyone who would like to participate has a chance to do so. Please follow the instructions on the first page of the agenda so we can make sure that you get to participate.

VVWRA Regular Meeting Minutes

Thursday, June 17, 2021

Page 2

CLOSED SESSION**PUBLIC COMMENTS- CLOSED SESSION AGENDA**

Chair Jones asked if there were any comments from the public regarding any item on the Closed Session Agenda. Hearing none, Chair Jones called for a motion to enter into Closed Session.

Moved: Commissioner Nassif**Second: Commissioner Bird****Motion to enter Closed Session****Chair Jones- Yes****Commissioner Holland- Yes****Commissioner Higgins- Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote****REGULAR SESSION****CALL TO ORDER & PLEDGE OF ALLEGIANCE**

Chair Jones called the meeting to order at 8:05 AM.

Roll Call for Open Session**Chair Jones- Present****Commissioner Holland- Present****Commissioner Higgins- Present****Commissioner Nassif- Present****REPORT FROM CLOSED SESSION**

None

PUBLIC COMMENTS- REGULAR SESSION AGENDA

None

POSSIBLE CONFLICT OF INTEREST

Commissioner Nassif will be abstaining from any disbursements to Napa Auto Parts on item 5

CONSENT CALENDAR:

4. **Receive, Approve and File Minutes, May 20, 2021**
5. **Receive, Approve and File May 2021 Disbursement**
6. **Recommendation to Approve Amendment to Contract of General Manager Contract**

Moved: Commissioner Nassif

Second: Commissioner Higgins

Approval of the Consent Calendar Items 4, 5, and 6 with Commissioner Nassif abstaining from any disbursements to Napa Auto Parts on item 5 and Commissioner Bird abstaining on item 4.

Chair Jones- Yes

Commissioner Bird- Yes

Commissioner Higgins- Yes

Commissioner Nassif- Yes

Motion passed by a 4-0 roll call vote

PUBLIC HEARING:

7. **FY 2021-2022 Budget**

Chair Jones opened the Public Hearing at 8:04 am.

The Secretary of the Board confirmed the posting and publication of the Public Hearing Notice as required by law.

A presentation was given on the FY 2021-2022 Budget

Chair Jones asked if there were any comments from the public. There were no public comments.

Chair Jones closed the public hearing at 8:07 am.

VVWRA Regular Meeting Minutes**Thursday, June 17, 2021****Page 4****ACTION ITEM:****8. Recommendation to Adopt Resolution 2021-03 Adoption of the FY 2021-2022 Budget**

The Board will consider approval of Resolution 2021-03 Adoption of the Proposed Budget as presented for the year ending June 30, 2022.

Moved: Commissioner Nassif**Second: Chair Jones**

Approval of Resolution 2021-03 Adoption of the Proposed Budget as presented for the year ending June 30, 2022.

Chair Jones- Yes**Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote****9. Recommendation to Adopt Resolution 2021-04 FY 2021-2022 Holiday Schedule**

The Board will consider approval of Resolution No. 2021-04 to establish the paid holidays for VVWRA employees during fiscal year 2021-2022 which is consistent with the MOU with the Employees Association adopted on December 8, 2016.

Moved: Commissioner Nassif**Second: Commissioner Bird**

Approval of Resolution No. 2021-04 to establish the paid holidays for VVWRA employees during fiscal year 2021-2022 which is consistent with the MOU with the Employees Association adopted on December 8, 2016

Chair Jones- Yes**Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote**

VVWRA Regular Meeting Minutes**Thursday, June 17, 2021****Page 5****10. Recommendation to Approve Resolution 2021-05 Recycled Water Rates**

The Board will consider approval of Resolution No. 2021-05 to establish a new recycled water rate for all recycled water customers.

This item was tabled and will be brought back to the Board in a workshop at the regular meeting on July 15, 2021

11. Recommendation to Approve Resolution 2021-06 ADM/FOG Tipping Fees

The Board will consider approval of Resolution 2021-06 ADM/FOG Tipping Fees

Moved: Commissioner Nassif**Second: Commissioner Jones****Approval of Resolution No. 2021-06 ADM/FOG Tipping Fees****Chair Jones- Yes****Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote****12. Recommendation to Approve the General Manager to Purchase Replacement Components for the WEDECO UV Disinfection Systems Located at Apple Valley and Hesperia Sub-regional Facilities in the Amount of \$105,827.80**

The Board will consider approval of the General Manager to purchase replacement components for the WEDECO UV disinfection systems located at Apple Valley and Hesperia sub-regional facilities in the amount of \$105,827.80.

Moved: Commissioner Bird**Second: Commissioner Nassif****Approval of the General Manager to purchase replacement components for the WEDECO UV disinfection systems located at Apple Valley and Hesperia sub-regional facilities in the amount of \$105,827.80.****Chair Jones- Yes**

VVWRA Regular Meeting Minutes**Thursday, June 17, 2021****Page 6****Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote****13. Recommendation to Cancel the June 24th Board Meeting.**

The Board will consider approval to cancel the regularly scheduled June 24, 2021 Meeting if the Board adopts the FY 2021-22 Budget.

Moved: Commissioner Bird**Second: Commissioner Nassif**

Approval to cancel the regularly scheduled June 24, 2021 Meeting if the Board adopts the FY 2021-22 Budget.

Chair Jones- Yes**Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote****14. Election of Officers**

The Board will consider approval of the rotation of officers for the FY 2021-2022, effective July 1, 2021

Moved: Commissioner Nassif**Second: Chair Jones**

Approval of the rotation of officers for the FY 2021-2022, effective July 1, 2021

Chair Jones- Yes**Commissioner Bird- Yes****Commissioner Higgins - Yes****Commissioner Nassif- Yes****Motion passed by a 4-0 roll call vote**

VVWRA Regular Meeting Minutes
Thursday, June 17, 2021
Page 7

STAFF/PROFESSIONAL SERVICES REPORTS:

15. **General Managers Report**
16. **Financial and Investment Report – December 2020**
17. **Operations & Maintenance Report – December 2020**
18. **Environmental Compliance Department Reports – December 2020**
19. **Septage Receiving Facility Reports – December 2020**
20. **Safety & Communications Report – December 2020**

CLOSED SESSION (If Closed Session is continued)

ADJOURNMENT

The board will adjourn to a regular board meeting on July 15, 2021 at 7:30 a.m.

APPROVAL:

DATE: July 15, 2021

BY: _____

Approved by VVWRA Board Paul Cook,
Secretary VVWRA Board of Commissioners



Victor Valley Wastewater Reclamation Authority

A Joint Powers Authority and Public Agency of the State of California

Administrative Offices

20111 Shay Road, Victorville, CA 92394


Telephone: (760) 246-8638

Fax: (760) 948-9897

e-mail: mail@vwwra.com

DATE: July 06, 2021

TO: Darron Poulsen
General Manager

FROM: Chieko Keagy 
Controller

SUBJECT: Cash Disbursements Register

RECOMMENDED ACTION

It is recommended that the Board of Commissioners approve the cash disbursements and payroll register for the Victor Valley Wastewater Reclamation Authority.

BACKGROUND

The Cash Disbursements Register totals represented below are for the month of JUNE 2021, check numbers 124012-124064 and ACH's.

<i>Accounts Payable</i>			
<i>Checks</i>	<i>ACH's and EFT's</i>	<i>Payroll</i>	<i>Total</i>
\$283,572.06	\$1,935,191.68	\$341,701.79	\$2,560,465.53

**Victor Valley Wastewater Reclamation Authority
Cash Disbursement Register
From 6/1/21 through 6/30/21**

Vendor #	Vendor Name	Type	Payment #	Date	Total
AAAL000	A&A Alternators And Starters	Check	123207	06/17/2021	\$ (250.00)
APPL000	Liberty Utilities	Check	123316	06/17/2021	\$ (91.39)
APPL000	Liberty Utilities	Check	123379	06/17/2021	\$ (87.48)
APPL000	Liberty Utilities	Check	123510	06/08/2021	\$ (899.85)
ALLP000	All Pro Pest Control	Check	124012	06/04/2021	\$ 1,950.00
VICT003	City Of Victorville / Sanitation	Check	124013	06/04/2021	\$ 4,725.16
DONE001	Done-Right Concrete Co	Check	124014	06/04/2021	\$ 1,232.00
HESP004	Hesperia Water District	Check	124015	06/04/2021	\$ 609.30
HIDE000	Hi-Desert Communications	Check	124016	06/04/2021	\$ 100.00
HIGG000	Higgins, Dakota	Check	124017	06/04/2021	\$ 100.00
HOLL000	Holland, William J.	Check	124018	06/04/2021	\$ 100.00
JONE003	Jones, Debra	Check	124019	06/04/2021	\$ 100.00
NASS000	Nassif, Scott	Check	124020	06/04/2021	\$ 100.00
PRUD001	Prudential Overall Supply	Check	124021	06/04/2021	\$ 682.40
QUAD000	Quadient Leasing Usa, Inc	Check	124022	06/04/2021	\$ 100.00
APPL015	Shredyourdocs.Com	Check	124023	06/04/2021	\$ 212.80
VERI004	Verizon Wireless	Check	124024	06/04/2021	\$ 1,902.91
BIGS000	Big Sky Electric	Check	124025	06/09/2021	\$ 24,622.00
BRYC000	Bryce Consulting	Check	124026	06/09/2021	\$ 5,100.00
EDEN000	Edenbros, Llc	Check	124027	06/09/2021	\$ 219.47
FHAS000	Fha Services, Inc.	Check	124028	06/09/2021	\$ 7,846.00
ORKI000	Orkin	Check	124029	06/09/2021	\$ 411.00
PRUD001	Prudential Overall Supply	Check	124030	06/09/2021	\$ 674.44
RAIN000	Rain For Rent	Check	124031	06/09/2021	\$ 4,128.93
APPL015	Shredyourdocs.Com	Check	124033	06/09/2021	\$ 89.60
SADD000	Saddleback Environmental Equipment, Inc.	Check	124035	06/09/2021	\$ 80,840.41
ATMO000	Atmospheric Analysis And Consulting, Inc	Check	124036	06/16/2021	\$ 1,890.00
BIGS000	Big Sky Electric	Check	124037	06/16/2021	\$ 20,406.00
CRUM000	Crump & Co., Inc	Check	124038	06/16/2021	\$ 2,455.38
SENT000	Daniel Sentman	Check	124039	06/16/2021	\$ 206.97
FHAS000	Fha Services, Inc.	Check	124040	06/16/2021	\$ 337.00
HERI000	Heritage Environmental Services, L.L.C.	Check	124041	06/16/2021	\$ 413.06
HIDE001	Hi-Desert Window Washing	Check	124042	06/16/2021	\$ 307.00
JCBS000	Socal Jcb	Check	124043	06/16/2021	\$ 4,376.54
KONI000	Konica Minolta Business Solutions	Check	124044	06/16/2021	\$ 150.66
APPL000	Liberty Utilities	Check	124045	06/16/2021	\$ 177.85
PARK000	Parkhouse Tire Inc.	Check	124046	06/16/2021	\$ 1,653.07
PRUD001	Prudential Overall Supply	Check	124047	06/16/2021	\$ 674.44
QUAD000	Quadient Leasing Usa, Inc	Check	124048	06/16/2021	\$ 293.98
SCOT001	Scott Equipment, Inc	Check	124049	06/16/2021	\$ 3,546.54
APPL015	Shredyourdocs.Com	Check	124050	06/16/2021	\$ 106.40
SUNB001	Sunbelt Supply Inc.	Check	124051	06/16/2021	\$ 6,228.21
AIRG000	Airgas Usa, Llc	Check	124052	06/23/2021	\$ 1,192.28
CONC000	Answering 365	Check	124053	06/23/2021	\$ 158.00
AQUA000	Aquatic Bioassay / Consult Inc.	Check	124054	06/23/2021	\$ 245.00
BIGS000	Big Sky Electric	Check	124055	06/23/2021	\$ 20,406.00
BRYC000	Bryce Consulting	Check	124056	06/23/2021	\$ 1,955.00
CINT000	Cintas Corporation	Check	124057	06/23/2021	\$ 383.15
EASY000	Easy Flow, Llc	Check	124058	06/23/2021	\$ 14,000.00
FHAS000	Fha Services, Inc.	Check	124059	06/23/2021	\$ 518.97
MIKE001	Mike Dyell Machine Shop, Inc.	Check	124060	06/23/2021	\$ 1,939.50
ORKI000	Orkin	Check	124061	06/23/2021	\$ 719.00
PHEN001	Phenix Truck Bodies & Equipment	Check	124062	06/23/2021	\$ 3,915.50
PRUD001	Prudential Overall Supply	Check	124063	06/23/2021	\$ 674.44
RAIN000	Rain For Rent	Check	124064	06/23/2021	\$ 2,724.42
STAT001	State Water Resources Control Board	Check	310020	06/23/2021	\$ 57,000.00
				Total Checks	\$ 283,572.06
ADSC000	A.D.S. Corp.	Electronic Fund Transfer	061020211	06/10/2021	\$ 7,150.00
PROT001	Adt Commercial	Electronic Fund Transfer	061820211	06/18/2021	\$ 929.55
ALLC000	All Covered	Electronic Fund Transfer	061020212	06/10/2021	\$ 990.00
ALLC000	All Covered	Electronic Fund Transfer	0604202122	06/04/2021	\$ 238.00
AMER006	American Express	Electronic Fund Transfer	061120211	06/11/2021	\$ 13,676.81
ANTH000	Anthony, Donna	Electronic Fund Transfer	062920211	06/29/2021	\$ 428.00
APPL013	Applied Maintenance Supplies & Solution	Electronic Fund Transfer	0629202115	06/29/2021	\$ 10.41
APPL013	Applied Maintenance Supplies & Solution	Electronic Fund Transfer	061820212	06/18/2021	\$ 1,678.65
APPL013	Applied Maintenance Supplies & Solution	Electronic Fund Transfer	061020213	06/10/2021	\$ 641.63
APPL013	Applied Maintenance Supplies & Solution	Electronic Fund Transfer	0604202123	06/04/2021	\$ 166.55
BRSU000	B&R Supply, Inc.	Electronic Fund Transfer	061820213	06/18/2021	\$ 252.72
ESBA000	Babcock Laboratories, Inc.	Electronic Fund Transfer	0629202116	06/29/2021	\$ 43,938.20
ESBA000	Babcock Laboratories, Inc.	Electronic Fund Transfer	061020214	06/10/2021	\$ 20,300.20
BECK000	Beck Oil, Inc.	Electronic Fund Transfer	0629202117	06/29/2021	\$ 2,593.76
BECK000	Beck Oil, Inc.	Electronic Fund Transfer	061020215	06/10/2021	\$ 25.42

Victor Valley Wastewater Reclamation Authority
Cash Disbursement Register
From 6/1/21 through 6/30/21

Vendor #	Vendor Name	Type	Payment #	Date	Total
BECK000	Beck Oil, Inc.	Electronic Fund Transfer	0604202124	06/04/2021	\$ 21.79
BEST000	Best, Best & Krieger, L.L.P.	Electronic Fund Transfer	0604202125	06/04/2021	\$ 32,799.05
BILL002	Billings, Richard	Electronic Fund Transfer	062920212	06/29/2021	\$ 428.00
BIOG001	Biogas Engineering	Electronic Fund Transfer	0629202118	06/29/2021	\$ 1,200.00
BIOG001	Biogas Engineering	Electronic Fund Transfer	061820214	06/18/2021	\$ 23,380.00
BREN001	Brenntag Pacific, Inc	Electronic Fund Transfer	061020216	06/10/2021	\$ 10,951.18
VEBA000	California School Veba	Electronic Fund Transfer	061020217	06/10/2021	\$ 665.24
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02165	06/18/2021	\$ 23.07
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02167	06/18/2021	\$ 172.61
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02166	06/18/2021	\$ 692.31
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02130	06/04/2021	\$ 23.07
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02131	06/04/2021	\$ 692.31
CALI012	California State Disbursement Unit	Electronic Fund Transfer	DFT02132	06/04/2021	\$ 172.61
CDWG000	Cdw Government, Inc	Electronic Fund Transfer	060420211	06/04/2021	\$ 2,117.64
TRIT000	Central Square Software	Electronic Fund Transfer	061020218	06/10/2021	\$ 14,131.30
CONS000	Consumers Pipe & Supply, Co.	Electronic Fund Transfer	061020219	06/10/2021	\$ 1,279.66
CORO000	Coromina, Robert	Electronic Fund Transfer	061820215	06/18/2021	\$ 482.70
CORR000	Correia, Bruce	Electronic Fund Transfer	062920213	06/29/2021	\$ 428.00
COYL000	Coyle Supply, Inc.	Electronic Fund Transfer	0610202110	06/10/2021	\$ 245.01
CRAN000	Crane Pro Services	Electronic Fund Transfer	061820216	06/18/2021	\$ 1,380.00
CRAN000	Crane Pro Services	Electronic Fund Transfer	060420212	06/04/2021	\$ 3,820.63
CULL000	Culligan Water Conditioning	Electronic Fund Transfer	060420213	06/04/2021	\$ 555.70
DKFS000	D.K.F. Solutions Group, Llc	Electronic Fund Transfer	060420214	06/04/2021	\$ 350.00
DAGN000	Daguino, Roy	Electronic Fund Transfer	062920214	06/29/2021	\$ 428.00
DAVI003	Davis Electric, Inc	Electronic Fund Transfer	060420215	06/04/2021	\$ 22,360.00
DAVI001	Davis, Tim	Electronic Fund Transfer	062920215	06/29/2021	\$ 428.00
DUDE000	Dudek	Electronic Fund Transfer	0629202119	06/29/2021	\$ 1,596.25
EHSI000	Ehs International Inc.	Electronic Fund Transfer	060420216	06/04/2021	\$ 1,950.00
EVOQ000	Evoqua Water Technologies Llc	Electronic Fund Transfer	060420217	06/04/2021	\$ 9,971.80
FAST001	Fastenal	Electronic Fund Transfer	0629202120	06/29/2021	\$ 155.19
FLIN000	Flint, Terrie Gossard	Electronic Fund Transfer	062920216	06/29/2021	\$ 238.25
FLYE000	Flyers Energy, Llc	Electronic Fund Transfer	DFT02144	06/17/2021	\$ 1,329.28
FLYE000	Flyers Energy, Llc	Electronic Fund Transfer	DFT02112	06/02/2021	\$ 1,144.68
GAOS000	G.A. Osborne Pipe & Supply	Electronic Fund Transfer	061820217	06/18/2021	\$ 946.08
GRAH000	Graham Equipment	Electronic Fund Transfer	0629202121	06/29/2021	\$ 25,545.00
GRAH000	Graham Equipment	Electronic Fund Transfer	0610202111	06/10/2021	\$ 6,425.00
GRAI000	Grainger	Electronic Fund Transfer	0629202122	06/29/2021	\$ 1,110.27
GRAI000	Grainger	Electronic Fund Transfer	061820218	06/18/2021	\$ 366.92
GRAI000	Grainger	Electronic Fund Transfer	0610202112	06/10/2021	\$ 538.03
GRAI000	Grainger	Electronic Fund Transfer	060420218	06/04/2021	\$ 12,394.11
GYUR000	Gyurcsik, Darline	Electronic Fund Transfer	062920217	06/29/2021	\$ 206.97
HAAK000	Haaker Equipment Company	Electronic Fund Transfer	0610202113	06/10/2021	\$ 6,581.25
HACH000	Hach Company	Electronic Fund Transfer	0610202114	06/10/2021	\$ 13,164.99
HIDE004	Hi Desert Forklift Service	Electronic Fund Transfer	061820219	06/18/2021	\$ 1,223.08
HIDE004	Hi Desert Forklift Service	Electronic Fund Transfer	0610202115	06/10/2021	\$ 608.86
HIGH015	High Desert Affordable Landscaping	Electronic Fund Transfer	0618202110	06/18/2021	\$ 6,872.26
HINO000	Hinojosa, Thomas	Electronic Fund Transfer	062920218	06/29/2021	\$ 428.00
ANAL003	I E H Analytical Services, Inc	Electronic Fund Transfer	0618202111	06/18/2021	\$ 6,930.00
ILIN000	Ilink Business Management	Electronic Fund Transfer	0629202123	06/29/2021	\$ 263.88
ILIN000	Ilink Business Management	Electronic Fund Transfer	0618202112	06/18/2021	\$ 263.88
ILIN000	Ilink Business Management	Electronic Fund Transfer	060420219	06/04/2021	\$ 527.76
ROBI000	John Robinson Consulting, Inc	Electronic Fund Transfer	0610202116	06/10/2021	\$ 2,640.00
KENI000	Keniston, Olin	Electronic Fund Transfer	062920219	06/29/2021	\$ 238.25
KONT000	Konica Minolta Business Solutions	Electronic Fund Transfer	DFT02173	06/24/2021	\$ 408.36
LABO002	Labor Finders	Electronic Fund Transfer	0629202124	06/29/2021	\$ 845.44
LARR000	Larry Walker Associates	Electronic Fund Transfer	0629202125	06/29/2021	\$ 11,131.00
LARR000	Larry Walker Associates	Electronic Fund Transfer	0604202110	06/04/2021	\$ 651.50
LINC000	Lincoln Financial Group	Electronic Fund Transfer	DFT02113	06/02/2021	\$ 4,314.65
LINC000	Lincoln Financial Group	Electronic Fund Transfer	DFT02114	06/02/2021	\$ 80.11
LUHD000	Luhdorff And Scalmanini	Electronic Fund Transfer	0629202126	06/29/2021	\$ 1,187.25
MAIN000	Main, Randy	Electronic Fund Transfer	0629202110	06/29/2021	\$ 428.00
AVIL000	Marcos Avila	Electronic Fund Transfer	0604202111	06/04/2021	\$ 192.00
MCGE000	Mcgee, Mark	Electronic Fund Transfer	0629202111	06/29/2021	\$ 428.00
MCGR000	Mcgrath Rentcorp	Electronic Fund Transfer	0629202127	06/29/2021	\$ 150.00
MCGR000	Mcgrath Rentcorp	Electronic Fund Transfer	0604202112	06/04/2021	\$ 5,466.43
MISC000	Misco - T.W. Associates	Electronic Fund Transfer	0629202128	06/29/2021	\$ 10,885.33
MONT000	Montgomery, Lillie	Electronic Fund Transfer	0629202112	06/29/2021	\$ 168.56
NALI000	Nalian, L. Christina	Electronic Fund Transfer	0629202113	06/29/2021	\$ 168.56
NAVE000	Nave, Patrick	Electronic Fund Transfer	0629202114	06/29/2021	\$ 428.00
NETG000	Netgain Networks, Inc	Electronic Fund Transfer	0629202129	06/29/2021	\$ 5,137.28
NETG000	Netgain Networks, Inc	Electronic Fund Transfer	0618202113	06/18/2021	\$ 11,635.24
PGR1000	Patrick Griffith	Electronic Fund Transfer	0610202117	06/10/2021	\$ 2,835.50
PATT001	Patton Sales Corp	Electronic Fund Transfer	0618202114	06/18/2021	\$ 4,005.35

**Victor Valley Wastewater Reclamation Authority
Cash Disbursement Register
From 6/1/21 through 6/30/21**

Vendor #	Vendor Name	Type	Payment #	Date	Total
PRIN000	Principal Life Ins. Co.	Electronic Fund Transfer	DFT02115	06/02/2021	\$ 2,532.96
PVFS000	Pvf Sales Inc	Electronic Fund Transfer	0610202118	06/10/2021	\$ 9,544.53
PVFS000	Pvf Sales Inc	Electronic Fund Transfer	0604202113	06/04/2021	\$ 251.66
RAFT000	Raftelis	Electronic Fund Transfer	0604202114	06/04/2021	\$ 7,095.00
ASHL000	Solenis Llc	Electronic Fund Transfer	0629202130	06/29/2021	\$ 8,666.51
SOUT000	Southern California Edison	Electronic Fund Transfer	DFT02174	06/24/2021	\$ 14,415.31
SOUT000	Southern California Edison	Electronic Fund Transfer	DFT02145	06/17/2021	\$ 105,010.20
SOUT000	Southern California Edison	Electronic Fund Transfer	DFT02146	06/17/2021	\$ 17,453.81
SOUT000	Southern California Edison	Electronic Fund Transfer	DFT02147	06/17/2021	\$ 1,510.63
SOUT000	Southern California Edison	Electronic Fund Transfer	DFT02143	06/10/2021	\$ 960.49
SOUT006	Southwest Gas Company	Electronic Fund Transfer	DFT02176	06/24/2021	\$ 29.09
SOUT006	Southwest Gas Company	Electronic Fund Transfer	DFT02175	06/24/2021	\$ 87.13
SOUT006	Southwest Gas Company	Electronic Fund Transfer	DFT02177	06/24/2021	\$ 46.24
SOUT006	Southwest Gas Company	Electronic Fund Transfer	DFT02148	06/17/2021	\$ 21,734.71
SPAR000	Sparkletts Drinking Water	Electronic Fund Transfer	DFT02116	06/02/2021	\$ 809.52
CHAR001	Spectrum (Prev. Charter Communications)	Electronic Fund Transfer	DFT02178	06/24/2021	\$ 4,946.40
STAT001	State Water Resources Control Board	Electronic Fund Transfer	DFT02151	06/17/2021	\$ 1,027,609.73
STAT001	State Water Resources Control Board	Electronic Fund Transfer	DFT02152	06/17/2021	\$ 271,632.70
SULZ000	Sulzer Electro-Mechanical Services (Us) Inc.	Electronic Fund Transfer	0604202115	06/04/2021	\$ 174.00
TMOB000	T-Mobile	Electronic Fund Transfer	0604202116	06/04/2021	\$ 198.88
APPL007	Town Of Apple Valley	Electronic Fund Transfer	DFT02149	06/17/2021	\$ 155.59
TYLE000	Tyler Technologies, Inc	Electronic Fund Transfer	0629202131	06/29/2021	\$ 250.00
USAB000	U.S.A. Bluebook	Electronic Fund Transfer	0618202115	06/18/2021	\$ 758.55
USAB000	U.S.A. Bluebook	Electronic Fund Transfer	0604202117	06/04/2021	\$ 1,005.19
UNDE000	Underground Service Alert Of Southern California	Electronic Fund Transfer	0610202119	06/10/2021	\$ 109.23
UPS0000	Ups	Electronic Fund Transfer	DFT02179	06/24/2021	\$ 28.03
UPS0000	Ups	Electronic Fund Transfer	DFT02150	06/17/2021	\$ 353.87
UPS0000	Ups	Electronic Fund Transfer	DFT02117	06/02/2021	\$ 73.12
VETE000	Veteran Janitorial, Llc	Electronic Fund Transfer	0618202116	06/18/2021	\$ 2,630.00
VVWE000	Victor Valley Wastewater Employees Assoc	Electronic Fund Transfer	0629202132	06/29/2021	\$ 650.00
VVWE000	Victor Valley Wastewater Employees Assoc	Electronic Fund Transfer	0604202118	06/04/2021	\$ 650.00
WAGE000	Wageworks, Inc	Electronic Fund Transfer	0604202119	06/04/2021	\$ 113.00
WAUK000	Waukesha-Pearce Industries, Llc	Electronic Fund Transfer	0629202133	06/29/2021	\$ 696.20
WAXI000	Waxie Sanitary Supply	Electronic Fund Transfer	0604202120	06/04/2021	\$ 770.05
WEST011	West Yost & Associates, Inc	Electronic Fund Transfer	0610202120	06/10/2021	\$ 552.50
XYLE000	Xylem Dewatering Solutions	Electronic Fund Transfer	0610202121	06/10/2021	\$ 32,060.74
XYLE000	Xylem Dewatering Solutions	Electronic Fund Transfer	0604202121	06/04/2021	\$ 3,522.60
XYLE001	Xylem Water Solutions	Electronic Fund Transfer	0610202122	06/10/2021	\$ 19,649.13
Total ACH & EFT					\$ 1,935,191.68

Approved

Chang - 07-06-21

Total Checks	\$ 283,572.06
Total ACH and EFT	\$ 1,935,191.68
Total Payroll - June 2021	\$ 341,701.79
Total	\$ 2,560,465.53

**VICTOR VALLEY WASTEWATER
RECLAMATION AUTHORITY**

20111 SHAY ROAD
VICTORVILLE CA 92394
(760) 246-8638



**ORDINANCE NO. 001
RULES AND REGULATIONS
FOR SEWERAGE SERVICE**

JuneJuly 2021

AN ORDINANCE PRESCRIBING THE RULES AND REGULATIONS FOR SEWERAGE SERVICE AND THE OPERATION OF THE REGIONAL SEWERAGE SYSTEM WITHIN THE BOUNDARIES OF THE VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY AND ESTABLISHING THE SERVICE AND USER FEES CHARGES IN CONNECTION WITH PROVIDING SUCH SEWERAGE SERVICE AND THE OPERATION AND MAINTENANCE OF THE REGIONAL SEWERAGE SYSTEM, ALL PURSUANT TO STATEMENT OF FINDINGS AND BOARD ACTION SET FORTH IN THIS ORDINANCE NO. 001.

**STATEMENT OF FINDINGS AND BOARD ACTION
REGARDING THE ADOPTION OF
ORDINANCE NO. 001**

WHEREAS, Ordinance No. 001 of the Victor Valley Wastewater Authority (“VWVRA”) adopted by the Board of Commissioners (“Commission”) of VWVRA on October 8, 1980, (also known as Ordinance No. 80-19, a copy of which is attached hereto as Exhibit “A” and is incorporated herein by this reference) establishes and imposes a schedule of user fees for services provided by the collection and treatment system owned, maintained and operated by VWVRA; and

WHEREAS, Article 11, Section 11-02 of Ordinance No. 001 provides in pertinent part that the Commission reserves the right to adopt charges and fees for the recovery of costs in connection with the commercial and industrial Pretreatment Program; and

WHEREAS, the funds collected pursuant to Ordinance No. 001 as amended are used to pay for the cost of operating and maintaining the collection and treatment systems owned, maintained and operated by VWVRA and to ensure compliance with regulatory requirements; and

WHEREAS, VWVRA operates a pretreatment program for certain commercial and industrial customers who discharge wastewater into the regional collection system to ensure that such discharge is in compliance with VWVRA quality requirements and does not overload or cause disruptions in the wastewater treatment system; and

WHEREAS, VWVRA issues permits to the commercial and industrial customers who are required to participate in the pretreatment program and charges application and inspection fees, as well as annual permitting fees in connection with such permits to ensure that the commercial and industrial users that are creating the additional burden on the system are paying the full costs associated with the program; and

WHEREAS, an independent analysis of VVWRA's costs in connection with the pretreatment program was undertaken by Larry Walker Associates ("Report") and VVWRA's permitting fees and fee structure were reviewed and compared to the fees imposed by similar agencies; and

WHEREAS, the Report, a copy of which is attached hereto as Exhibit "A", determined that VVWRA is not recovering the full cost of operating the pretreatment program and recommended an increase in pretreatment program fees to address this deficit;

WHEREAS, the Report also pointed out that certain commercial and industrial users create a higher compliance and enforcement burden within the pretreatment program and recommended that VVWRA charge annual permitting fees by permit type to reflect the actual cost of the different classes of commercial and industrial user; and

WHEREAS; the member entities (i) have local pretreatment programs for the handling of FOG (food, oil and grease) that is generated by restaurants, (ii) require local permits in connection with such programs, and (iii) enforce permit requirements through the local inspection process, it was determined that wastewater pretreatment for Food Service Establishments should be handled exclusively through member entity pretreatment programs to avoid duplication of cost and regulatory burden on Food Service Establishments;

WHEREAS, (1) after discussing these matters with staff for its member entities and the VVWRA Engineering Committee, (2) review and consideration of the Report by the Commission; and (3) conducting the necessary notice and public hearing process in the matter, the Commission believes that the proposed changes in the pretreatment program fees and the structure of those fees and the elimination of duplicate cost with respect to the permitting of Food Service Establishments, is necessary in light of the findings above.

WHEREAS, in 2016, Ordinance No. 001 was amended to allow a third party acting under the authority granted by a member entity to make a direct connection to a VVWRA interceptor and the member entities, in consultation with staff, have determined that only member entities should have such authority and the language added in 2016 should be deleted.

WHEREAS, the Commission has approved Resolution 2021-06 setting tipping fee for solid waste ADM disposal as authorized pursuant to Section 07-04 of the Ordinance and such Resolution has been attached hereto as Exhibit "B".

NOW THEREFORE, the Board of Commissioners of the Victor Valley Wastewater Reclamation Authority hereby ordains as follows:

Section 1. Findings. The Board of Commissioners asserts and adopts the findings set forth above;

Section 2. Change In Pretreatment Program Fees. The current Pretreatment Program Fee Schedule is hereby revised as follows:

(a) Annual Wastewater Discharge Permit Fees will be set on the basis of the type of permit, with separate fees for Class I, II, III and IV permits, to take into account the differences in the actual cost to VVWRA of administering the Pretreatment Program with respect to each such class; and

(b) The Pretreatment Program Fee Schedule will be modified as set forth in the revised Table IV to provide for full cost recovery of the expenses incurred by VVWRA to operate the Pretreatment Program.

Section 3. Repeal of Table IV of Ordinance No. 001 Table IV is hereby repealed in its entirety and, as set forth below, is to be replaced by the Amended Table IV attached hereto..

Section 4. Amendment of Table IV of Ordinance No. 001 Table IV, as referenced in Section 11-02 of Ordinance No. 001, is hereby amended and revised as set forth in the attachment hereto and is incorporated herein by the reference.

Section 5. Permitting of Food Service Establishments. Food Service Establishments will hereinafter be permitted exclusively through the pretreatment programs operated by the member agencies to promote efficiency and avoid duplication of cost and regulatory burden on Food Service Establishments within the boundaries of the member agencies.

Section 6. Direct Connections to VVWRA Interceptor. The flexibility added to Ordinance No. 001 in 2016 to allow direct connections to a VVWRA interceptor by a third party acting under the authority of a member entity is hereby rescinded.

Section 7. ADM Tipping Fees ~~Additional Changes.~~ Ordinance No. 001 has been updated with ~~such technical revisions as are necessary to implement the changes discussed herein~~ tipping fee set forth in Resolution 2021-06.

Section 8. Additional Changes. ~~Section 8.~~ Ordinance No. 001 has been updated with ~~such technical revisions as are necessary to implement the changes discussed herein.~~

Section 9. Continued Effect of Remaining Provisions of Ordinance No. 001. The remaining provisions of Ordinance No. 001 not expressly repealed or amended by this Ordinance shall remain in full force and effect.

Section ~~9~~10. Effective Date. This Ordinance shall take effect and be in full force thirty (30) days after its adoption. Prior to the expiration of the fifteen (15) days from its adoption, the Ordinance or a summary of it shall be published in The Daily Press, a newspaper of general circulation within the boundaries of the Victor Valley Wastewater Reclamation Authority, or a newspaper of substantially equivalent circulation.

Section ~~10~~11. Notice of Exemption. Within five working days after the passage and adoption of this Ordinance, the Commission hereby authorizes and directs staff to prepare, execute, and file with the County Clerk a Notice of Exemption for the revisions to Ordinance No. 001.

Formatted: Indent: First Line: 0"

BEGIN TEXT OF ORDINANCE NO. 001

DRAFT

LEGISLATIVE HISTORY

ORDINANCE NO. 001

(PREVIOUSLY REFERRED TO AS ORDINANCE 80-19)

ADOPTED: 10/08/80

AMENDED: 11/25/81

AMENDED: 06/03/82

AMENDED: 11/17/83

AMENDED: 06/28/84

AMENDED: 06/27/85

AMENDED: 06/26/86

AMENDED: 01/29/87

AMENDED: 06/25/87

AMENDED: 06/30/88

AMENDED: 07/01/89

AMENDED: 07/01/90

AMENDED: 07/01/91

AMENDED: 06/25/92

AMENDED: 05/27/93

AMENDED: 05/26/94

AMENDED: 03/30/95

AMENDED: 05/23/96

AMENDED: 08/27/97

AMENDED: 10/28/99

AMENDED: 07/25/01

AMENDED: 07/05/02

AMENDED: 06/22/07

AMENDED: 06/20/08

AMENDED: 06/29/09

AMENDED: 06/21/12

AMENDED: 03/20/14

AMENDED: 05/20/15

AMENDED: 02/18/16

AMENDED: 10/23/19

REPEALED AND RESTATED: 6/17/2021

Table of Contents

LEGISLATIVE HISTORY	7
ARTICLE 01: GENERAL.....	9
ARTICLE 02: JURISDICTION	11
ARTICLE 03: DEFINITIONS AND ABBREVIATIONS.....	12
ARTICLE 04: AREA SERVED	32
ARTICLE 05: GENERAL REQUIREMENTS.....	33
ARTICLE 06: FACILITIES DESIGN AND CONSTRUCTION	35
ARTICLE 07: FACILITIES OPERATION.....	36
ARTICLE 08: DISCHARGE OF NONDOMESTIC WASTEWATER	38
ARTICLE 09: ADMINISTRATIVE PROCEDURES	61
ARTICLE 10: SERVICE AND USE CHARGES	64
ARTICLE 11: CONNECTION AND PRETREATMENT PROGRAM FEES	66
ARTICLE 12: EXECUTIVE PROVISIONS.....	69
ARTICLE 13: ENFORCEMENT	70
Approval and Adoption.....	77
Certification	78
Form of Certificate of Adequacy of Sewerage System	79
Table I: Specific Local Pollutant Concentration Limits	80
Table II: Fee Schedule	81
Table III: Unit Operations and Maintenance Cost Determination.....	83
Table IV: Pretreatment Program Fee Schedule	Error! Bookmark not defined.
Exhibit A - Larry Walker Associates Report.....	Error! Bookmark not defined.

ARTICLE 01: GENERAL

The purpose of these Rules and Regulations is to provide for the maximum possible beneficial public use of the Victor Valley Wastewater Reclamation Authority (VWVRA) facilities through adequate regulation of sewer design and construction, sewer use, and industrial wastewater discharges; to provide equitable distribution of the costs of the regional sewerage system and to provide procedures for complying with requirements placed upon the Reclamation Authority by other regulatory agencies.

The provisions of these Rules and Regulations shall apply to the direct or indirect discharge of all liquid carried wastes to facilities of the Reclamation Authority and the collection and processing of solid wastes that qualify as ADM and are approved by the Reclamation Authority from time to time. These Rules and Regulations, among other things, provide for the regulation of sewer service and construction in areas within the Reclamation Authority service area, the quality and quantity of discharged wastes, the degree of waste pretreatment required, the issuance of permits for wastewater discharge and of other miscellaneous permits, and the establishment of penalties for violation.

Unless otherwise provided herein, the Reclamation Authority, shall administer, implement, and enforce the provisions of this document. Each Member Entity will provide its own design and construction specifications for local systems. These specifications will be regulated and enforced individually by the Member Entities. The regulation of inflow into the sanitary sewer systems of each Member Entity is available under the following conditions:

- a) Domestic waste hook-up will be regulated by a permit procedure by each Member Entity.
- b) Industrial/commercial waste hook-up will be regulated by the individual Member Entities; however, all discharge of nondomestic wastewater will be subject to the standards and procedures set forth in this Ordinance as adopted and as hereafter amended; and with respect to Food Service Establishments, by the standards and procedures established by the Member Entities consistent with the requirements of this Ordinance.

The Reclamation Authority is a Joint Powers Agency created expressly for the purpose of treatment of wastewater and the ultimate disposal of effluent and solids in compliance with waste discharge requirements set from time to time by the California Regional Water Quality Control Board (Regional Board), Lahontan Region, and any and all applicable Federal, State, and Local statutes, ordinances regulations, and other requirements.

Sewerage service by the Reclamation Authority, subject to the availability of facilities, adequate capacity in facilities, funds or financing for the construction thereof, or all of the foregoing, is available to Member Entities on the terms of conditions herein established. The availability of such service is to be furnished to each Member Entity on the same basis, so that all such entities may be served in an equal and comparable manner.

The original financing for the regional sewerage system was established pursuant to Financial Policy Resolution 81-10 dated November 1981. On an ongoing basis, the Reclamation Authority Financial and Revenue Plan sets forth the means of funding capital and operational costs of the regional sewerage system. In general, the Reclamation Authority sets rates for service to the Member Entities that cover the costs of operating the regional sewerage system. The Reclamation Authority further establishes connection fees to fund capital infrastructure for the regional sewerage system. Connection fees are collected by each Member Entity from users at the local level on behalf of the Reclamation Authority.

It is additionally the intent of the Reclamation Authority to utilize reclaimed water to the maximum beneficial advantage of the community. This use may encompass all or a combination of ground water recharge, landscape irrigation, agricultural irrigation, industrial process water, recreational impoundment, or other beneficial use thereof.

The Reclamation Authority intends to provide regional sewerage service to its Member Entities through sound fiscal planning so as to provide capacity at all times to meet the growth of the area. The Reclamation Authority, however, urges that strong control measures be adopted within each Member Entity to encourage water conservation. In this manner, the Reclamation Authority would not only provide reuse of the treated wastewater, but even more importantly, reduce the consumptive use of high quality drinking water available within its boundaries.

The Reclamation Authority is committed to generating renewable energy through the collection and utilization of biogas that is a byproduct of the treatment process, including the processing of additional solid waste that qualifies as ADM within the digesters of the Reclamation Authority to maximize biogas generation.

ARTICLE 02: JURISDICTION

Pursuant to the regional "project concept", the "contracting communities" or "Member Entities" will collect sewage through locally owned and operated municipal collector systems within their respective boundaries and transmit same to the Reclamation Authority owned and operated regional sewerage system, via the Reclamation Authority's interceptor pipelines, for treatment and ultimate disposition of the treated effluent.

Reclamation Authority may establish policies and procedures for the acceptance of septage and solid waste products that qualify as ADM from waste haulers directly at its primary treatment facility. Reclamation Authority will further adopt standard operating procedures for the handling and treatment of solid waste products that qualify as ADM.

All Member Entities recognize that the violation of any rule and regulation regarding the use of the regional sewerage system by a Member Entity or any of its dischargers could jeopardize the integrity and operation of the regional system and the Reclamation Authority's ability to provide regional wastewater service to the entity in question and to the other Member Entities and their dischargers. In addition, all Member Entities recognize the importance of fair, equitable, and uniform enforcement of said Rules and Regulations throughout the regional system service area. Accordingly, each Member Entity pledges to comply with, honor, and enforce all Rules and Regulations in force relating to the regional sewerage system within their respective boundaries; and agrees to delegate to the Reclamation Authority the primary power and authority to regulate the discharge of nondomestic wastewater by Industrial Users into the tributary sewerage systems.

Notwithstanding anything contained herein which may appear to be to the contrary, the Member Entities shall have and retain exclusive jurisdiction and control over their local collector systems and the Reclamation Authority shall have and retain exclusive jurisdiction and control over the regional sewerage system.

ARTICLE 03: DEFINITIONS AND ABBREVIATIONS

03-01 - Definitions

For the purposes of this Ordinance, the following words and phrases are defined and shall be construed as hereinafter set out unless it shall be apparent from the context that they have a different meaning.

ACT shall mean the Federal Water Pollution Control Act of 1972, also known as the Clean Water Act, as amended, 33 USC 1251, et. seq. This Act has been incorporated by reference into California Law in the Water Code, Chapter 5.5.

ANAEROBICALLY DIGESTIBLE MATERIALS or ADM shall mean waste that can be accepted by the Reclamation Authority for treatment and disposal directly into the anaerobic digester at the wastewater treatment plant. These wastes include FOG, Food Waste and inedible kitchen grease as defined in section 19216 of the California Food and Agriculture Code and food material as defined in Title 14 of the California Code of Regulations, Chapter 3.1, Article 1, section 17852(a)(20).

APPROVED ANALYTICAL METHODS shall mean the sampling referred to in 40 CFR Part 403, Appendix E and analysis of these samples performed in accordance with the techniques prescribed in 40 CFR Part 136 and amendments thereto. Where 40 CFR Part 136 does not contain sampling or analytical techniques for the pollutant in question, or where the EPA determines that the Part 136 sampling and analytical techniques are inappropriate for the pollutant in question, sampling and analysis shall be performed using other applicable sampling and analytical procedures approved by the VVWRA and the EPA.

APPROVAL AUTHORITY shall mean the State of California Water Resources Control Board and/or the California Regional Water Quality Control Board, Lahontan Region.

AUTHORITY INTERCEPTOR shall mean those interceptor sewers owned by the Reclamation Authority for the conveyance of liquid wastes from Member Entity tributary sewerage systems to the Reclamation Authority's wastewater treatment facilities.

AUTHORITY SEWERAGE FACILITY shall mean any property belonging to the Reclamation Authority used in the treatment, reclamation, reuse transportation, or disposal of wastewater.

AUTHORIZED OR DULY AUTHORIZED REPRESENTATIVE OF THE USER shall mean:

1. If the User is a corporation:
 - a. A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation, or
 - b. The manager of one or more manufacturing, production, or operating facilities, provided, the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty

of making major capital investment recommendations, and initiate and direct other comprehensive measures to assure long-term environmental compliance with environmental laws and regulations; can ensure that the necessary systems are established or actions taken to gather complete and accurate information for control mechanism requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.

2. If the User is a partnership or sole proprietorship: a general partner or proprietor, respectively;
3. If the User is a Federal, State, or local government facility: a director or highest official appointed or designated to oversee the operation and performance of the activities of the government facility, or their designee; or
4. The individuals described paragraphs 1, 2, and 3, above, may designate a Duly Authorized Representative if the authorization is in writing, the authorization specifies the individual or position responsible for the overall operation of the facility from which the discharge originates or having overall responsibility for environmental matters for the company, and the written authorization is submitted to VVWRA.

If authorization under item 4 of this definition is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, or overall responsibility for environmental matters for the company, a new authorization satisfying the requirements of item 4 of this definition must be submitted to the VVWRA prior to or together with any reports to be signed by an authorized representative.

AVERAGE DAILY FLOW shall mean the arithmetic average value for the number of gallons of wastewater discharged into the sewer system during a 24-hour period.

BEST MANAGEMENT PRACTICES (BMPs) shall mean schedules of activities, prohibitions of practices, maintenance procedures, and other management practices to implement the prohibitions listed in Article 8. BMPs include treatment requirements, operating procedures, and practices to control plant site runoff, spillage or leaks, sludge or waste disposal, or drainage from raw materials storage.

BIOCHEMICAL OXYGEN DEMAND (BOD) shall mean the quantity of dissolved oxygen required to biochemically oxidize the organic matter in a wastewater sample in five (5) days at 20°C expressed in terms of milligrams per liter (mg/l) and analyzed in accordance with Approved Analytical Methods.

BUILDING SEWER shall mean any sewer or sewer lateral conveying wastewater from the premises of a User to the public sewer system.

BUILDING SEWER - SANITARY shall mean a sewer pipe receiving flow from a single building and connecting to a sewer main or lateral, and constructed on private property, except for street crossing.

CATEGORICAL INDUSTRIAL USER (CIU) shall mean an Industrial User who is subject to promulgated Categorical Standards.

CATEGORICAL STANDARDS shall mean any regulation containing pollutant discharge limits promulgated by EPA in accordance with sections 307(b) and (c) of the Act (33 USC section 1317) that apply to a specific category of Users and that appears in 40 CFR Chapter I, Subchapter N, Parts 405-421, as it exists and as it may be amended.

CHEMICAL OXYGEN DEMAND shall mean the quantity of dissolved oxygen required to chemically oxidize the contents of a waste sample under specific conditions of oxidizing agent, temperature, and time, expressed in terms of milligrams per liter (mg/l) and analyzed in accordance with Approved Analytical Methods.

CLASS I USER shall mean a Categorical Industrial User. (CIU)

CLASS II USER shall mean a Non-categorical Significant Industrial User. (NCSIU)

CLASS III USER shall mean a Non-Significant Industrial User. (NSIU)

CLASS IV USER shall mean a Temporary Industrial User. (TIU)

CLASS V USER shall mean a discharger of trucked or hauled wastewater to the POTW.

COLIFORM BACTERIA shall mean any of a number of species of bacterial organisms common to the intestinal tracts of humans and animals whose presence in sewage is an indicator of the potential presence of pathogens.

COLLECTION SEWER shall mean a public sewer owned and operated by a Member Entity, whose primary purpose is to collect wastewaters from individual point source discharges.

COMBINED SEWAGE shall mean a combination of both wastewater and storm or surface water.

COMBINED SEWER shall mean a sewer intended to receive both wastewater and storm or surface water.

COMMERCIAL WASTEWATER shall mean wastewater from any retail store, restaurant, office building, laundry, church, lodge, or other private business or service establishment.

COMMISSION shall mean the Board of Commissioners of the Reclamation Authority.

COMPATIBLE POLLUTANT shall mean BOD, suspended solids, pH, coliform bacteria, and such additional pollutants as are now or may be in the future specified and controlled by the Reclamation Authority's permit, for its wastewater treatment works as said works have been designed and are operated to reduce or remove such pollutants.

COMPLIANCE TIME SCHEDULE shall mean a formal timetable for achieving compliance required of Users in violation of the provisions of this Ordinance. Each Compliance Time Schedule shall contain milestone dates as well as a final compliance date, and shall be approved by the Manager.

COMPOSITE SAMPLE shall mean a sample which is collected from a wastewater discharge over a time period of twenty-four (24) hours. A composite sample may be collected using automatic continuous or discrete sampling equipment, or by manually collecting and compositing a minimum of four grab samples. Where specified by the Manager, composite samples shall be collected in a manner which is proportional to the flow rate of the discharge.

CONNECTION FEE shall mean a fee paid by a new system discharger to fund the capital costs associated with service capacity in the regional wastewater system.

CONSTITUENT shall mean any physical, chemical, or microbiological component or parameter of water or wastewater which can be quantified using Approved Analytical Methods.

CONSTRUCTION DRAINAGE shall mean water accumulated in excavations; water taken from the ground through a well-point, underdrain or other dewatering systems; water accumulated as a result of grading; and all other drainage associated with construction operations.

CONTROL AUTHORITY shall mean the General Manager of the VVWRA or his authorized representative, agent, or deputy.

CONTROL STRUCTURE shall mean a manhole, vault, or other chamber specially constructed for the purpose of sampling and measuring the flow of a nondomestic wastewater discharge to the POTW.

CONVENTIONAL POLLUTANT shall mean any pollutant or combination of pollutants listed as conventional in 40 CFR Part 401.16.

COUNTY shall mean the County of San Bernardino or the Board of Supervisors of the County of San Bernardino, California.

DAILY MAXIMUM shall mean the arithmetic average of all effluent samples for a pollutant collected during a calendar day.

DAILY MAXIMUM LIMIT shall mean the maximum allowable discharge limit of a pollutant during a calendar day. Where Daily Maximum Limits are expressed in units of mass, the daily discharge is the total mass discharged over the course of the day. Where Daily Maximum Limits are expressed in terms of concentration, the daily discharge is the arithmetic average measurement of the pollutant concentration derived from all measurements taken that day.

DEVELOPMENTS shall mean parcels of land on which dwelling units, commercial, or industrial buildings, or improvements are built.

DIRECT DISCHARGE shall mean the discharge of wastewater to the storm drain system or waters of the State of California or the United States.

DISCHARGE TO THE GROUND shall mean the discharge of wastewater to or into the soil and not contained in a facility approved by the Manager as being impermeable.

DISCHARGER shall mean any person who causes or contributes a discharge into the POTW.

DISSOLVED ORGANIC HALIDES (DOX) shall mean the measure of dissolved halogenated organic material in domestic or other wastewater as analyzed in accordance with Approved Analytical Methods.

DISSOLVED SOLIDS shall mean the residues of the dissolved constituents in water.

DOMESTIC WASTEWATER (DOMESTIC SEWAGE) shall mean water bearing wastes from residences and other premises resulting from personal use of water for ordinary living processes.

EASEMENT shall mean an acquired legal right for the specific use of land owned by others.

EFFLUENT shall mean the liquid outflow from any POTW facility; or the nondomestic wastewater discharged by a User to the POTW.

ELECTRICAL CONDUCTIVITY (EC) shall mean the ability of an aqueous solution to carry an electrical current, expressed in terms of micromhos per centimeter (umhos/cm) at 25°C, and analyzed in accordance with Approved Analytical Methods.

ENVIRONMENTAL PROTECTION AGENCY (EPA) shall mean the United States Environmental Protection Agency, or where appropriate, the Regional Water Management Division Director, the Regional Administrator, or other duly authorized official of said agency.

EXCHANGE-TYPE WATER CONDITIONING DEVICE shall mean a water conditioning device that is removed to and serviced at a commercial regeneration facility for regeneration from the premises at which it is normally operated.

EXISTING SOURCE shall mean any source of discharge that is not a "New Source".

FLOATABLE OIL shall mean oil, fat, or grease that is made up of organic polar compounds derived from vegetable/plant or animal sources that are composed of long chain triglycerides (3 fatty acid molecules with one glycerol) and is in a physical state such that it will separate by gravity from wastewater by treatment in a pretreatment facility approved by the Reclamation Authority and Member Entity.

FATS, OIL, and GREASE (FOG) shall mean any substance such as vegetable or animal product that is used in, or is a byproduct of, the cooking for food preparation process, and that turns or may turn viscous or solidify with a change in temperature or other conditions.

FOOD PROCESSING FACILITY shall mean a wholesale or retail facility which handles, processes, or prepares foodstuffs intended for human and/or animal consumption.

FOOD SERVICE ESTABLISHMENT (FSE) shall mean means facilities defined in California Uniform Retail Food Facilities Law (CURFFL) Section 113785, and any commercial entity (such as, but not limited to, restaurants, commercial kitchens, caterers, hotels, bakeries, donut shops, public and private schools, hospitals, prisons, correctional facilities, and care institutions) within the service area, operating in a permanently constructed structure such as a room, building, or place, or portion thereof, maintained, used, or operated for the purpose of preparing, serving, or

manufacturing, packaging, or otherwise handling food for sale to other entities, or for consumption by the public, its members or employees, and which has any process or device that uses or produces FOG, or grease vapors, steam, fumes, smoke or odors that are required to be removed by a Type I or Type II hood, as defined in CURFFL Section 113785. A limited food preparation establishment is not considered a food service establishment when engaged only in reheating, hot holding or assembly of ready to eat food products and as a result, there is no wastewater discharge containing a significant amount of FOG. A limited food preparation establishment does not include any operation that changes the form, flavor, or consistency of food.

FOOD WASTE shall mean organic wastes derived from pre- and post-processed plants and animals (excluding those wastes generated at rendering facilities) for the explicit creation of foods for human and/or animal consumption. This includes, but may not be limited to, those foods and scraps processed or produced at restaurants, hospitals, food distributors, schools and residences.

FORCE MAIN shall mean a pipe in which wastewater is carried under pressure.

GARBAGE shall mean solid wastes from the domestic and commercial preparation, cooking and dispensing of food, and from the handling, storage and sale of food; and from solid waste recycling and separation facilities.

GENERAL MANAGER or MANAGER shall mean the General Manager of the VVWRA.

GRAB SAMPLE shall mean a sample which is collected from a wastewater discharge without regard for flow over a period of time not exceeding fifteen (15) minutes.

GRAVITY SEPARATION INTERCEPTOR shall mean an approved detention chamber designed to remove grease, oil, and solids from wastewater before discharge to the POTW.

HAZARDOUS SUBSTANCE shall mean any substance which is toxic, explosive, corrosive, flammable or an irritant, or which generates pressure through heat or decomposition including, but not limited to, any substance determined to be a toxic or hazardous substance pursuant to Section 307 and 311(b)(2) of the Clean Water Act, 33 USC, Section 1251, et. seq., or its implementing regulations at 40 CFR Section 307 and 311; any substance classified as a hazardous substance pursuant to California Water Code Section 13050(p) and; any imminently hazardous chemical substance subject to regulation under the Toxic Mixtures or Substances Control Act, 15 USC, Section 2601, et seq.

HAZARDOUS WASTE shall mean any hazardous substance which is either the resultant and/or intermediate or final by-product of any process.

HOLDING TANK WASTE shall mean any waste from holding tanks such as vessels, chemical toilets, campers, trailers, septic tanks, and vacuum-pump tank trucks.

INCOMPATIBLE POLLUTANT shall mean any non-treatable waste product including non-biodegradable dissolved solids.

INDIRECT DISCHARGE or DISCHARGE shall mean the introduction of pollutants into a POTW from any non-domestic source regulated under section 307(b), (c) or (d) of the Act.

INDUSTRIAL PLANT shall mean any facility which discharges industrial wastes. Each industrial plant will be considered and analyzed individually even though an owner may operate two or more industrial plants within the Reclamation Authority service area. A multi-building industrial plant located on a single site shall not be arbitrarily divided into separate units for the purpose of obtaining additional deductions and exemptions.

INDUSTRIAL SEWER shall mean a sewer owned and operated by an industry.

INDUSTRIAL USER (IU) The term Industrial User or User means a source of Indirect Discharge.

INDUSTRIAL WASTE ENFORCEMENT OFFICER shall mean a person authorized by the Reclamation Authority and Member Entities to inspect wastewater generation, conveyance, processing, and disposal facilities.

INDUSTRIAL WASTEWATER shall mean wastewater generated by industrial users.

INFILTRATION shall mean the water unintentionally entering the public sewer system, including groundwater seepage, through such means as, but not limited to, defective pipes, pipe joints, connections, or manhole walls.

INFILTRATION/INFLOW shall mean the total quantity of water from both infiltration and inflow without distinguishing the source.

INFLOW shall mean the water discharge into a sanitary sewer system, including building drains and sewers, from such sources as, but not limited to, roof leaders, cellar, yard, and area drains, foundation drains, unpolluted cooling water discharges, drains from springs and swampy areas, manhole covers, cross connections from storm sewers and/or combined sewers, catch basins, stormwaters, surface runoff, street wash waters or drainage. (Inflow does not include, and is distinguished from, infiltration.)

INSTANTANEOUS LIMIT shall mean the maximum concentration of a pollutant allowed to be discharged at any time, determined from the analysis of any discrete or composited sample collected, independent of the flow rate and the duration of the sampling event.

INTERCEPTOR shall mean a gravity separation interceptor.

INTERCEPTOR SEWER shall mean a sewer whose primary purpose is to convey wastewater from the collection sewers of a Member Entity to the Reclamation Authority's wastewater treatment facilities.

INTERFERENCE shall mean a discharge which alone or in conjunction with a discharge or discharges from other sources, both:

- a) Inhibits or disrupts the POTW, its treatment processes or operations, or its sludge processes, use or disposal; and
- b) Causes a violation of any requirement of the POTW's NPDES permit and/or WDR (including an increase in the magnitude or duration of a violation) or of the prevention of sewage sludge use or disposal in compliance with the use or disposal in compliance with the following statutory provisions and regulations or permits issued thereunder (or more stringent State or local regulations): Section 405 of the Clean Water Act, the Solid Waste Disposal Act (SWDA) (including Title II, more commonly referred to as the Resource Conservation and Recovery Act (RCRA), and including State regulations contained in any State sludge management plan prepared pursuant to Subtitle D of the SWDA), the Clean Air Act, the Toxic Substances Control Act, and the Marine Protection, Research and Sanctuaries Act.

JOINT POWERS AUTHORITY shall mean members included in the Joint Exercise of Powers Agreement comprised of the following parties: City of Victorville, Town of Apple Valley, City of Hesperia, and County Service Areas No. 42 (Oro Grande) and No. 64 (Spring Valley Lake) or the entity known as VVWRA, however constituted.

LIQUID WASTE HAULER DISCHARGE PERMIT shall mean the regulatory procedure established and enforced by the Manager pursuant to Section 07-03 herein, to allow for the proper discharge of Septage into the POTW LOCAL LIMIT shall mean specific discharge limits developed and enforced by the Reclamation Authority upon industrial or commercial facilities to implement the general and specific discharge prohibitions listed in 40 CFR Part 403.5(a)(1) and (b).

LOCAL SEWERING AGENCY shall mean the Member Entity, as designated in the Joint Powers Agreement, with authority to approve building plans for a particular User.

LOWER EXPLOSIVE LIMIT (LEL) shall mean the minimum concentration of a combustible gas or vapor in the air which will ignite if an ignition source is present.

MAINTENANCE shall mean keeping the sewer lines, sewer systems, sewer facilities or sewage works and structures in satisfactory working condition and good state of repair (including, but not limited, to preventing any obstructions or extraneous materials or flows from entering said facilities, protecting said facilities from any damage, and keeping same free from defects or malfunctions), and making necessary provisions and taking necessary precautions to assure that said sewer facilities are at all times capable of satisfactorily performing the services, and

adequately discharging the functions and producing the final results and purposes said facilities are intended to perform, discharge, or produce.

MASS EMISSION RATE shall mean the mass of material discharged to the POTW during a given time interval. Unless otherwise specified, the mass emission rate shall be expressed in pounds per day of a particular constituent or combination of constituents.

MAY is permissive.

MEMBER ENTITY shall mean one of the public functional entities that are legally accepted as members of the VVWRA and so designated in the JPAG.

MILLIGRAMS PER LITER (mg/l) shall mean a unit of the concentration of water or wastewater constituent. It is 0.001 g of the constituent in 1,000 ml of water. It has replaced the unit formerly used commonly, parts per million, to which it is approximately equivalent in reporting the results of water and wastewater analysis.

MONTHLY AVERAGE shall mean the sum of all “daily discharges” measured during a calendar month divided by the number of “daily discharges” measured during that month.

MONTHLY AVERAGE LIMIT shall mean the highest allowable average of “daily discharges” over a calendar month, calculated as the sum of all “daily discharges” measured during a calendar month divided by the number of “daily discharges” measured during that month.

NATIONAL PROHIBITIVE DISCHARGE STANDARD OR PROHIBITIVE DISCHARGE STANDARD shall mean any regulation developed under the authority of Section 307(b) of the Act and 40 CFR Part 403.5.

NATURAL OUTLET shall mean any outlet, including storm sewers and combined sewer overflows, into a water course; pond, ditch, lake or other body of surface or ground water.

NEW SOURCE shall mean

- (1) Any building, structure, facility, or installation from which there is or may be a discharge of pollutants to the POTW, the construction of which commenced after the publication of proposed Pretreatment Standards under Section 307(c) of the Act which will be applicable to such source if such Standards are thereafter promulgated in accordance with that Section.
 - a. The building, structure, facility, or installation is constructed at a site at which no other source is located; or
 - b. The building, structure, facility, or installation totally replaces the process or production equipment that causes the discharge of pollutants at an Existing Source; or
 - c. The production or wastewater generating processes of the building, structure, facility, or installation are substantially independent of an Existing Source at the same site. In determining whether these are substantially independent, factors such as the extent to which the new facility is integrated with the existing plant, and the extent to which the new facility is engaged in the same general type of activity as the Existing Source, should be considered
- (2) Construction on a site at which an Existing Source is located results in a modification rather than a New Source if the construction does not create a new building, structure, facility, or installation meeting the criteria of Section (1) (b) or (c) above but otherwise alters, replaces, or adds to existing process or production equipment.

- (3) Construction of a New Source as defined under this paragraph has commenced if the owner or operator has:
- a. Begun, or caused to begin, as part of a continuous onsite construction program
 - i. any placement, assembly, or installation of facilities or equipment; or
 - ii. significant site preparation work including clearing, excavation, or removal of existing buildings, structures, or facilities which is necessary for the placement, assembly, or installation of new source facilities or equipment; or
 - b. Entered into a binding contractual obligation for the purchase of facilities or equipment which are intended to be used in its operation within a reasonable time. Options to purchase or contracts which can be terminated or modified without substantial loss, and contracts for feasibility, engineering, and design studies do not constitute a contractual obligation under this paragraph.

NON-CATEGORICAL SIGNIFICANT INDUSTRIAL USER (NCSIU) shall mean a Significant Industrial User which is not subject to promulgated Categorical Standards.

NON-CONTACT COOLING OR HEATING WATER shall mean water which is used solely for the purpose of cooling or heating, and which has no direct contact with any raw material, intermediate product, waste product, or finished product.

NONDOMESTIC WASTEWATER shall mean all wastewater except domestic wastewater and unpolluted water as defined herein. Nondomestic wastewater shall include, but not be limited to, wastewater resulting from industrial, commercial, producing, manufacturing, processing, institutional, governmental, and agricultural operations, and brine wastewater resulting from the regeneration of water conditioning devices. All liquid wastewater hauled by truck, rail, or another means shall also be considered as nondomestic wastewater, regardless of the original source of the wastes. Hauled domestic wastewater is included in the category of nondomestic wastewater.

NONDOMESTIC WASTEWATER DISCHARGE PERMIT (PERMIT) shall mean the regulatory procedure established and enforced by the Manager pursuant to Section 08-07 herein, to control the flow and quality of wastes discharged into the POTW.

NONRESIDENTIAL USER shall mean any Industrial User or Commercial Discharger.

NON-SIGNIFICANT INDUSTRIAL USER (NSIU) shall mean any Industrial User which is not a Significant Industrial User.

NORMAL WORKING DAY shall mean the period of time during one day during which production and/or operation is taking place.

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) PERMIT shall mean the permit issued to the POTW by the California Regional Water Quality Control Board, Lahontan Region pursuant to Section 402 of the Act (33 USC 1342).

NORTH AMERICAN INDUSTRY CLASSIFICATION SYSTEM (NAICS) shall mean the classification of business establishments that was adopted in 1997 to replace the Standard Industrial Classification system as outlined in the 2012 U.S. NAICS Manual; or latest edition thereof.

PETROLEUM BASED OIL AND GREASE shall mean Petroleum derived products, e.g., oils, fuels, lubricants, solvents;

OWNER shall mean any individual, firm, company, association, society, corporation or group discharging any wastewater to the POTW.

PASS-THROUGH shall mean any discharge which exits the POTW into waters of the State of California or United States in quantities or concentrations which, alone or in conjunction with other discharges, causes a violation of any requirement of the POTW's NPDES permit (including an increase in the magnitude or duration of a violation).

PATHOGEN shall mean any bacterial, viral, protozoan or other microbial organism which has the ability to cause disease in man.

PERMITTEE shall mean any User who is issued a Nondomestic Wastewater Discharge Permit pursuant to Section 08-07 herein.

PERSON shall mean any individual, family, household, partnership, co-partnership, firm, industry, company, corporation, association, society, Joint Stock Company, trust, estate, governmental entity, or group, Member Entity, or any other legal entity or their legal representatives, agents, or assigns. The masculine gender shall include the feminine; the singular shall include the plural where indicated by the context.

pH shall mean the measure of the acidity or alkalinity of a solution, expressed in standard units and calculated as the logarithm (base 10) of the reciprocal of the concentration of hydrogen ions, as analyzed in accordance with Approved Analytical Methods.

PLUMBING OFFICIAL shall mean the Director of Building and Safety of the Local Sewering Agency or his authorized representative or deputy.

POLLUTANT shall mean any dredged spoil, solid waste, incinerator residue, filter backwash, sewage, garbage, sewage sludge, munitions, chemical wastes, biological materials, radioactive materials, heat, wrecked or discharged equipment, rock, sand, cellar dirt, and industrial, municipal, and agricultural waste, and certain characteristics of wastewater (e.g., pH, temperature, TSS, turbidity, color, BOD, COD, toxicity, or odor).

POLLUTION shall mean the man-made or man-induced adverse alteration of the chemical, physical, biological, and radiological integrity of water.

POPULATION EQUIVALENT shall mean a term used to evaluate the impact of industrial or other waste on a treatment works or stream. One population equivalent of normal domestic sewage is 70 gallons of sewage per day, or 0.12 pounds of BOD or 0.15 pounds of suspended

solids per day. The impact on a treatment works is evaluated as the equivalent of the highest of the three parameters. Impact on a stream is the higher of the BOD and suspended solids parameters.

PUBLICLY OWNED TREATMENT WORKS (POTW) shall mean treatment works as defined by Section 212 of the Act, (33 USC 1292). This definition includes any devices or systems owned and operated by VVWRA and its Member Entities, which are used in the storage, treatment, recycling and reclamation of municipal sewage within the regional sewerage system, the tributary sewerage systems, and any other sewers, pipes, lift stations, and other conveyances which convey wastewater to the wastewater treatment facilities contained therein.

POTW TREATMENT PLANT shall mean the portion of the POTW designed to provide treatment to wastewater.

PRETREATMENT shall mean the reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater to a less harmful state prior to or in lieu of discharging or otherwise introducing such pollutants into the POTW. The reduction or alteration may be obtained by physical, chemical, or biological processes, process changes, or other means, except as prohibited by 40 CFR Part 403.6 (d).

PRETREATMENT REQUIREMENT shall mean any substantive or procedural requirement related to pretreatment, other than a Pretreatment Standard, imposed on a User.

PRETREATMENT STANDARD shall mean any regulation containing pollutant discharge limits or prohibitions promulgated by EPA or the VVWRA, applicable to Users, including promulgated Categorical Standards, National Prohibitive Discharge Standards, General Discharge Prohibitions contained in Section 08-04.2 herein, and Specific Local Discharge Limitations contained in or pursuant to Sections 08-05.1 and 08-05.2 herein.

PRETREATMENT WASTES shall mean all wastes, liquid or solid, removed from nondomestic wastewater by physical, chemical, or biological means.

PROCESS WASTEWATER shall mean nondomestic wastewater, excluding boiler blowdown and non-contact cooling water or cooling tower discharges.

PROHIBITED DISCHARGE STANDARDS OR PROHIBITED DISCHARGES shall mean absolute prohibitions against the discharge of certain substances; these prohibitions appear in Section 08.04 of this ordinance.

PUBLIC AGENCY shall mean the Federal Government, the State, or any City, County, District, JPA, or other public agency or body duly organized under the laws of the State of California or of the USA.

PUBLIC SEWER shall mean any sewer located in or maintained by the VVWRA or a Member Entity which is tributary to the wastewater treatment facilities operated by VVWRA. The term as used here does not include storm drains or channels for conveyance of natural surface waters.

RADIOACTIVE MATERIAL shall mean material containing chemical elements that spontaneously change their atomic structure by emitting any particles, rays, or energy forms.

RECLAMATION AUTHORITY shall mean the Victor Valley Wastewater Reclamation Authority.

REGIONAL BOARD shall mean the California Regional Water Quality Control Board, Lahontan Region.

REGIONAL SERVICE AREA shall mean the service area of the Reclamation Authority, the boundaries of which are determined as described in Article 04.

REGIONAL SEWERAGE SYSTEM shall mean the regional component of the sewerage system which is owned and operated by the Reclamation Authority, including the Authority Interceptor, Authority Sewerage Facility and POTW Treatment Plant, but excluding the Collection Sewers and Tributary Sewerage System.

REGULATORY AGENCIES shall mean those public agencies legally constituted to protect the public health and water quality in the United States, such as EPA, or State of California, such as the California Environmental Protection Agency; the California Department of Public Health; the State Water Resources Control Board; the California Regional Water Quality Control Board, Lahontan Region; and the San Bernardino County Department of Environmental Health Services.

RESTAURANT shall mean any retail establishment which prepares and sells foods and drinks on the premises for consumption on or off the premises.

SALT AND NUTRIENT MANAGEMENT PLAN means the plan adopted in 2015 by the California Regional Water Quality Control Board, Lahontan Region, to manage salts and nutrients in groundwaters in the Mojave River Watershed.

SANITARY SEWAGE shall mean domestic wastewater.

SANITARY SEWER shall mean a sewer which carries wastewater, and to which storm, surface, and ground water are not intentionally admitted.

SEPTAGE shall mean any wastewater or sludge removed from a cesspool, septic tank, holding tank, or chemical toilet, and which is trucked or hauled to the point of discharge.

SERVICE AGREEMENT shall mean the contract documents common to Member Entities, and executed during formation of JPA dated November 1976, as the same may be amended from time to time.

SEWAGE shall mean wastewater.

SEWAGE LIFT STATION shall mean a station positioned in a sewer system at which wastewater is pumped to a higher level.

SEWER shall mean a pipe or conduit that carries wastewater or drainage water.

SEWERAGE SYSTEM shall mean a network of wastewater collection, conveyance, treatment and disposal facilities interconnected by sewers, and owned by the Reclamation Authority or the Member Entities.

SHALL is mandatory.

SHREDDED GARBAGE shall mean garbage that has been shredded to such a degree that all particles will be carried freely under the flow conditions normally prevailing in public sewers, with no particle greater than 1/2" (1.25 centimeters) in any dimension.

SIGNIFICANT INDUSTRIAL USER (SIU) shall mean any Industrial User of the POTW who 1. is subject to Categorical Standards; 2. has an average daily discharge of 25,000 gallons or more of process wastewater (as defined herein); 3. has a process wastestream which makes up 5% or more of the average dry-weather hydraulic or organic capacity of the Wastewater Treatment Facilities receiving the wastewater; or 4. is designated by the Manager to have a reasonable potential for adversely affecting the POTW's operation or violating any applicable pretreatment standard or requirement.

SIGNIFICANT NONCOMPLIANCE (SNC) shall mean violations of pretreatment requirements, which include violations of effluent limits, sampling violations, analysis violations, reporting violations, compliance schedule and regulatory deadline violations, which satisfy one or more of the following criteria:

- a) Violations of wastewater discharge limits:
 1. Chronic Violations. Sixty-six percent or more of all the measurements taken during a six-month period exceed (by any magnitude) a numeric pretreatment standard or requirement, including instantaneous limits as defined by 40 CFR 403.3(l)
 2. Technical Review Criteria (TRC) Violations. Thirty-three percent or more of all the measurements for each pollutant or pollutant property taken during a six-month period equals or exceeds the product of the numeric pretreatment standard or requirement, including instantaneous limits as defined by 40 CFR 403.3(l) multiplied by the applicable criteria (1.4 for BOD, TSS, fats, oils and grease and 1.2 for all other pollutants except pH)
 3. Any other violation(s) of a pretreatment effluent limit (daily maximum, long-term average, instantaneous, or narrative standard) that the VVWRA determines has caused, alone or in combination with other discharges, interference or pass through (including endangering the health of the POTW personnel or the public).
 4. Any discharge of a pollutant that has caused imminent endangerment to human health or welfare or to the environment or has resulted in the Reclamation Authority's exercise of its emergency authority to halt or prevent such a discharge.
- b) Failure to meet, within ninety (90) days of the scheduled date, a compliance schedule milestone contained in Nondomestic Wastewater Discharge Permit, Compliance Time

Schedules or other enforcement order for starting construction, completing construction, or achieving final compliance.

- c) Failure to provide within forty-five (45) days after the due date, any required reports, including baseline monitoring reports, reports on compliance with Categorical Standard deadlines, periodic self-monitoring reports, and reports on compliance with compliance schedules.
- d) Failure to report noncompliance in an accurate and timely fashion.
- e) Any other violation or group of violations, which may include a violation of BMPs, which the Manager determines will adversely affect the operation or implementation of the pretreatment program.

SINGLE PASS, NON-CONTACT COOLING OR HEATING WATER shall mean non-contact cooling or heating water which is used only once and then disposed of.

SLUG DISCHARGE CONTROL PLAN shall mean a plan submitted to the VVWRA by a User pursuant to Section 08-09.4(b) herein, which specifies to the Manager's satisfaction the potential pollutants used and/or stored at the User's facility; potential pathways of entry of said potential pollutants into the POTW; and facilities and procedures for preventing or controlling the occurrence of slug loading.

SLUG LOAD or SLUG DISCHARGE shall mean any discharge at a flow rate or concentration, which could cause a violation of the prohibited discharge standards in Section 08.04 of this ordinance. A slug discharge is any discharge of non-routine, episodic nature, including but not limited to an accidental spill or a non-customary batch discharge, which has a reasonable potential to cause interference or pass through, or in any other way violates the Reclamation Authority's regulations, local limits, or nondomestic wastewater discharge permit.

SOLID WASTE shall mean the non-liquid carried wastes normally considered to be suitable for disposal with refuse at sanitary landfill refuse disposal sites.

SOLID WASTE ADM DISCHARGE PERMIT shall mean the regulatory procedure established and enforced by the Manager pursuant to Section 07-04 herein, to permit the treatment and disposal of solid waste which qualifies as ADM directly into the anaerobic digester at the wastewater treatment plant.

SOLVENT MANAGEMENT PLAN (TOXIC ORGANIC MANAGEMENT PLAN) shall mean a plan submitted to the VVWRA by an Industrial User pursuant to Section 08-09.4(a) herein, which specifies to the Manager's satisfaction the solvents and other toxic organic compounds used; the methods of disposal used; and procedures for assuring that solvents and other toxic organics do not routinely spill or leak into the wastewater.

SPECIFIC COMPLIANCE PLAN shall mean a plan submitted to the VVWRA by an Industrial User pursuant to Section 08-09.4(c) herein, which specifies to the Manager's satisfaction the cause of noncompliance; the corrective actions which will be taken to prevent recurrence of said noncompliance; and, if required by the Manager, a proposed Compliance Time Schedule.

STANDARD INDUSTRIAL CLASSIFICATION (SIC) shall mean a classification pursuant to the Standard Industrial Classification Manual issued by the Executive Office of the President, Office of Management and Budget, 1987; or latest edition thereof.

"STANDARD METHODS" shall mean "Standard Methods for the Examination of Water and Wastewater", latest edition, prepared and published by the American Public Health Association, American Water Works Association, and Water Environment Federation, which specifies accepted procedures used to assess the quality of water and wastewater.

STATE shall mean the State of California.

STATE WATER BOARD shall mean the State of California Water Resources Control Board.

STORMWATER shall mean any flow of water resulting from natural precipitation.

STORMWATER SYSTEM shall mean all stormwater conveyance and treatment facilities located within the VVWRA, including, but not limited to, storm drains, catch basins, storm drain manholes and manways, and stormwater pumping facilities.

SURCHARGE shall mean an assessment, in addition to the service charge, which may be levied on those Users whose wastes are greater in strength than surcharge threshold concentration values established by the Manager.

SUSPENDED SOLIDS OR "SUSPENDED MATTER" (TSS) shall mean the insoluble solid matter suspended in wastewater that is separable by laboratory filtration.

TEMPORARY INDUSTRIAL USER (TIU) shall mean any Industrial User who is granted temporary permission by the Manager to discharge unpolluted water or wastewater to the public sewer and controlled by a wastewater discharge permit. Such temporary permission shall not be granted to Industrial Users subject to promulgated Categorical Standards.

TOTAL DISSOLVED SOLIDS (TDS) shall mean the quantity of non-volatile substances remaining after filtration through a standard filter and drying to constant weight at 180°C, expressed in terms of milligrams per liter (mg/l) and analyzed in accordance with Approved Analytical Methods. TDS is synonymous with Total Filterable Residue (TFR).

TOTAL SOLIDS shall mean the sum of suspended and dissolved solids.

TOTAL TOXIC ORGANICS (TTO) shall mean the sum of the concentrations for each of the toxic organic compounds regulated by applicable Categorical Standards which are found in the User's discharge at a concentration greater than ten (10) micrograms per liter, and analyzed in accordance with Approved Analytical Methods. TTO is comprised of the following constituents:

Acenaphthene	4-Chlorophenyl phenyl ether	Benzo(ghi) perylene
Acrolein	4-Bromophenyl phenyl ether	Fluorene
Acrylonitrile	Bis(2-chloroisopropyl) ether	Phenanthrene
Benzene	Bis(2-chloroethoxy) ether	Dibenzo(a,h) anthracene
Benzidine	Methylene chloride	Indeno(1,2,3-cd) pyrene
Carbon tetrachloride	Methyl chloride	Pyrene
Chlorobenzene	Methyl bromide	Tetrachloroethylene
1,2,4-Trichlorobenzene	Bromoform	Toluene
Hexachlorobenzene	Dichlorobromomethane	Trichloroethylene
1,2-Dichloroethane	Chlorodibromomethane	Vinyl chloride
1,1,1-Trichloroethane	Hexachlorobutadiene	Aldrin
Hexachloroethane	Hexachlorocyclopentadiene	Dieldrin
1,1-Dichloroethane	Isophorone	4,4'-DDT
1,1,2-Trichloroethane	Naphthalene	4,4'-DDE
1,1,2,2-Tetrachloroethane	Nitrobenzene	4,4'-DDD
Chloroethane	2-Nitrophenol	alpha-Endosulfan
Bis(2-chloroethyl) ether	4-Nitrophenol	beta-Endosulfan
2-Chloroethyl vinyl ether	2,4-Dinitrophenol	Endosulfan sulfate
2-Chloronaphthalene	4,6-Dinitro-o-cresol	Endrin
p-Chloro-m-cresol	N-nitrosodimethylamine	Endrin aldehyde
Chloroform	N-nitrosodiphenylamine	Heptachlor
2-Chlorophenol	N-nitrosodi-n-propylamine	Heptachlor epoxide
1,2-Dichlorobenzene	Pentachlorophenol	alpha-BHC
1,3-Dichlorobenzene	Phenol	beta-BHC
1,4-Dichlorobenzene	Bis(2-ethylhexyl) phthalate	gamma-BHC
3,3'-Dichlorobenzidine	Butyl benzyl phthalate	delta-BHC
1,1-Dichloroethylene	Di-n-butyl phthalate	Arochlor 1242
1,2-trans-Dichloroethylene	Di-n-octyl phthalate	Arochlor 1254
2,4-Dichlorophenol	Diethyl phthalate	Arochlor 1221
1,2-Dichloropropane	Dimethyl phthalate	Arochlor 1232
1,3-Dichloropropylene	Benzo(a)anthracene	Arochlor 1248
2,4-Dimethylphenol	Benzo(a)pyrene	Arochlor 1260
2,4-Dinitrotoluene	Benzo(b)fluoranthene	Arochlor 1016
2,6-Dinitrotoluene	Benzo(k)fluoranthene	Toxaphene
1,2-Diphenylhydrazine	Chrysene	Fluoranthene
Ethylbenzene	Acenaphthylene	Anthracene
Chlordane (tech and metabolites)		

TOXIC POLLUTANT shall mean any pollutant or combination of pollutants listed as toxic in 40 CFR Part 401.15 or 40 CFR Part 403, Appendix B.

TRADE SECRETS shall include, but not be limited to, any formula, plan pattern, process, tool, mechanism, compound, procedure, production data, or compilation of information which is not

patented, which is known only to certain individuals within a commercial concern who are using it to fabricate, produce, or compound an article of trade or a service having commercial value, and which gives its User an opportunity to obtain a business advantage over competitors who do not know or use it.

TRIBUTARY SEWERAGE SYSTEM shall mean any sewerage system under the jurisdiction of a Member Entity that is tributary to the Reclamation Authority's sewerage system and is connected thereto.

UNCONTAMINATED WATER shall mean unpolluted water.

UNPOLLUTED WATER shall mean non-contact cooling or heating water; air conditioner, condenser or chiller condensate; ice melt; or uncontaminated ground water, surface water, or stormwater.

USER shall mean any person who contributes, causes, or permits the contribution of wastewater into the POTW, including Households, Private Residences, Nonresidential Users, and Member Entities.

WASTE shall mean sewage and any and all other waste substances, liquid, solids, gaseous, or radioactive, associated with human habitation, or of human or animal origin, or from any producing, manufacturing or processing operation of whatever nature, including such wastes placed within containers of whatever nature, prior to and for the purpose of disposal.

WASTEWATER shall mean the liquid and water-carried domestic or nondomestic wastes from dwellings, commercial buildings, industrial facilities, and institutions, together with any ground water, surface water, and stormwater that may be present, whether treated or untreated, which is contributed into or permitted to enter the POTW.

WASTEWATER CONSTITUENTS AND CHARACTERISTICS shall mean the individual chemical, physical, bacteriological, and radiological parameters, including volume, flow rate, concentration, and such other parameters that serve to define, classify, or measure the quality and quantity of wastewater.

WASTEWATER DISCHARGE PERMIT shall mean a Nondomestic Wastewater Discharge Permit.

WASTEWATER TREATMENT FACILITIES shall mean the structures, equipment, and processes maintained by the VVWRA which accept untreated wastewater from the public sewer and are required to treat and dispose of domestic and nondomestic wastewater.

WASTEWATER TREATMENT PLANT shall mean the POTW Treatment Plant.

WATER CONDITIONING DEVICE shall mean any device or apparatus used to soften or otherwise condition water, including zeolite or resinous anion or cation exchange softeners, demineralizers, and any other like device.

WATERS OF THE STATE OF CALIFORNIA shall be in accordance with sections 13050-13051 of the California Code of Regulations.

WATERS OF THE UNITED STATES shall be in accordance with 40 CFR Part 230.3.

WATER SUPPLY shall mean the water supply serving the area tributary to the POTW.

WASTE DISCHARGE REQUIREMENTS (WDR) shall mean those requirements imposed by the Lahontan Regional Water Quality Control Board in connection with the disposal of solid wastes by the Reclamation Authority pursuant to Title 27 of the California Code of Regulations and Article 4 of Chapter 4 of Division 7 of the California Water Code (also known as the Porter-Cologne Water Quality Control Act).

WILL SERVE LETTER shall mean written authorization from the Reclamation Authority or its representative authorizing contributions of sewerage from an Industrial User into the tributary sewerage system.

ZERO DISCHARGER shall mean a User that does not discharge wastewater, pollutants, or other substances into the POTW.

03-02 - Abbreviations

For the purposes of this Ordinance, the following abbreviations shall have the designated meanings:

Abbreviation	Designated Meaning	Abbreviation	Designated Meaning
AO	Administrative Order	NCSIU	Non-Categorical Significant Industrial User
ADM	Anaerobically Digestible Materials	NOV	Notice of Violation
APE	Alkyl Phenol Ethoxylates	NPDES	National Pollutant Discharge Elimination System
BMR	Baseline Monitoring Report	NSIU	Non-significant Industrial User
BOD	Biochemical Oxygen Demand	NWDP	Nondomestic Wastewater Discharge Permit
CAA	Clean Air Act	POTW	Publicly Owned Treatment Works
CDO	Cease and Desist Order	PPD	Pounds per Day
CFR	Code of Federal Regulations	RCRA	Resource Conservation and Recovery Act
CIL	Categorical Industrial User	SIC	Standard Industrial Classification
CO	Compliance Order	SIU	Significant Industrial User
COD	Chemical Oxygen Demand	SNC	Significant Non-compliance
CTS	Compliance Time Schedule	SWDA	Solid Waste Disposal Act, 42 USC 6901 et seq
DOX	Dissolved Organic Halides	TDS	Total Dissolved Solids
EAP	Ethylated Alkyl Phenols	TFR	Total Filterable Residue
EC	Electrical Conductivity	TIU	Temporary Industrial User
EPA	Environmental Protection Agency	TOC	Total Organic Carbon
FOG	Fats, oils, and grease	TOX	Total Organic Halides
FSE	Food Service Establishment	TRC	Technical Review Criteria
gpd	gallons per day	TSCA	Toxic Substances Control Act
IU	Industrial User	TSS	Total Suspended Solids
JPA	Joint Powers Authority	TTO	Total Toxic Organics
JPAG	Joint Powers Agreement	µg	micrograms
l	liter	µg/l	micrograms per liter
lb	pound	µmhos/cm	micromhos per centimeter
LEL	Lower Explosive Limit	UBC	Uniform Building Code
MBAS	Methylene Blue Activated Substances	UFC	Uniform Fire Code
mg	milligrams	UPC	Uniform Plumbing Code
mg/l	milligrams per liter	USC	United States Code
MOU	Memorandum of Understanding	VVWRA	Victor Valley Wastewater Reclamation Authority
MPRSA	Marine Protection Research and Sanctuaries Act	WDR	Waste Discharge Requirements

ARTICLE 04: AREA SERVED

The Rules and Regulations set forth herein pertain to sewer service to land or improvements, or both, lying within the boundaries of the Reclamation Authority, unless otherwise stated.

Per JPA Agreement, Section A, Paragraph 3, "The territorial boundaries may be changed from time to time upon the approval of two-third (2/3) of the members of this Agency." Section A, Paragraph 5 of the JPA further states in regard to eligibility for membership (other than those specified) that "(h) other such public agencies as may hereafter be declared eligible by unanimous vote of existing members," and Paragraph 6 states, "in connection with the admission of any additional eligible public agency after formation of the Agency, each of the existing members and

The prospective member for contributions toward past and present agency and project expenditures." Policy Resolution 81-10 of the Reclamation Authority further provides:

"Before any territory outside the boundaries of the Reclamation Authority may be added or service may be provided to it, such area must first be annexed to the boundaries of a contracting community and must also be annexed to the boundaries of the VVWRA. Annexation to the VVWRA may only be accomplished through satisfaction of all applicable legal prerequisites and payment of applicable fees and charges".

Therefore, in accordance with the JPA and the policy resolution a public entity or applicant owner of property outside the boundaries of the Reclamation Authority must petition for inclusion of eligibility for membership or apply for service through a JPA member and request the service area to be expanded. Conditions of service must be reviewed first by the Member Entity, or entities involved, and then by the JPA since "annexation to the VVWRA may only be accomplished through satisfaction of all applicable legal prerequisites and payment of applicable fees and charges." Such costs will be reviewed by a consultant selected by the Reclamation Authority and approved at a regular Commission meeting.

Notwithstanding the foregoing, Reclamation Authority may accept and process ADM from sources outside of the boundaries of the Reclamation Authority for the purpose of maximizing the utilization of the Reclamation Authority's anaerobic digesters and the generation of biogas for the production of renewable energy, provided, however, that ADM which is generated within the boundaries of the Reclamation Authority will have priority.

ARTICLE 05: GENERAL REQUIREMENTS

05-01 - Sewer Service Conditions

Sewer service shall be provided by the Reclamation Authority only if the service area is included within or added to the Member Entity's and the Reclamation Authority's boundaries and the applicant meets the requirements of the Reclamation Authority and the interested Member Entity. Properties may from time to time petition the Member Entity and the Reclamation Authority for annexation in compliance with Service Agreements, the JPA, and the Authority's Rules and Regulations. Sewer Conveyance, treatment, and disposal shall be available only in accordance with the Reclamation Authority's and the Member Entity's Rules and Regulations, as well as applicable Federal, State, and local statutes, ordinances, regulations, and contracts, and other requirements. This includes, but is not limited to the California Water Code, the California Code of Regulations, and regulations imposed by the Regional Board, and State and local health departments, as well as the terms of any service agreement and permit issued by the Authority and/or the Member Entity. Any such permit may be revoked by the party granting same and thereupon all such sewer service shall cease in the manner provided in such granting Entity's Rules and Regulations.

05-02- Application Procedure

An Industrial User will have completed the following steps prior to direct or indirect sewerage discharges into the Reclamation Authority's facilities:

- a) Letter of intent to the Member Entity outlining project plans of development followed by;
- b) Written response from the Member Entity.

Pre-Initiation

- c) Application for service.
- d) Receipt of approved Certificate of Adequacy and permit from the Member Entity and a "Will Serve Letter" from the Reclamation Authority.
- e) Five-day notification to the Member Entity prior to commencement of construction.

Construction

- f) Request for final acceptance of completed works.
- g) Receipt of written authorization, from the Member Entity, to connect to facilities that will contribute to the Reclamation Authority's system.
- h) The Member Entity shall be responsible for informing the Reclamation Authority of planned developments that may significantly affect the operational or capacity limits of the Reclamation Authority's facilities. Additionally, the Member Entity must have obtained a "Will Serve Letter" from the Authority prior to issuing a "Certificate of Adequacy" to an Industrial User.

05-03 - Design and Construction Criteria

Design criteria as submitted in the letter of intent and service application shall conform to the following:

- a) The average flow rate is to be determined based on good engineering practice. The ranges shown in Plate I (Average Flow Rate Chart) may be used as a guide; however, flows outside of these ranges may occur. If flows are used which are less than those listed, the Reclamation Authority's approval must be obtained in advance of design.
- b) The peak sewage flow rate shall be obtained by entering the chart with average daily flow rates.
- c) For hydraulic design, use Manning's "n" = 0.013 or Hazen-Williams "C" = 100. For pipe sizes 10" or less in diameter, design pipe so peak flow rate will be carried when pipe is flowing at one-half depth. Discharge at one-half depth equals one-half discharge when full and velocity equals velocity when full. Tables and formulas to find slope may be used by entering with two times the peak flow rate.
- d) For pipes 12 inches and larger in diameter, design pipe so peak flow will be carried when pipe is flowing at two-thirds depth. Discharge at two-thirds depth equals three-quarters discharge when full and velocity equals 1.16 times velocity when full. Tables and formulas to find slope may be used by entering with 1.33 times the peak flow rate.

All applications shall be accompanied by a "Certificate of Adequacy of Sewerage System" (Form of Certificate of Adequacy of Sewerage System).

05-04 - Illegal Connections

Only Member Entities or others under contract with the Reclamation Authority may make connection to interceptor sewers of the Reclamation Authority. Specifically, but not by way of limitation, as to any connection to the Member Entity's sewerage facilities, no roof downspouts, exterior foundation drains, areaway drains, or other sources of surface runoff or ground water shall be connected to a building sewer or building drain that may contribute to the tributary sewerage system.

A Member Entity may engage a third party contractor to make a connection to interceptor sewers of the Reclamation Authority pursuant to the authority granted to the Member Entities or may authorize a developer or other third party to connect to the interceptor sewers of the Reclamation Authority pursuant to a permit or approval issued by the Member Entity, provided, however, that any such connection will comply with all other requirements of this Ordinance. The Authority retains the right at all times to observe and inspect work being conducted by any third party in connection with the interceptor sewers.

ARTICLE 06: FACILITIES DESIGN AND CONSTRUCTION

06-01 - General

All sewers shall be constructed according to the requirements, conditions, and standards set forth in a separate supplement hereto, as adopted and revised by the Reclamation Authority from time to time, entitled "Standard Specifications for Public Works Construction" with extension and revisions, which document is on file at the office of the Reclamation Authority, and by this reference is incorporated herein.

06-02 - Member Entity Sewer

Any sewer collection and trunk system facilities, to the extent determined by the Member Entity, required to serve within developments of property within the Member Entity jurisdiction shall be provided as determined by the Member Entity. The Reclamation Authority will assume responsibility for providing interceptor sewers, regional wastewater treatment, and disposal of liquid and solid wastes.

ARTICLE 07: FACILITIES OPERATION

07-01 - Interceptor Sewer and Sewage Treatment and Disposal

Operation, maintenance, and surveillance of all of the Reclamation Authority's interceptor sewers and sewage treatment and disposal facilities and effluent disposal facilities including all interceptors, reservoirs, pumping stations, force mains, flow meters/monitoring stations and other appurtenances and property shall be under the management and control of the Reclamation Authority. No other persons except authorized representatives of the Reclamation Authority shall have the right to enter upon, inspect, operate, adjust, change, alter, move, or relocate any portion of the foregoing or any of the Reclamation Authority's property. In the event that such trespass should occur, it shall be a misdemeanor and all charges and penalties provided for in this Ordinance shall be applicable and may be imposed and collected. Also such action shall be in violation of any and all applicable Federal, State and local statutes, ordinances, regulations, and other requirements.

07-02 - Member Entity Facilities

The operation, maintenance, and surveillance of onsite sewage collection and the Member Entity's collection system is the responsibility of the Member Entity.

07-03 – Septage Receiving Station

Reclamation Authority may authorize the disposal and treatment of Septage at one or more receiving stations located within the POTW by permitted liquid waste haulers. Reclamation Authority will adopt a set of policies and procedures for the issuance of Liquid Waste Hauler Discharge Permits, including qualifications for Septage hauling and disposal, limitations on the volume and quality of Septage that is discharged to the POTW and billing and collection procedures. The rates for Septage disposal shall be as set by the Commission from time to time in Ordinance 003.

07-04 – Solid Waste ADM Discharge

Reclamation Authority may authorize the disposal and treatment of solid waste which qualifies as ADM and has been approved by the Reclamation Authority directly into the anaerobic digesters at the wastewater treatment facility. Reclamation Authority will adopt a set of policies and procedures for the issuance of Solid Waste ADM Discharge Permits, including qualifications for solid waste ADM hauling and disposal, limitations on the volume and quality of solid waste ADM that is disposed of in the anaerobic digesters and billing and collection procedures. The rates for solid waste ADM disposal shall be as set by the Commission from time to time pursuant to a separate [appendix resolution](#) to be attached to this Ordinance.

Prior to authorizing the disposal of solid waste ADM in the anaerobic digesters, Reclamation Authority will develop standard operating procedures (SOPs) for the acceptance of anaerobically

digestible material consistent with applicable law and the requirements of the California Department of Resources Recycling and Recovery. Such SOPs will be adopted by a separate resolution of the Commission. Reclamation Authority will notify the Regional Water Quality Control Board that those SOPs are being implemented. If required by law, a Standard Provision (permit condition) that reflects the acceptance of anaerobically digestible material will be incorporated in the Reclamation Authority's Waste Discharge Requirements or National Pollutant Discharge Elimination System permit. Anaerobically digestible material must be pumped or off-loaded directly into a covered, leak proof container and then pumped, or diluted or slurried and then pumped, and co-digested in an anaerobic digester at the POTW.

Reclamation Authority will comply with all reporting requirements of the Regional Water Quality Control Board, Lahontan Region, and any other applicable agency, in connection with ADM disposal.

ARTICLE 08: DISCHARGE OF NONDOMESTIC WASTEWATER

08-01 - Introduction

The Reclamation Authority's Wastewater Treatment Facilities are regional facilities designed and constructed to collect and process liquid wastes from Member Entities per approved service agreements and contracts. These facilities, constructed to meet Federal and State discharge requirements, have specific limitations on biological loadings, inert loadings, volumes of flow, and toxic pollutant concentrations that will permit operation of the facilities without serious violation of the discharge requirements. In order to provide for the maximum public benefit from the use of the Reclamation Authority's facilities, this Article defines these limitations and establishes policies and procedures to ensure compliance with same.

Additionally, the Reclamation Authority recently participated in an effort to develop the Mojave Salt and Nutrient Management Plan (SNMP) for the Mojave River Watershed to manage salts and nutrients. The SNMP documents several constituents that may impact groundwaters within the Mojave River Watershed. Any regulatory action(s) arising from the SNMP will be evaluated by the Reclamation Authority and may lead to a revision of this Ordinance.

08-02- Purpose and Policy

This Article sets forth uniform requirements for all Users of the Reclamation Authority's wastewater collection and treatment system who reside in the cities of Apple Valley, Hesperia, and Victorville, and unincorporated areas of San Bernardino County within the service area of the Reclamation Authority. This Ordinance enables the Reclamation Authority to comply with all applicable State and Federal laws required by the Act and the General Pretreatment Regulations (40 CFR Part 403). The objectives of this Article are:

- a) To prevent the introduction of pollutants into the wastewater system which will interfere with the operation of the system or contaminate the resulting sludge;
- b) To prevent the introduction of pollutants into the wastewater system which will pass through the system, inadequately treated, into surface waters, groundwaters, the atmosphere, or otherwise be incompatible with the system;
- c) To improve the opportunity to recycle and reclaim wastewaters and sludges from the system;
- d) To improve the opportunity to recycle solid wastes which qualify as ADM to maximize biogas production and to reduce the disposal of such solid wastes in landfills;
- e) To protect and preserve the health and safety of the personnel of the Reclamation Authority and the general public; and
- f) To enable the Reclamation Authority to comply with its NPDES permit conditions, sludge use and disposal requirements, and any other Federal or State laws to which the Reclamation Authority is subject.

To achieve these objectives, this Ordinance provides for regulation through issuance of permits to certain Industrial Users and enforcement of general requirements for other Users; authorizes inspection, monitoring and enforcement activities; provides for User reporting; and provides for the setting of fees for the equitable distribution of the Reclamation Authority's cost for sewer service.

08-03 - Revenues

The revenues to be derived from the application of this Ordinance shall be used to defray the costs of providing regional sewerage service, including, but not limited to, administration, operation, inspection, monitoring, maintenance, financing, capital construction, replacement and recovery, and provisions for necessary reserves.

08-04 - General Restrictions and Prohibitions

08-04.1 - Authorization for New or Increased Pollutant Discharges or Changes in the Nature of Pollutant Discharges

No person shall commence, increase or substantially change any discharge of nondomestic wastewater to the POTW except as authorized by the Manager in accordance with the provisions of this Ordinance.

08-04.2 - General Discharge Prohibitions

No User shall introduce or cause to be introduced into the POTW any pollutant or wastewater which causes pass through or interference. These general prohibitions apply to all Users of the POTW whether or not they are subject to Categorical Standards or any other National, State, or local Pretreatment Standards.

08-04.3 - Specific Discharge Prohibitions

No User shall introduce or cause to be introduced into the POTW the following pollutants, substances, or wastewater:

1. Solids or Viscous Wastes

Any solid, semi-solid or viscous substances which may obstruct the flow of sewage, cause clogging of or adversely affect sewage pumping equipment, or sewage sludge pumping equipment, or the community sewer system, or interfere with the operation of the POTW, such as, but not limited to, grease, garbage with particles greater than one-half inch in any dimension, dead animals, animal guts or tissues, paunch manure, bones, hair, hides or fleshings, entrails, excessive quantities of whole blood, feathers, ashes, cinders, earth, sand, mud, gravel, rocks, plaster, concrete, spent lime, stone or marble dust, metal, metal filings or shavings, wood, wood shavings, grass clippings, straw, spent grains, spent hops, waste paper, paper containers or other paper products, rags, plastics, tar, asphalt, asphalt residues, residues from refining or processing of fuel or lubricating oil, glass, or glass grinding or polishing wastes. Notwithstanding the foregoing, solid

wastes which (i) qualify as ADM; and (ii) are approved by the Reclamation Authority for processing in the anaerobic digesters, may be transported to the Reclamation Authority for processing in accordance with such permits, policies and procedures as may be adopted by the Reclamation Authority from time to time.

2. Health and Safety Hazards

Any discharge which may, alone or in combination with other waste substances, result in the presence of toxic or poisonous solids, liquids, gases, vapors, or fumes in the POTW in such quantities that would create a hazard, public nuisance, or acute worker health and safety problems.

3. Stormwater and Unpolluted Water

Any stormwater, rainwater, ground water, street drainage, subsurface drainage, roof drainage, yard drainage, water from yard fountains, ponds, lawn sprays or any other type of surface water, or single pass, non-contact cooling or heating water. The Manager may approve, on a temporary basis, the discharge of such waters to the POTW when no reasonable alternative method of disposal is available, subject to the payment of all applicable User charges and fees by the Discharger. Water from swimming pools, wading pools and therapy pools may be admitted to the sewer system during off-peak hours, subject to written authorization by the Manager.

4. Explosive Mixtures

Any liquids, solids or gases which by reason of their nature or quantity are, or may be, sufficient either alone or by interaction with other substances to cause fire, explosion, or in any other way be, injurious to the POTW or to operation of the POTW, including but not limited to, wastestreams with a closed cup flashpoint of less than 140 degrees Fahrenheit or 60 degrees Centigrade, using the test methods specified in 40 CFR 261.21, or which result in conditions where two successive readings on an explosion hazard meter at the point of discharge into the system (or at any point in the system), are more than 5%, or any single reading is over 10%, of the Lower Explosive Limit (LEL) of the meter. Prohibited materials include, but are not limited to, gasoline, kerosene, naphtha, benzene, toluene, xylenes, ethers, alcohols, ketones, aldehydes, peroxides, chlorates, perchlorates, bromates, carbides, hydrides, and sulfides; as discharged in such quantities as to potentially result in any of the hazards noted above. Closed cup flashpoint values may be found in the National Institute of Occupational Safety and Health (NIOSH) *Pocket Guide to Chemical Hazards*.

5. Corrosive Materials

Any wastewater having pH less than 5.0 or greater than 11.0, or wastewater having any other corrosive property capable of causing damage or hazard to structures, equipment and/or personnel of the POTW, provided, however, that the restriction on pH less than 5.0 will not apply to solid wastes which are qualified as ADM for disposal only in the anaerobic digesters to the extent permitted by applicable laws, regulations and regulatory agency interpretations and further provided that Reclamation Authority has made a determination that such low pH will not have a corrosive effect on the structures and equipment of Reclamation Authority.

6. Excessive Pollutants Concentrations
Any pollutants, including oxygen-demanding pollutants (BOD, etc.), released in a discharge at a flow rate and/or pollutant concentration which, either singly or by interaction with other pollutants, will cause interference with the POTW.
7. Pollutants Causing Toxic Gases, Vapors, or Fumes
Pollutants which result in the presence of toxic gases, vapors, or fumes within the POTW in a quantity that may cause acute worker health and safety problems.
8. Hazardous Wastes
Any wastewater containing hazardous substances or toxic pollutants in sufficient quantity, either singly or by interaction with other pollutants, to injure or interfere with any wastewater treatment process, including sludge disposal, constitute a hazard to humans or animals, create a toxic or hazardous effect in the receiving waters of the POTW. Any toxic waste as defined in Title 22, California Code of Regulations, Section 66261.24.
9. Noxious Materials
Any noxious or malodorous liquids, gases, or solids which either singly or by interaction with other wastes are sufficient to create a public nuisance or hazard to life or are sufficient to prevent access to the POTW for maintenance and repair.
10. Sludge Contaminants
Any substance which may cause the POTW's effluent, or any other product of the POTW such as residues, sludges, or scums, to be unsuitable for reclamation and reuse. In no case shall a substance discharged to the POTW cause the POTW to violate applicable sludge use or disposal regulations developed under Section 405 of the Act (33 USC 1345) or any criteria, guidelines, or regulations affecting sludge use or disposal developed pursuant to the Solid Waste Disposal Act (SWDA), the Clean Air Act (CAA), Toxic Substances Control Act (TSCA), the Resource Conservation and Recovery Act (RCRA), the Marine Protection, Research and Sanctuaries Act (MPRSA), or State Regulations.
11. Discolored Materials in Excessive Quantities
Any wastewater with objectionable color not removed in the treatment process such as, but not limited to, dye wastes and vegetable tanning solutions.
12. Septage
Any wastewater or sludge removed from a cesspool, septic tank, or chemical toilet, unless discharged to the POTW in accordance with all provisions and restrictions of a Wastewater Discharge Permit issued by the Reclamation Authority, including restrictions on time and place of discharge.
13. Trucked/Hauled Wastes
Any trucked or hauled pollutants or wastewater, except at such place and in such manner as prescribed by the Manager.
14. Pesticides or Fertilizers in Excessive Quantities

Any quantity of any of the following pesticides: DDT (both isomers), DDD, DDE, Aldrin, Chlordane, Dieldrin, Endosulfan (alpha, beta, and sulfate), Endrin, Endrin Aldehyde, Heptachlor, Heptachlor Epoxide, Lindane, and/or Toxaphene.

15. Petroleum Products in Excessive Quantities

Any non-biodegradable cutting oil, petroleum oil, refined petroleum products, or products of mineral oil origin in amounts which could cause interference or pass-through.

16. Soluble Oils

Any non-biodegradable cuttings oils, commonly called soluble oils, which form persistent water emulsions.

17. Animal/Vegetable Oils in Excessive Quantities

Any excessive quantities of dispersed biodegradable oils or fats such as lard, tallow, or vegetable oil or any other substances that may precipitate, solidify, or become viscous at temperatures between 40°F and 100°F. Notwithstanding the foregoing, solid wastes which (i) qualify as ADM; and (ii) are approved by the Reclamation Authority for processing in the anaerobic digesters, may be transported to the Reclamation Authority for processing in accordance with such permits, policies and procedures as may be adopted by the Reclamation Authority from time to time.

18. High Temperature Wastes

Any wastewater having a temperature which will inhibit biological activity at wastewater treatment facilities resulting in interference, but in no case wastewater with a temperature higher than 60°C (140°F) or which causes the temperature at the POTW treatment plant to exceed 40°C (104°F).

19. Radioactive Wastes

Any wastewater containing any radioactive wastes or isotopes of such half-life or concentration as may cause violation of applicable State or Federal regulations.

20. Pretreatment Wastes

Any pretreatment wastes. All pretreatment wastes shall be disposed of in accordance with all applicable Federal, State, County, and local laws and regulations.

21. Water Softener Brines

Discharges from the regenerative process of onsite water softening units is not permitted to be discharged into the sanitary sewer system.

22. Dissolved Organic Halides (DOX)

Any quantity of Dissolved Organic Halides (Purgeable Halocarbons).

23. PCBs and Dioxins

Any quantity of any of the following compounds: Arochlors 1221, 1228, 1232, 1242, 1254, 1260, and 1262. Any quantity of TCDD equivalents.

24. Ethoxylated Alkyl Phenol Surfactants

Any quantity of surfactants or detergents based on Ethoxylated Alkyl Phenols (Alkyl Phenol Ethoxylates, APE, EAP).

25. Excessive Discharge Flow

Wastewaters at a flow rate or containing such concentrations or quantities of pollutants that exceed for any time period longer than fifteen (15) minutes more than five (5) times the average twenty-four (24) hour concentration; quantities or flow during normal operation and that would cause a treatment process upset and subsequent loss of treatment efficiency. An excessive discharge from a Member Entity is defined as total collection system peak discharge into Authority Interceptors that exceeds the plant design ratio between average dry weather flow and peak wet weather flow.

Pollutants, substances, or wastewater prohibited by this section shall not be processed or stored in such a manner that they could be discharged to the POTW.

08-04.4 - Prohibition against Discharging Solid or Fluid Material to Watercourses

No person shall circumvent or obviate the intent or purpose of this Ordinance by discharge, or by causing to be discharged, into any storm drain, channel, natural water course or public street, any material or waste prohibited or restricted as to its discharge into a sewer system.

08-04.5 - Prohibition against Discharging Pollutants to the Ground

No person shall deposit or discharge, or cause to be deposited or discharged, into any sump which is not impermeable, or into any pit or well, or onto the ground, or into any storm drain or watercourse, any material which, by seeping underground or by being leached or by reacting with the soil, can pollute usable groundwaters, or any pretreatment wastes as defined herein.

08-04.6 - Point of Discharge Limitation

No person, excluding authorized Reclamation Authority or Member Entity personnel involved in maintenance functions of sanitary sewer facilities, shall discharge or cause to be discharged any wastewater or any other matter directly into a manhole or other opening leading to the POTW other than through an approved building sewer, unless written permission for the discharge has been provided by the Manager. If during the performance of maintenance duties, Reclamation Authority personnel are required to add water to the interceptor for any reason, said water flow shall be deducted from the Member Entity flow. Any discharge of Septage or ADM shall only take place at receiving stations that have been authorized by the Reclamation Authority pursuant to permitting requirements, policies and procedures adopted by Reclamation Authority from time to time.

08-04.7 - Prohibition against Dilution

No person shall increase the use of process water or, in any way, attempt to dilute a discharge as a partial or complete substitute for adequate treatment to achieve compliance with Categorical Standards. The Manager may impose mass emission limits on Users who are using dilution to meet applicable Pretreatment Standards.

08-04.8 - Prohibition against Interference with Reclamation Authority Equipment or Facilities

No person shall enter, break, damage, destroy, uncover, deface, or tamper with any temporary or permanent structure, equipment or appurtenance which is part of the POTW or is required or authorized by the provisions of this Ordinance.

08-05 - Specific Pollutant Limitations

08-05.1 - Specific Local Discharge Limitations

The Manager is authorized to establish Specific Local Discharge Limitations pursuant to 40 CFR Part 403.5(c). No person shall, except as specifically allowed by the Manager on a temporary basis or as hereinafter provided, discharge or cause to be discharged to the POTW any wastewater unless it conforms to all applicable Specific Local Discharge Limitations as listed in Table I. These pollutant limits are established to protect against pass through and interference. The Specific Local Discharge Limitations apply at the point where the wastewater is discharged to the POTW.

08-05.2 - Specific Local Pollutant Mass Emission Rate Limits

The Manager may authorize the discharge of nondomestic wastewater to the POTW which contains pollutants in concentrations exceeding the Specific Local Pollutant Concentration Limits contained herein when said concentrations, in combination with the measured discharge flow rate, do not exceed Specific Local Mass Emission Rate Limits which are computed for the individual discharger on the basis of said Specific Local Pollutant Concentration Limits and the discharger's permitted discharge flow rate limit, and which are issued to the discharger as part of the discharger's Wastewater Discharge Permit.

08-05.3- Categorical Standards

Users must comply with promulgated National Categorical Pretreatment Standards, located in 40 CFR Chapter I, Subchapter N, Parts 405-471, which are hereby incorporated into this Ordinance.

08-05.4- Best Management Practices

The Manager may develop Best Management Practices, by ordinance or in nondomestic wastewater discharge permits to implement Specific Local Discharge Limitations or the General and Specific Discharge Prohibitions in Section 08-04.2.

08-06 - Special Restrictions and Requirements

08-06.1 - Special Restrictions, Vehicle Servicing Facilities

- a) Any facility maintained for the servicing, washing, cleaning, or repair of vehicles, roadway machinery, construction equipment, industrial transportation or power equipment, and which discharges nondomestic wastewater to the POTW, shall install and maintain a gravity separation interceptor in accordance with Section 08-08.5, or other sand and oil

separator approved by the Manager. Wastewater from toilets shall not be allowed to pass through this interceptor, but all wastewater arising from the servicing and repair of vehicles shall pass through this interceptor before discharge to the POTW.

If the vehicle servicing facility does not include facilities for the washing of more than one vehicle at a time, the interceptor shall have a fluid detention capacity of not less than 100 gallons.

If the vehicle servicing facility has facilities for washing or cleaning more than one vehicle at a time, the interceptor shall be as large as necessary so that a seven day accumulation of sand and oil together will not fill more than twenty-five percent of the fluid capacity. The interceptor shall be designed so as to retain any petroleum based oil and grease which will float and any sand which will settle.

- b) Any interceptor legally and properly installed at a vehicle servicing facility before January 1, 1995, shall be acceptable as an alternative to the interceptor specified above, provided such interceptor is effective in removing sand and oil and is so designed and installed that it can be inspected and properly maintained.
- c) The Plumbing Official shall not approve the plumbing of a vehicle servicing facility if it does not have a gravity separation interceptor meeting the requirements of this Section.

08-06.2 - Special Restrictions, Food Processing Facilities

- a) All food processing facilities, except restaurants, which discharge food processing wastes to the POTW, shall direct all wastewater from floor drains and sinks in the food processing area, waste container wash racks, and dishwashers through a two-compartment gravity separation interceptor in accordance with Section 08-08.5. All domestic wastewaters from restrooms, showers, mop sinks, and drinking fountains shall be kept separate until the previously specified wastes have passed through the interceptor. The interceptor shall have a minimum fluid capacity of 100 gallons, or as required by Appendix "H" of the Uniform Plumbing Code (latest), whichever is greater.
- b) Any interceptor or grease trap legally and properly installed at a food processing facility before January 1, 1995, shall be acceptable as an alternative to the interceptor specified above, provided such interceptor or grease trap is effective in removing grease and is so designed and installed that it can be inspected and properly maintained.
- c) The Plumbing Official shall not approve the plumbing of a food processing facility if it does not have a gravity separation interceptor meeting the requirements of this Section, unless a conditional waiver has been granted by the Manager. Restaurants are exempted from this provision, see provision (e) below.
- d) Conditional waivers modifying or waiving the gravity separation interceptor requirements may be granted by the Manager in accordance with Section 09-06, for those food processing facilities determined not to have adverse effects on the POTW. Conditional waivers may be revoked for the following reasons:
 - 1. Changes in types of food processed.
 - 2. Falsification of information submitted to the Reclamation Authority.
 - 3. Changes in operating hours.

4. Changes in equipment used.
- e) Member Entities shall prevent the discharge of excessive quantities of grease and oil to their tributary sewerage systems by requiring all restaurants to properly install and maintain appropriately designed and effective grease traps.

08-06.3 - Special Restrictions, Anaerobically Digestible Material (ADM)

The Reclamation Authority may permit users to dispose of anaerobically digestible material at the wastewater treatment plant directly into the anaerobic digester in accordance with the permits, policies and procedures adopted by Reclamation Authority from time to time pursuant to Section 07-04. These Users will be permitted under a Solids Waste ADM Discharge Permit and subject to the applicable permit requirements.

08-06.4 - Special Restrictions, Food Service Establishment (FSE)

FSEs that propose to discharge nondomestic wastewater to the POTW shall complete and submit the appropriate FOG permit application and fee to the Member Entity where proposed FSE is located. The Member Entity responsibility will be to issue the appropriate FOG permit and enforce all its conditions.

08-06.5 - Special Restrictions, Sludge from Member Entities

The Reclamation Authority receives wet sludge at the wastewater treatment plant from Member Entities that operate wastewater treatment facilities. Member Entities must periodically conduct sampling of the wet sludge that is conveyed to the wastewater treatment plant as directed by the Manager. The Manager may implement controls to regulate wet sludge quantity and quality as necessary to prevent interference or pass through at the wastewater treatment plant. If necessary, the Manager may require a Member Entity to obtain a Nondomestic Wastewater Discharge Permit to discharge wet sludge to the wastewater treatment plant.

08-07 - Nondomestic Wastewater Discharge Permits

08-07.1 - Permit Requirement

All Significant Industrial Users and haulers of wastewater proposing to connect to or discharge to the POTW and all other Industrial Users so required by the General Manager, shall obtain a Nondomestic Wastewater Discharge Permit before connecting to or discharging to the POTW, or at any other time as required by the Manager. All Significant Industrial Users connected to or discharging into a collection sewer on the effective date such system is connected to the regional system shall apply for a Nondomestic Wastewater Discharge Permit within ninety (90) days of such date. The Industrial User shall maintain a copy of the current Permit readily accessible on the site of wastewater discharge at all times.

Any violation of the terms and conditions of a Nondomestic Wastewater Discharge Permit shall be deemed a violation of this ordinance and subjects the User to the sanctions set out in ARTICLE 13: ENFORCEMENT of this ordinance. Obtaining a Nondomestic Wastewater Discharge Permit

does not relieve the User of its obligation to comply with all Federal and State Pretreatment Standards or with any other requirements of Federal, State, or local law.

08-07.2 - Permit Classification

Nondomestic wastewater discharge permits shall be classified as follows:

Permit Class	Industrial User Description
I	Categorical Industrial Users (CIU's)
II	Non-Categorical Significant Industrial Users (NCSIU's)
III	Non-Significant Industrial Users (NSIU's)
IV	Temporary Industrial Users (TIU's)
V	Dischargers of Trucked or Hauled Wastewater to the POTW

08-07.3- Permit Application

All Industrial Users proposing to discharge nondomestic wastewater to the POTW shall complete and submit a Wastewater Discharge Permit Application to the Manager. Any existing User shall apply for a wastewater discharge permit within thirty (30) days after notification by the Manager. Application for reissuance of existing permits shall be submitted by the Industrial User in accordance with Section 08-07.8. The Permit application may require submittal of the following information:

- a) Identifying information:
 1. Name and address of the facility, including the name of the operator and owner;
 2. Contact information, description of activities, facilities, and plant production processes on the premises;
- b) A list of any environmental control permits held by or for the User's facility, and a copy of the San Bernardino County "Business Plan" which addresses the location, type, and quantity of hazardous materials handled by the User;
- c) Description of operations:
 1. NAISC number and SIC number according to 2012 U.S. NAISC Manual and the Standard Industrial Classification Manual, respectively, as amended;
 2. A brief description of the nature, average rate of production (including each product produced by type, amount, processes, and rate of production);
 3. An 8-1/2" X 11" process flow schematic diagram that includes identification of the point(s) of discharge to the POTW;
 4. Types of wastes generated, and a list of all raw materials and chemicals used or stored at the facility which are, or could accidentally or intentionally be discharged to the POTW;

5. Number and type of employees and hours of plant operation, and proposed or actual hours of operation;
 6. Type and amount of rate materials processed (average and maximum per day)
 7. Site plans, floor plans, mechanical and plumbing plans, including details showing all sewers, sewer connections, treatment facilities and appurtenances by the size, location and elevation. If required by the Manager, said plans shall be certified by a Civil Engineer registered in the State of California;
- d) Time and duration of discharge(s);
 - e) The location for monitoring all wastes covered by the permit;
 - f) Flow measurement. Information showing the measured average daily, peak daily, and 15-minute peak wastewater flow rates (in gallons per day), including daily, monthly and seasonal variations if any, to the POTW from regulated process streams and other streams as necessary;
 - g) Measurement of pollutants
 1. The Categorical Standards applicable to each regulated process and any new categorically regulated processes for existing sources;
 2. The results of sampling and analysis identifying the nature and concentration, and/or mass, where required by the Categorical Standard or by the Manager, of regulated pollutants in the discharge from each regulated process;
 3. Instantaneous, daily maximum, and long-term average concentrations, or mass, where required, shall be reported;
 4. Wastewater constituents and characteristics, as determined by a State certified analytical laboratory using Analytical Methods as defined herein and sampling procedures in accordance with 40 CFR 136 and 40 CFR 403.12(b)(5), including but not limited to, those referred to in Section 08-05 of this Ordinance;
 - h) A time schedule for compliance with any provisions of the Ordinance or Categorical Standard for which immediate compliance is not possible;
 - i) Any other information as may be deemed by the Manager to be necessary to evaluate the permit application.

08-07.4- Permit Application Evaluation

- a) The Manager will evaluate the data furnished by the User and may require additional information, such as critical parameter reporting. After evaluation of the data furnished, the Manager may issue a wastewater discharge permit subject to the terms and conditions provided herein.
- b) If the Manager determines that the proposed discharge will not be acceptable he shall disapprove the application and shall notify the applicant in writing, specifying the reason(s) for denial and the applicable appeals process. The applicant shall then be prohibited from discharging nondomestic wastewater, but may immediately submit a revised permit application for the evaluation of the Manager.

08-07.5 - Permit Contents

Nondomestic wastewater discharge permits shall be expressly subject to all provisions of this Ordinance and all other applicable regulations (including Federal, State, and local) charges and fees established by Reclamation Authority resolution or ordinance.

Class I and Class II permits shall contain at least the following:

- a) Statement of permit issuance and effective date and permit duration.
- b) Statement of permit non-transferability.
- c) Statement of prohibited discharges.
- d) Statement of applicable civil and criminal penalties for violation of Pretreatment Standards and requirements and any applicable compliance schedule.
- e) Limitations on the average and/or maximum wastewater constituents and characteristics in the discharge.
- f) BMP requirements based on applicable Pretreatment Standards.
- g) Requirements to control slug discharge, if determined by the Manager to be necessary.
- h) Specifications for monitoring programs, which may include: pollutants to be monitored (or BMPs); sampling location(s); frequency of sampling; sample type(s); number, types, and standards for tests; and reporting schedule; and may include total toxic organic (TTO) monitoring.
- i) Compliance Time Schedule(s) where required.

All classes of permits shall contain at least items (a)-(d), above; and may contain items (e)-(i) above, if applicable.

Permits may also contain the following:

- a) The unit charge or schedule of user charges and fees for the wastewater discharged to the POTW.
- b) Schedule of penalty fees for noncompliance.
- c) Limitations on average and/or maximum flow rates.
- d) Requirements for proper installation, operation, and maintenance of pretreatment technology, pollution control, or construction of appropriate containment devices designed to reduce, eliminate, or prevent the introduction of pollutants to the POTW.
- e) Requirements for installation and maintenance of inspection and sampling facilities, including flow measuring devices.
- f) Requirements for installation and maintenance of spill containment systems.
- g) Requirements for submission of technical or discharge reports.
- h) Requirements for maintaining and retaining plant records relating to the wastewater discharge as specified by the Manager.
- i) Requirements for submittal of a solvent management plan.
- j) A statement that compliance with the nondomestic wastewater discharge permit does not relieve the User of responsibility for compliance with all applicable Federal and State

Pretreatment Standards, including those which become effective during the term of the permit.

- k) Other conditions as deemed appropriate by the Manager to ensure compliance with this Ordinance and Federal and State laws, rules, and regulations.

08-07.6- Permit Modifications

The terms and conditions of the permit may be subject to modification by the Manager during the term of a permit if limitations or requirements, as referenced in Section 08-07.6 are modified or other just cause exists. The User shall be informed of any proposed changes in his permit at least fifteen (15) days prior to the effective date of change. Any changes or new conditions in a permit shall include a reasonable time schedule for compliance. The Manager may modify the permit, including, but not limited to the following reasons:

- a) Promulgation of Categorical Standards. Within three months of the promulgation of a Categorical Standard, permits for Users subject to such Standards shall be revised to require compliance within the time frame prescribed by such Standard. Where an affected User has not previously submitted an application for a permit as required by Section 08-07.3, the User shall apply within 180 days after the promulgation of the applicable Categorical Standard. In addition, Users with existing permits shall submit to the Manager within 180 days after the promulgation of an applicable Categorical Standard, a time schedule for compliance with the Categorical Standard.
- b) Changes in Operation. Industrial Users shall receive written approval from the Manager prior to initiating any changes in the User's facility's operation which may result in a change in quantity or quality of nondomestic wastewater contributed to the POTW. For the purposes of this Section "changes" shall include the following: A positive or negative change of 25% in the quantity of wastes discharged, additional waste-generating processes, additional or different waste-generating equipment, and an increase in production capacity.
- c) A change in the POTW that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- d) Information indicating that the permitted discharge poses a threat to the POTW, Reclamation Authority personnel, the general public, or receiving water.
- e) Violation of any terms or conditions of the permit.
- f) Misrepresentation or failure to fully disclose all relevant facts in the permit application or in any required reporting.
- g) To correct any typographical or other errors in the permit.

08-07.7 - Permit Transfer

Nondomestic Wastewater Discharge Permits are issued to specific Users for specific operations. A Nondomestic Wastewater Discharge Permit shall not be transferable, either from one location to another, or from one person to another. Statutory mergers or name change shall not constitute a transfer or a change in ownership. Following a change in ownership, and upon application for a new Nondomestic Wastewater Discharge Permit, an interim permit may be issued by the Manager.

08-07.8 - Permit Duration

Nondomestic Wastewater Discharge Permits shall be issued for a time period specified by the Manager, not to exceed three (3) years. The User shall apply for permit reissuance a minimum of ninety (90) days prior to the expiration of the User's existing permit. If the User submits a completed wastewater discharge permit application and through no fault of the User, a new wastewater discharge permit is not issued prior to the expiration of the existing wastewater discharge permit, the existing wastewater discharge permit shall remain in effect until the Reclamation Authority reissues, or denies, as the case may be, a new wastewater discharge permit. In no case shall a wastewater discharge permit have a duration of more than five (5) years. The terms and conditions of each permit may be subject to modification by the Reclamation Authority during the term of the permit in accordance with Section 08-07.6.

08-08 - Pretreatment Facility Requirements

08-08.1- Pretreatment of Nondomestic Wastewaters

- a) All Users shall provide necessary wastewater treatment as required to comply with this Ordinance and shall achieve compliance with all applicable, promulgated Categorical Standards (Subpart of 40 CFR Chapter I, Subchapter N, as it exists and as it may be amended) within the time limitations specified therein. If unable to immediately meet applicable Pretreatment Standards and Requirements, Users shall develop a compliance schedule for the installation of technology required to meet such requirements. Any facilities required to pretreat wastewater to a level acceptable to the Manager, including gravity separation interceptors, shall be provided, operated, and maintained at the User's expense.
- b) Detailed plans showing the pretreatment facilities and operating procedures shall be submitted to the Manager for review, and shall be acceptable to the Manager BEFORE construction of the facility. The Manager's review of such plans and operating procedures will not relieve the User from the responsibility of modifying the facility as necessary to produce an effluent which complies with all provisions of this Ordinance.

08-08.2 - Monitoring Facilities

The Reclamation Authority may require, at the User's expense, installation and operation of monitoring facilities to allow inspection of discharges to the POTW and collection of wastewater samples. The monitoring facilities shall include a suitably designed control structure and such other sampling, monitoring, and flow metering equipment as are deemed necessary by the Manager. The control structure shall be water tight, structurally sound, and durable. The monitoring facilities, including sampling, monitoring, and flow measuring equipment, shall be maintained and calibrated at all times in a safe and proper operating condition at the expense of the User.

Monitoring facilities shall normally be situated on the User's premises, but the Reclamation Authority and Member Entity may, when such a location would be impractical or cause undue hardship on the User, allow the facilities to be constructed in public right-of-way.

If the control structure is inside the User's fence, there shall be accommodations to allow access for Reclamation Authority or Member Entity personnel, such as a gate secured with a lock, with key provided to the Member Entity and the Reclamation Authority.

There shall be ample room and a 120 V power outlet in or near monitoring facility to allow installation of portable sampling and monitoring equipment by the Member Entity or the Reclamation Authority.

Whether constructed on public or private property, the sampling and monitoring facilities shall be constructed in accordance with the Reclamation Authority's requirements and all applicable local construction standards and specifications. Construction Drawings for proposed monitoring facilities shall be approved by the Manager and the Member Entity prior to construction. Construction shall be completed within 90 days following written approval by the Manager and Member Entity, unless the Manager grants a time extension.

08-08.3 - Flow Measuring Equipment

The Manager may require any User to install and operate a continuous monitoring flow meter capable of measuring the User's discharge to the Reclamation Authority's sewerage system as part of its Monitoring Facilities. The flow measurement device shall conform to standards established by the Manager.

08-08.4 - Separation of Domestic and Nondomestic Wastewaters

Every person who discharges nondomestic wastewater to the POTW shall keep the domestic wastewaters separate from all nondomestic wastewaters until the nondomestic wastewaters have passed through any required pretreatment facilities and the control structure.

08-08.5- Gravity Separation Interceptor

Each User so required by the Manager or Member Entity shall install and maintain a gravity separation interceptor to provide wastewater treatment for floatable and settleable pollutants. Domestic wastewater shall not be allowed to pass through this interceptor. This interceptor shall have an operational fluid capacity of not less than 100 gallons and shall be designed so as to retain any material which will float and any material which will settle. The interceptor shall be watertight, structurally sound, and durable. Interceptors shall have no less than two compartments. Interceptors of 750 gallons capacity or larger, except those designed for food processing facilities, shall have no less than three compartments.

a) Interceptor Requirements:

1. All interceptor chambers shall be immediately accessible at all times for the purpose of inspection and cleaning. At no time shall any material, debris,

obstacles or obstructions be placed in such a manner so as to prevent immediate access to the interceptor.

2. All interceptors of 300 gallons capacity or larger shall be equipped with a sampling chamber located at the downstream end of the interceptor. The sampling chamber shall have a minimum 18 inch square clear opening for the temporary installation of portable automatic sampling equipment.
3. Any interceptor legally and properly installed before January 1, 1995 shall be acceptable as an alternative to the interceptor specified herein, provided such interceptor is effective in removing floatable and settleable material and is so designed and installed that it can be inspected and properly maintained.
4. If the Manager or Member Entity finds that an interceptor is incapable of adequately retaining the floatable and settleable material in the wastewater flow or is structurally incomplete, he shall declare that such interceptor does not meet the requirements of this Section and shall require the User to install, at the User's expense, an acceptable interceptor.

b) Interceptor Approval:

If a gravity separation interceptor is required, the Plumbing Official shall only approve plumbing plans which include an interceptor which meets the requirements of this Section

c) Interceptor Maintenance:

The User who owns, operates, or maintains a gravity separation interceptor shall maintain it properly. It shall be cleaned as often as is necessary to ensure that sediment and floating materials do not accumulate to impair the efficiency of the interceptor. The use of chemicals to dissolve grease is specifically prohibited. When an interceptor is cleaned, the accumulated sediment and floating material shall be removed and legally disposed of otherwise than to the sewer. An interceptor is not considered to be properly maintained if for any reason it is not in good working condition or if the operational fluid capacity has been reduced by more than 25% by the accumulation of floating and settled solids, oils and grease. The owner of any facility required to install an interceptor, the lessee and sub-lessee, if there be such, and any proprietor, operator or superintendent of such facility are individually and severally liable for any failure of proper maintenance of such interceptor. If the interceptor is not properly maintained under the conditions of use, the Manager or Member Entity may require that the interceptor be resized and replaced.

08-08.6 - Spill Containment Systems

Users so required by the Manager or Member Entity shall install spill containment system(s) which conform to requirements established by the Manager and Member Entity. Users shall not operate a spill containment system that allows incompatible liquids to mix thereby creating hazardous or toxic substances in the event of failure of one or more containers. Spill containment systems shall consist of a system of dikes, walls, barriers, berms, secondary vessels, or other devices designed to contain spillage of the liquid contents of containers. Spill containment systems shall be constructed of impermeable and non-reactive materials with respect to the liquids being contained.

Spill containment systems shall conform to all State and County regulations and policies as to percent containment, container type, and size.

08-09 - Record Keeping and Reporting Requirements

08-09.1 - User Record Keeping

All Users shall keep records of waste hauling, reclamations, monitoring, pH and flow measuring device calibrations reports, sample analysis data, flow and pH meter chart recordings, records of pretreatment equipment maintenance, interceptor and clarifier maintenance and cleaning, and correspondence with the Reclamation Authority on the site of wastewater discharge. Sample analysis records shall include the date, exact place, method, and time of sampling, and the name of the person(s) collecting the samples; the dates analyses were performed; who performed the analyses; the analytical techniques or methods used; the results of such analyses; and chain-of-custody forms. All these records are subject to inspection and shall be copied as needed. All records must be kept on the site of generation for a minimum period of three years. The records retention period may be extended beyond three years at the request of the Manager in the event criminal or civil action is taken or an extensive company history is required.

08-09.2 - Reporting Requirements

All Users are required to submit the following types of reports:

- a) **Reports of Potential Problems:** If, for any reason, pollutants are discharged at a flow rate or concentration which might cause interference with the POTW or Pass-Through, including any slug loadings, or which might result in a violation of NPDES Permit requirements or requirements of this Ordinance, or a hazard to Reclamation Authority and/or Member Entity personnel and/or the Public, the User shall verbally notify the Manager and POTW staff immediately. The notification shall include the location of the discharge, type of waste, concentration and volume, if known, and corrective actions taken by the User. The verbal notification shall be followed by a written report submitted to the Manager within five days. The User shall also repeat the sampling and analysis and submit the results of the repeat analysis to the Reclamation Authority within 30 days after becoming aware of the violation.
- b) **Notification of Changed Discharge:** All Users shall promptly notify the POTW in advance of any substantial change in the volume or character of pollutants in their discharge. The Manager may require the User submit information as may be deemed necessary to evaluate the changed condition(s), including submission of a Nondomestic Wastewater Discharge Permit Application.
- c) **Notification of Hazardous Waste Discharge:** Discharge of hazardous wastes is prohibited by Section 08-04. However, should any discharge of hazardous waste occur, the User shall observe the following notification procedures:

- a. All Users shall notify the Reclamation Authority, the EPA Regional Waste Management Division Manager, and State hazardous waste authorities in writing of any discharge into the POTW of a substance, which, if otherwise disposed of, would be classified as hazardous waste pursuant to 40 CFR Part 261.
- b. Such notification must include the name of the hazardous waste as set forth in 40 CFR Part 261, the EPA hazardous waste number, and the type of discharge (continuous, batch, or other).
- c. The above required notifications must take place no later than 180 days after the discharge of the hazardous waste.

In the case of any notification made under these requirements, the Industrial User shall certify that it has a program in place to eliminate all hazardous waste discharges. A notice shall be permanently posted on the User's bulletin board or other prominent place advising employees who to call in the event of a discharge described in (a)-(c) above. Employers shall ensure that all employees, who could cause such a discharge to occur, are advised of the emergency notification procedures.

Industrial Users may be required to submit the following types of reports:

- d) **Self-Monitoring Reports:** Permittees may be required to submit periodic self-monitoring reports containing a description of the nature, concentration, and flow of pollutants required to be reported by the Reclamation Authority, and the time, date, and place of sampling and methods of analysis. Sampling for self-monitoring reports shall be performed during the period covered by the report. All required analyses shall be performed by a State Certified Laboratory using Analytical Methods as defined herein. Significant Industrial Users shall be required to submit self-monitoring reports at least once every six months. If any User subject to this section, monitors any regulated pollutant at the designated sampling location more frequently than required by the Reclamation Authority using Approved Analytical Methods, the results of this monitoring shall be included in the report.
- e) **Sampling Specifications:** All self-monitoring reports required under Section 08-09.2 (d) and reports required under Section 08-09.4 must be based upon data obtained through appropriate sampling and analysis, which data are representative of conditions occurring during the reporting period. Grab samples must be used for pH, cyanide, total phenols, petroleum based oil and grease, FOG, Food Waste, sulfide, and volatile organic compounds. For all other pollutants, 24-hour composite samples must be obtained through flow-proportional composite sampling techniques, unless time-proportional composite sampling or grab sampling is authorized by the Reclamation Authority. Where time-proportional composite sampling or grab sampling is authorized by the Reclamation Authority, the samples must be representative of the discharge and the decision to allow the alternative sampling shall be documented in the Industrial User file for that facility or facilities. Using protocols (including appropriate preservation) specified in 40 CFR Part

136 and appropriate EPA guidance, multiple grab samples collected during a 24-hour period may be composited prior to the analysis as follows: For cyanide, total phenols, and sulfides the samples may be composited in the laboratory or in the field; for volatile organics and oil & grease the samples may be composited in the laboratory. Composite samples for other parameters unaffected by the compositing procedures as documented in approved EPA methodologies may be authorized by the Reclamation Authority, as appropriate. For sampling required in support of baseline monitoring and 90-day compliance reports required in Sections 08-09.2 and 08-09.3, a minimum of four (4) grab samples must be used for pH, cyanide, total phenols, petroleum based oil and grease, FOG, Food Waste, sulfide and volatile organic compounds for facilities for which historical sampling data do not exist; for facilities for which historical sampling data are available, the Reclamation Authority may authorize a lower minimum sample requirement. For self-monitoring reports and periodic compliance reports for Class I users, the Reclamation Authority shall require the number of grab samples necessary to assess and assure compliance by Industrial Users with Applicable Pretreatment Standards and Requirements.

- f) Periodic measurements of flow, suspended solids and BOD for surcharge determination and other appropriate waste characteristics shall be made by those Users specifically designated by the Manager.
- g) Any other reports required by California State Law, including such reports as are required by Chapter 6.95 of the California Health and Safety Code.

08-09.3- Categorical Industrial User Reporting Requirements

In addition to the reports specified in Section 08-09.2, Categorical Industrial Users must submit Initial Baseline Monitoring Reports (BMRs) and periodic compliance reports, and, if necessary, schedule compliance reports, and final compliance reports.

- a) **Initial Baseline Monitoring Reports (BMRs):** Baseline Monitoring Reports shall be submitted to facilitate evaluation of initial compliance status with respect to categorical standards, and any modifications or conditions necessary to achieve full compliance with categorical standards.

Baseline Monitoring Reports shall include all information listed in Section 08-07.3, and shall include a statement, reviewed by an authorized representative of the Industrial User, and certified as to accuracy by a qualified professional, indicating whether Pretreatment Standards are being met on a consistent basis, and, if not, whether additional operation and maintenance and/or additional pretreatment is required for the Industrial User to meet the Pretreatment Standards and requirements. New sources shall submit a Baseline Monitoring Report at least 90 days prior to commencement of discharge.

If immediate compliance with the Categorical Standard is not possible and additional pretreatment or operation and maintenance is necessary, the report must specify the shortest time necessary to achieve compliance. The completion date must not be later than that specified in the applicable Categorical Standards. New sources must achieve compliance with all applicable Pretreatment Standards within 90 days of commencing discharge.

- b) **Schedule Compliance Reports:** Schedule compliance reports shall be submitted, if necessary, to demonstrate compliance with conditions of a time schedule requiring full compliance with Categorical Standards by a specified date. Schedule compliance reports shall contain dates for pretreatment equipment design completion, building permit submittal date, construction commencement date, construction updates, construction completion date, employee training completion date, and date of achieving final compliance. Samples shall be collected and analyzed to demonstrate compliance. The samples shall be taken in accordance with 40 CFR Part 136 and 40 CFR Part 403.12(b) (5). Schedule compliance reports shall be submitted at the completion of all major events necessary to achieve full compliance with Categorical Standards, but not less frequently than thirty (30) days. Schedule compliance reports must be submitted within fourteen (14) days of a milestone date. In no case shall any event in the compliance schedule exceed nine (9) months.
- c) **Final Compliance Reports:** Final compliance reports shall be submitted, if necessary, to demonstrate that full compliance with Categorical Standards has been achieved. Final compliance reports shall include all information contained in a Baseline Monitoring Report. Final compliance reports shall be submitted within ninety (90) days of achieving compliance with Categorical Standards. Final compliance reports from new sources must be submitted immediately after the facility commences discharge.
- d) **Periodic compliance reports:** Periodic compliance reports shall be submitted to demonstrate continued compliance with Categorical Standards. Periodic compliance reports shall include all monitoring data specified in the applicable Categorical Standard and any additional monitoring data obtained by the User. Sampling for periodic compliance reports shall be performed during the period covered by the report. Analyses shall be performed by a State certified laboratory using Approved Analytical Methods as defined herein. Sampling shall be performed in accordance with 40 CFR Part 136 and 40 CFR Part 403.12(b) (5). Periodic compliance reports shall be submitted every six (6) months in June and December of each year, unless required to be submitted more frequently by the Manager. Periodic compliance reports may be combined with self-monitoring reports pursuant to Section 08-09.2(d) herein.

08-09.4 - Industrial User Compliance Plans

- a) **Solvent Management Plans:** All Industrial Users subject to effective Categorical Standards which include a Total Toxic Organic (TTO) limitation shall be required to file a Solvent Management Plan. The Manager may also require other Users to submit Solvent Management Plans where, in his judgment, said plans are necessary to assure proper containment and disposal of solvents.
- b) **Slug Discharge Control Plans:** All Users so required by the Manager shall file a Slug Discharge Control Plan. The plan shall contain at least the following elements:
 1. Description of discharge practices, including nonroutine batch discharges;
 2. Description of stored chemicals;
 3. Procedures for prompt verbal notification of the Reclamation Authority of slug discharges, including any discharge that would violate a specific prohibition under Section 08-04.2 or 40 CFR Part 403.5(b), within twenty-four (24) hours of becoming aware of the discharge and procedures for follow-up written notification within five days (5) days;
 4. If necessary, procedures to prevent adverse impact from accidental spills or slug discharges, including inspection and maintenance of storage areas, handling and transfer of materials, loading and unloading operations, control of plant site runoff, worker training, building of containment structures or equipment, measures for containing toxic organic pollutants (including solvents), and/or measures and equipment for emergency response; and
 5. If necessary, follow-up practices to limit the damage suffered by the POTW or the environment.
- c) **Specific Compliance Plans:** All Users so required by the Manager shall file a Specific Compliance Plan. The Specific Compliance Plan shall indicate the cause of noncompliance, the corrective actions which will be taken to prevent recurrence of said noncompliance, and, if required by the Manager, a proposed Compliance Time Schedule indicating the dates those corrective actions will be completed.

08-09.5- Bypass Reporting

- a) For the purpose of this Section,
 1. Bypass means the intentional diversion of wastewater from any portion of the User's treatment facility.
 2. Severe property damage means substantial physical damage to property, damage to the treatment facilities which cause them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
- b) Bypass is prohibited, and the Manager may take enforcement action against a User for bypass, unless

1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 2. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventative maintenance.
 3. The User is required to submit notices are required in Section 08-09.5(d).
- c) The Manager may approve an anticipated bypass, after considering its adverse effects, if the Manager determines that it will meet the three conditions listed in paragraph (b) above.
- d) Bypass Notifications
1. If a User knows in advance of the need for a bypass, it shall submit prior notice to the Manager, at least ten (10) days before the date of the bypass, if possible.
 2. A User shall submit oral notice to the Manager of an unanticipated bypass that exceeds applicable Pretreatment Standards within twenty-four (24) hours from the time it becomes aware of the bypass. A written submission shall also be provided within five (5) days of the time the User becomes aware of the bypass. The written submission shall contain a description of the bypass and its cause; the duration of the bypass, including exact dates and times, and if the bypass has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, or prevent reoccurrence of the bypass. The Manager may waive the written report on a case-by-case basis if the oral report has been received within twenty-four (24) hours.

08-09.6 - Signatory and Certification Requirement

All permit applications, reports, and plans submitted to the Reclamation Authority by Industrial Users pursuant to Sections 08-07.3, 08-07.6, 08-09.2, 08-09.3, 08-09.4, and 08-09.5 shall be signed and dated by an authorized representative of the Industrial User. The signature shall accompany the following certification statement:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations".

Analytical reports submitted directly to the Reclamation Authority by a certified analytical laboratory at the request of the Industrial User for samples of wastewater collected at User facilities may be signed, dated, and certified by the laboratory manager in lieu of an authorized

representative of the User; however, such reports shall be accompanied by a statement, signed, dated, and certified by an authorized representative of the User, as above, which verifies that the sample identified in the analytical report was collected on the date and time indicated at the location indicated, and using the method indicated on the analytical report. Said signed, dated, and certified statement may be included as part of the chain-of-custody form for the sample.

08-09.7 - Member Entity Reporting Requirements

Each Member Entity shall promptly inform all applicants for business licenses within its jurisdiction of the requirements of Sections 08-04.1, 08-07.1, and 08-07.3 herein.

Each Member Entity shall submit a monthly report to the Manager, which contains the following information from each business license application received during the previous month: applicant's name, business name, mailing address, telephone number, type of business, and whether a nondomestic wastewater discharge is proposed. The monthly report shall also summarize all pretreatment program activities conducted by the Member Entity in accordance with the provisions of this Ordinance.

ARTICLE 09: ADMINISTRATIVE PROCEDURES

09-01 - Administration

Except as otherwise provided, the Manager shall administer, implement and enforce the provisions of this Ordinance. Any powers granted or imposed on the Manager may be delegated by him to other persons or authorized agents acting in the beneficial interest of or in the employ of the Reclamation Authority.

09-02 - Inspection and Sampling

The Manager may enter upon the Nondomestic User's premises during reasonable hours for the purpose of inspecting sewer systems and other facilities to ensure compliance with these Rules and Regulations, including the provision that self-regenerating water softeners shall not be connected to the sanitary sewer system contributing to the POTW, and the provisions that stormwater systems are separated from sanitary sewers.

The Manager shall inspect the facilities of each Significant Industrial User a minimum of once each year, and shall sample the discharge of each Significant Industrial User a minimum of once each year.

Persons or occupants of premises where nondomestic wastewater is created or discharged, or where the Manager has reason to believe that nondomestic wastewater may be created or discharged, shall allow the Manager ready access at all reasonable times to all parts of the premises for the purposes of inspection, sampling, examination and copying of records, taking photographs, and performance of any of his duties.

Any temporary or permanent obstruction to safe and easy access to the facility to be inspected and/or sampled shall be promptly removed by the User at the written or verbal request of the Manager and shall not be replaced. The expense of clearing such access shall be born by the User.

The Manager shall have the right to set up on the Industrial User's property such devices as are necessary to conduct sampling inspection, compliance monitoring, and/or metering operations. Where a User has security measures in force, which would require proper identification and clearance before entry into the User's premises, the User shall make necessary arrangements with its staff so that upon presentation of suitable identification, the Manager will be permitted to enter, without delay, for the purpose of performing inspection and sampling. Unreasonable delays in allowing the Manager access to the User's premises shall be a violation of this ordinance.

If the Manager has been refused access to a building, structure, or property, or any part thereof, and is able to demonstrate probable cause to believe that there may be a violation of this ordinance, or that there is a need to inspect and/or sample as part of a routine inspection and sampling program designed to verify compliance with this ordinance or any permit or order issued hereunder, or to protect the overall public health, safety, and welfare of the community, the Manager may seek

issuance of a search warrant from the Municipal or Superior Court of San Bernardino County through the Reclamation Authority Attorney

09-03 - Public Access to Information

Information and discharge data provided to the Reclamation Authority by a User shall be available without restriction to the EPA, the State Water Board, and the Regional Board. Such information shall also be available to the public without restriction, except where there is a claim of confidentiality by the User. All other information which is submitted by the User to the Reclamation Authority shall be available to the public, at least to the extent provided by 40 CFR Part 2.302. With the exception of Regulatory Agencies, any person requesting this information from the Reclamation Authority shall be required, prior to receipt of the information, to pay the reasonable costs of said data gathering reproduction and transmission incurred by the Reclamation Authority.

09-04 - Confidentiality

Any information submitted to the Reclamation Authority pertaining to the pretreatment program may be claimed by the User to be confidential, except for effluent data which will be available to the public without restriction. Any confidentiality claim must be asserted at the time of submission of the information to the Reclamation Authority. The claim may be asserted by stamping the words "Confidential business information" on each page containing such information or by other means; however, if no claim is asserted at time of submission, the Reclamation Authority may make the information available to the public without further notice. If such a claim is asserted, the information will be treated in accordance with the procedure in 40 CFR Part 2 (Public Information).

09-05 - Extension of Time Limits

Any time provided in any written notice or any provision of this Ordinance may be extended only by a written directive of the Manager.

09-06 - Conditional Waivers and Special Agreements

If any discharge or connection to the POTW fails to conform to any of the standards or requirements set forth or referenced in Sections 08-04.5, 08-05.1, 08-05.2, 08-06.1, 08-06.2, or 08-08.1, 08-08.2, 08-08.3, 08-08.4, or 08-08.5 herein, but the Manager finds that: a) the discharge will not cause harm to the POTW; b) the discharge will not unreasonably or inequitably burden the operation of the POTW; c) when considered together with discharges by other Users, the discharge will not materially affect the ability of the POTW to meet its requirements; and d) the requirement or requirements to be waived or modified are not part of a Categorical Standard or Prohibitive Discharge Standard; the Manager may grant approval for discharge to the POTW with a special agreement, waiver or modification of the requirement or requirements which could not be met; subject to any payments or User charges as may be applicable.

In the letter of approval, the Manager shall include a statement regarding the requirement that is waived or modified along with reasons as to why the waiver is issued. Any waiver granted pursuant to the section shall be subject to withdrawal at any time the Manager makes a subsequent finding that the POTW is unreasonably burdened or the ability of the POTW to meet its NPDES Permit discharge requirements or other permit or use requirements is materially affected.

09-07 - Appeal from Decisions

Administrative orders, waivers, permit conditions or disapproval of permit applications made by the Manager, pursuant to this Ordinance may be appealed to the Commission. The Commission may amend, modify, confirm, or reject any such decision provided the purpose and intent of this Ordinance is not violated. No appeal shall be made with respect to the specific Ordinance requirements pertaining to quality, content or method of disposal of wastewater that may be discharged, pursuant to Sections 08-04.2, 08-04.3, 08-04.4, and 08-05.3 herein, nor to any requirement of State or Federal Law.

ARTICLE 10: SERVICE AND USE CHARGES

10-01 - Service Charges

10-01.1 - Establishment of Rates

Rates to be charged and collected and terms, provisions, and conditions to be effective respecting such rates for regional sewer service supplied by the Reclamation Authority using the regional sewerage system to Member Entities within the Reclamation Authority Service Area shall be as fixed and established by the Commission from time to time and shall become an attachment of these Rules and Regulations (see Table II). The payment of service charges to the Reclamation Authority is the responsibility of each Member Entity, which in turn establishes the rates and service charges for Users within its local service area. This provision is in addition to and not by way of derogation of any other remedies or procedures available to the Reclamation Authority pursuant to any law or regulation or by any of the provisions of these Rules and Regulations.

10-01.2 - Change of Service Charge

The Commission reserves the right to change the schedule of regional sewer service charges and other charges and fees from time to time as necessary for the proper operation, maintenance, repair, replacement, and expansion of the regional system.

10-01.3 - Service Charge Billing

Regional sewer service charges to Member Entities will be rendered as part of the Reclamation Authority Service Bill at monthly intervals.

10-01.4 - Metering

For the purpose of computing charges, the Reclamation Authority will contract with an approved third party to provide accurate measurement of flow rate and cumulative totals at all connections to the Reclamation Authority's Interceptor Sewer. Such measurements will be made prior to entry of contributing flows into the interceptor and shall be used to determine a percentage allocation of the total flow for each connected entity. The percentage allocation will be applied to the total monthly influent flow, as measured at the WWTP influent mag meter, to determine the monthly flow contributed by each connected entity. Invoice billings will be sent to each connected Entity on a monthly basis. If, for any reason, the influent mag meter is out of service or flow measurements cannot be taken, the Reclamation Authority will estimate contributions based on the best available information including previous flows and existing conditions.

10-02 - Charges for Use

The purpose of a charge for use is to insure that each recipient of sewage service from the Reclamation Authority pays its reasonably proportionate share of all the costs of providing that sewerage service. Charges for use are used for recovering the cost of conveying, treating and disposing of sewage in the regional sewerage system and are exclusive of any fees levied by Local Sewering Agencies. The charge for use shall be based on the total maintenance, operation, capital expenditures and reserve requirements for providing regional wastewater collection, treatment and disposal and the related administration of the regional sewerage system.

ARTICLE 11: CONNECTION AND PRETREATMENT PROGRAM FEES

11-01 - Connection Fees

11.01.1 - Introduction

The regional sewerage system will provide adequate capacity for sewer service within the regional service area for a limited period of time. The Reclamation Authority must take into consideration future capacity requirements within the regional service area to ensure that the infrastructure necessary to provide reliable service to the Member Entities and their Users is constructed in advance. Failure to adequately plan for future capacity requirements can result in service interruption and the inability of the regional community to accommodate growth. In order to provide for future capacity requirements, Capital must be accumulated before it is required (pay-as-you-go) by levying connection fees. Connection fees have traditionally been the pay-as-you-go method for financing the expansion of a sewerage system. This follows the logic that, upon connection, a new discharger pays for its capacity just as the existing dischargers had paid to develop the original capacity in the sewerage system. The connection fees are accumulated in a fund for use when the sewerage system requires expansion.

11-01.2 - Connection Fees

- a) Connection fees will not be applied to properties developed prior to July 1, 1982, which are connected to existing local collection systems.
- b) Properties developed prior to July 1, 1982, unconnected to existing local collection systems will not be charged regional (Reclamation Authority) connection fees for the first five years after the completion of the interceptor to the contracting community. Thereafter, applicable Reclamation Authority connection fees will apply to such properties.
- c) Properties developed after June 30, 1982 will pay a connection fee applicable at the time of connection. Likewise, any additions or improvements to properties developed prior to July 1, 1982, which are connected and generate additional sewage, will pay a connection fee at the time applicable permits are issued.
- d) "Properties developed" as defined in Paragraph 5 of VVWRA Policy Resolution No. 81-10 shall be deemed to include all properties designated to be sewered within the regional service area for which a building permit for residential, commercial, or industrial structures has been issued and all applicable fees therefor have been paid on or prior to June 30, 1982.
- e) Connection fees shall be determined and assessed in accordance with VVWRA Connection Fee Ordinance No. 002, as amended, or successor.

11-01.3 - Duty of Enforcement

The Reclamation Authority sets the connection fees for Users within the regional service area and Member Entities set the connection fees for Users which are associated with the expansion of the tributary sewerage systems. The responsibility of calculating and enforcing connection fees is shared between the Reclamation Authority and the Member Entities, provided, however, that each Member Entity has the primary responsibility of enforcing the collection of regional and local connection fees in conjunction with its local authority to regulate land use and development within its boundaries. The provisions of this Section shall be applicable to any building, structure, or property contributing to the Reclamation Authority's regional sewerage system, whether the same is owned, operated, or controlled by a private party or by a public or quasi-public agency, corporation or association, other than the Reclamation Authority. The Member Entity shall, through the "Will Serve" process enforce payment of these connection fees. The Member Entity may, in addition thereto, add connection fees for their own purposes. Further, administrative and lateral charges may also be applicable.

Unless specified otherwise, all fees, charges and penalties imposed pursuant to this Ordinance are due and payable upon receipt of notice.

11-02- Pretreatment Program Fees

It is the purpose of this Section to provide for the recovery of costs from Industrial Users of the POTW for the implementation of the pretreatment program. The Reclamation Authority may adopt charges and fees, by resolution, which may include:

- a) Fees for the processing of applications.
- b) Fees for reimbursement of costs of developing and operating the Reclamation Authority pretreatment program.
- c) Fees for monitoring, inspections, surveillance procedures and laboratory costs.
- d) Fees for reviewing plans and construction inspections.
- e) Fees for reviewing accidental discharge procedures.
- f) Fees for filing appeals.
- g) Noncompliance fees.
- h) Extra strength charges; surcharge fees. These fees shall be assessed based on the pounds discharged of a constituent above stated permit conditions or allowable limits. AT NO TIME shall any user affected by Categorical Standards be permitted to discharge wastewater to the POTW in violation of Categorical Standards.
- i) Administrative fees for compensation for damages in accordance with Section 13-01.
- j) Other fees deemed necessary by the Reclamation Authority to implement the provisions of this Ordinance.

The Reclamation Authority may incorporate the equivalent amount of any of the above fees into its sewer charges. The current Pretreatment Program fees are in Table IV.

11-03 - Payment of Fees

Except as otherwise provided, all fees charged pursuant to the provisions of this Regulation are due and payable upon receipt of notice thereof.

The connection fee for a parcel shall be payable and collected at the time of final inspection or the date the certificate of occupancy is issued for improvements to the subject parcel, whichever occurs first.

All fees shall become delinquent thirty (30) days after mailing notice thereof to the mailing address of the discharger subject to such charges. The Reclamation Authority may impose a late fee on any charge that becomes delinquent as determined by the collection policy adopted by the Reclamation Authority from time to time. Such late fee shall accumulate on the unpaid balance of the delinquent charge until payment is received by the Reclamation Authority. The Reclamation Authority may further recover costs associated with the recovery of delinquent charges.

ARTICLE 12: EXECUTIVE PROVISIONS

12-01 - Right of Revision

The Reclamation Authority may from time to time, in its discretion and by resolution or Ordinance, amend the Rules and Regulations which govern the discharge of wastewater so as to keep the Reclamation Authority in compliance with evolving State and Federal Law.

12-02 - Right of Waiver

In the event of any declared local, State, or Federal emergency, the provisions of this Ordinance may be waived by resolution of the Board of Commissioners.

12-03 - Severability

If any provision, paragraph, word, section or article of this Ordinance is invalidated by any court of competent jurisdiction, the remaining provisions, paragraphs, words, sections and articles shall not be affected and shall continue in full force and effect.

12-04 - Conflict

If any discrepancy between this Ordinance and the Rules and Regulations of a Member Entity exists, the more restrictive ordinance shall govern.

All other Reclamation Authority ordinances and parts of other Reclamation Authority ordinances inconsistent or conflicting with any part of this Ordinance are hereby repealed to the extent of such inconsistency or conflict.

ARTICLE 13: ENFORCEMENT

13-01 - Compensation for Damages

Any person who, by discharge of wastewaters or by any other means, damages monitoring equipment, detrimentally affects wastewater treatment processes, significantly increases POTW operation costs, requires non-routine inspection and/or sampling, causes blockages of, damage to, interference with or pass-through from the POTW, or causes any other damages including the imposition of fines or penalties on the Reclamation Authority by Federal, State or local regulatory agencies, shall be liable to the Reclamation Authority for all damages and additional costs, including said fines or penalties, occasioned thereby. An administrative fee of twenty-five (25) percent of the Reclamation Authority's costs may be added to these charges and shall be payable within thirty (30) days of invoicing by the Reclamation Authority.

13-02 - Revocation of Permit

Any User who violates the following conditions of this Ordinance, or applicable State and Federal regulations, is subject to having his permit revoked:

- a) Failure of the User to factually report the wastewater constituents and characteristics of his discharge;
- b) Failure of the User to report significant changes in operations or wastewater constituents and characteristics;
- c) Failure of the User to provide reasonable access to the User's premises for the purpose of inspection or monitoring;
- d) Tampering with monitoring requirement;
- e) Failure to complete a wastewater survey or the Nondomestic Wastewater Discharge Permit Application;
- f) Failure of the User to pay fees, fines, and charges for use established pursuant to these Rules and Regulations; or
- g) Violation of conditions of any permit, ordinance, and/or compliance schedules, including the requirements of any Non-Domestic Water Discharge Permit, Liquid Waste Hauler Discharge Permit or Solid Waste ADM Discharge Permit.

13-03 - Notification of Violation

Whenever the Manager finds that any User has violated or is violating any applicable Pretreatment Standard or requirement contained in this Ordinance or the Nondomestic Wastewater Discharge Permit, or the requirements of any Liquid Waste Hauler Discharge Permit or Solid Waste ADM Discharge Permit, the Manager may serve upon such person a written notice stating the nature of the violation and stating the penalties for continued noncompliance. If required in the notice, such User shall submit to the Manager, within a prescribed period specified in the notice, a Specific Compliance Plan pursuant to Section 08-09.4(c). Submission of such a plan in no way relieves the User of liability for any violations occurring before or after receipt of the Notice of Violation.

Nothing in this Section shall limit the authority of the Manager to take any action, including emergency actions or any other enforcement action, without first issuing a Notice of Violation.

13-04 - Compliance Time Schedule

The Manager may adopt a proposed Compliance Time Schedule submitted by the User, or may adopt a revised Compliance Time Schedule if, in the judgment of the Manager, the proposed Compliance Time Schedule is unreasonable. The Manager will notify the User of the Adopted Compliance Time Schedule in a timely manner. The Manager shall not adopt a Compliance Time Schedule which extends beyond applicable federal deadlines. Nothing in this Section shall limit the authority of the Manager to take any action, including emergency actions or other enforcement action, without first adopting a Compliance Time Schedule

13-05 - Administrative Orders

The Manager may require compliance with any prohibition, limitation, or requirement of this Ordinance or the provisions of a Nondomestic Wastewater Discharge Permit, a Liquid Waste Hauler Discharge Permit or a Solid Waste ADM Discharge Permit, by issuing administrative orders that are enforceable in a court of law or by directly seeking court action. Nothing in the following Sections shall limit the authority of the Manager to take any action, including emergency actions or any other enforcement action, without first issuing administrative orders. Administrative orders may include:

- a) **Stop Work Orders:** The Manager may direct the Local Sewering Agency to serve a written stop work order on any person(s) engaged in doing or causing to be done new construction, tenant improvements, alterations, or additions, if violations of this Ordinance are found at the site of the new construction, tenant improvements, alterations, or additions. Any person served a Stop Work Order shall stop such work forthwith until written authorization to continue is received from the Manager and the Member Entity.
- b) **Compliance Orders:** When the Manager finds a discharge of wastewater has violated or threatens to violate any prohibition or limitation of this Ordinance or the provisions of a Nondomestic Wastewater Discharge Permit, the Manager may issue a Compliance Order and direct those persons not complying with such prohibitions, limitations, requirements, or provisions to:
 1. Comply immediately; or
 2. Comply in accordance with a specific compliance time schedule.
 A Compliance Order may include modifications in the frequency and extent of monitoring sampling and analysis, and submission of self-monitoring reports. A Compliance Order may also establish a noncompliance monitoring program, or include modifications to an existing noncompliance monitoring program.
- c) **Cease and Desist Orders:** When the Manager finds that any User has violated or threatens to violate any provision of this Ordinance or its Nondomestic Wastewater Discharge Permit, the Manager may issue a Cease and Desist Order directing the User to:

1. Comply immediately; or
2. Comply in accordance with a time schedule specified in the Cease and Desist Order.

A Cease and Desist Order may include modifications in the frequency of monitoring, testing, and submission of self-monitoring reports. A Cease and Desist Order may also establish a noncompliance monitoring program.

- d) **Cease Discharge Orders:** When the Manager finds that any User has violated or threatens to violate any provision of this Ordinance or its Nondomestic Wastewater Discharge Permit, the Manager may revoke or suspend the User's Wastewater Discharge Permit and terminate sewer service to that User upon issuance of a Cease Discharge Order. The User shall be liable for all costs for termination of sewer service incurred by the User and the Reclamation Authority.

This provision is in addition to other statutes, rules, or regulations authorizing termination of service for delinquency in payment, or for any other reason. Sewer service shall be reinstated by the Manager after the User has complied with all provisions in the Administrative Order. The User shall be liable for all costs for reinstating sewer service.

- e) **Immediate Termination of Service:** The Manager may immediately suspend wastewater treatment service and any Nondomestic Wastewater Discharge Permit when such suspension is necessary, in the opinion of the Manager, to stop an actual or threatened discharge which presents or may present an imminent or substantial endangerment to the health or welfare of persons, the environment, or causes interference to the POTW. Other conditions that may subject the User to termination of service include:
1. Failure to accurately report the wastewater constituents and characteristics of its discharge;
 2. Failure to report significant changes in operations or wastewater volume, constituents, and characteristics prior to discharge; or
 3. Refusal of reasonable access to the User's premises for the purpose of inspection, monitoring, or sampling

Any User notified that wastewater treatment service and any Nondomestic Wastewater Discharge Permit has been suspended, shall immediately stop and eliminate the applicable contributions to the POTW. In the event of failure to comply voluntarily with the suspension order, the Manager shall take steps as deemed necessary including directing the Member Entity to immediately sever the sewer connection. The User shall be liable for all costs incurred by the Reclamation Authority in terminating sewer service.

Sewer service shall be reinstated by the Manager after the actual or threatened discharge has been eliminated. A detailed written statement, submitted by the User, describing the causes of the harmful contribution and the measures taken to prevent any future occurrence shall be submitted to the Manager within fifteen (15) days of the date of sewer service termination.

- f) **Notices of Discharge Prohibition:** The Manager may serve a written Notice of Discharge Prohibition on any person(s) engaged in any activity or activities which, while not resulting in a discharge of nondomestic wastewater to the POTW at the time, may, in the Manager's

judgment, result in a discharge of nondomestic wastewater at some time in the future. A Notice of Discharge Prohibition shall include at least the following:

1. A list or citation of general discharge restrictions and prohibitions;
2. A list of any Categorical Standards that would be applicable upon commencement of nondomestic wastewater discharge;
3. A requirement to apply for and obtain a nondomestic wastewater discharge permit prior to commencing discharge of nondomestic wastewater to the POTW;
4. A requirement for notification of slug or accidental discharges; and
5. A statement of applicable civil and criminal penalties for violation of Pretreatment Standards and requirements.

A Notice of Discharge Prohibition may also contain one or more of the following:

1. A requirement to prepare and submit a Slug Discharge Control Plan;
 2. A requirement to install and maintain one or more spill containment systems;
 3. A requirement for maintaining and retaining plant records relating to wastes removal from the facility; and
 4. A requirement to submit an annual written statement to the Manager certifying that no nondomestic wastewater has been discharged to the POTW during the previous year other than discharges of which the Manager was properly notified, and that no nondomestic wastewater will be discharged during the forthcoming year without proper notification and/or obtaining a Nondomestic Wastewater Discharge Permit.
- g) **Suspension or Termination of Discharge Rights:** With respect to the violation of the requirements of a Liquid Waste Hauler Discharge Permit or Solid Waste ADM Discharge Permit, the Manager may revoke or suspend the right of the permit holder to discharge Septage or ADM to the POTW until such time as the permit holder is in compliance with the terms of the applicable permit.

13-06- Noncompliance Monitoring Program

- a) If sampling by Reclamation Authority or User indicates that the User is discharging constituents in violation of the mass emission or concentration limits established by Reclamation Authority resolution or contained in User's Nondomestic Wastewater Discharge Permit, then the User must notify the Manager within twenty-four (24) hours of becoming aware of the violation. The User shall collect a follow-up sample (as directed by Manager). The User shall submit the completed sample analysis to the Reclamation Authority within thirty (30) days of notification by the Reclamation Authority.
- b) If the follow-up sample indicates noncompliance with permit requirements, the User may be required by the Reclamation Authority to immediately initiate a noncompliance monitoring program requiring additional sampling and reporting by the User in accordance with a schedule issued by the Manager. During the program, the User may be subject to noncompliance fees established by Reclamation Authority resolution. Fees may be required for each sample analysis indicating violation or violations of limits specified in

User's permit or established by Reclamation Authority resolution. User may also be subject to a fee for each sample analysis not submitted by the User to the Reclamation Authority in accordance with the schedule specified in the program.

- c) The noncompliance monitoring program may be terminated by the Reclamation Authority upon the User's demonstration of a return to compliance. To demonstrate a return to compliance, the User must either terminate discharge or provide analyses showing consistent compliance over a period of not less than 30 days or as specified in the Program.
- d) The payment of noncompliance fees by Users shall not bar the Reclamation Authority from undertaking any other enforcement procedures specified herein.

13-07 - Administrative Hearing

Any User may request, or the Manager may order, an Administrative Hearing, at which a User who causes or allows or who has caused or allowed an unauthorized discharge to enter the POTW shall show cause why the proposed enforcement action should not be taken. An Administrative Hearing Officer who is a Reclamation Authority Officer not directly involved in the enforcement of this Ordinance, shall preside over the Administrative Hearing, at which each party, including the User and the Manager, shall have the right to present evidence. A notice shall be served on the User specifying the time and place of the hearing regarding the violation, the reasons why the action is to be taken, the proposed enforcement action, and directing the User to show cause before the Administrative Hearing Officer why the proposed enforcement action should not be taken. The notice of the hearing shall be served personally or by registered or certified mail (return receipt requested) at least ten (10) days before the hearing. Service may be made on any agent or officer of the User.

13-08 - Annual Public Notice of Significant Noncompliance

In March of each year, the Reclamation Authority shall publish in the newspaper with the largest daily circulation in the Victor Valley Wastewater Reclamation Authority service area a list of all Industrial Users which have been in Significant Noncompliance with applicable Pretreatment Standards or Requirements during the previous calendar year.

13-09 - Legal Action

If any User violates the provisions of this Ordinance, Federal or State Pretreatment requirements, or any order of the Reclamation Authority, the Reclamation Authority Attorney may commence an action for appropriate legal, equitable, and/or injunctive relief in the Municipal or Superior Court of San Bernardino County.

In addition to the penalties provided herein, the Manager may recover reasonable attorney fees, court costs, court reporters' fees, and other expenses of litigation by appropriate suit at law against the person found to have violated any of the provisions of this Ordinance or the orders, rules, regulations, and permits issued thereunder.

13-10 - Injunctive Relief

When the Manager finds that a User has violated, or continues to violate, any provision of this Ordinance, its Nondomestic Wastewater Discharge Permit, or order issued hereunder, or any other Pretreatment Standard, the Manager may petition the Municipal or Superior Court of San Bernardino County through the Reclamation Authority Attorney for the issuance of a temporary or permanent injunction, as appropriate, which restrains or compels the specific performance of the Nondomestic Wastewater Discharge Permit or other requirements imposed by this Ordinance on activities of the User. The Manager may also seek such other action as is appropriate for legal and/or equitable relief, including a requirement for the User to conduct environmental remediation. A petition for injunctive relief shall not be a bar against, or a prerequisite for, taking any other action against a User.

13-11 - Civil Penalties

Any User who is found to have violated any prohibition, limitation or requirement of this Ordinance or of his Nondomestic Wastewater Discharge Permit or an administrative order shall be subject to civil penalty of not less than one thousand dollars (\$1,000) nor more than twenty-five thousand dollars (\$25,000) for each offense per day. Each violation shall be considered a separate and distinct offense, and each day on which a violation shall occur or continue shall be deemed a separate and distinct offense. In addition to the penalties provided herein, the Reclamation Authority may recover reasonable attorneys' fees, court costs, court reporters' fees and other expenses of litigation by appropriate suit at law against the person found to have violated this Ordinance or the orders, rules, regulations, and permits issued hereunder.

Civil Penalties may be imposed, assessed and recovered by action commenced in the Superior Court through petition by the Manager pursuant to Section 54740 of the California Government Code, or by Administrative Hearing in accordance with Section 13-07. Assessment of Civil Penalties through the Administrative Hearing Process shall be in accordance with Section 54740.5 of the California Government Code.

13-12 - Criminal Penalties

Any person who willfully violates any provision of this Ordinance or permit condition; who knowingly violates any stop work order, cease and desist order, prohibition or effluent limitation; who knowingly makes any false statements, representation, or certification in any application, record, report, plan, or other document filed or required to be maintained pursuant to this Ordinance or a Nondomestic Wastewater Discharge Permit; or who falsifies, tampers with, or knowingly causes inaccuracy in any monitoring device or method required or authorized under this Ordinance, shall, upon conviction, be guilty of a misdemeanor which is punishable by a fine not to exceed one thousand dollars (\$1,000.00) or by imprisonment for a period of not more than six (6) months or by both such fine and imprisonment. Each such person shall be deemed guilty of a separate offense for every day during any portion of which any violation of any provisions of

this Ordinance is committed, continued, or permitted by such person, and shall be punishable for that violation as provided by this Section.

13-13 - Remedies Nonexclusive

The remedies provided for in this ordinance are not exclusive. The Manager may take any, all, or any combination of these actions against a noncompliant User. Enforcement of pretreatment violations will generally be in accordance with the Enforcement Response Plan. However, the Manager may take other action against the User when the circumstances warrant. Further, the Manager is empowered to take more than one enforcement action against any noncompliant User.

13-14 - Payment of Penalties

Except as otherwise provided, all penalties made pursuant to the provisions of this Ordinance are due and payable upon receipt of notice thereof. All such penalties shall be delinquent thirty (30) days after mailing notice thereof to the mailing address of the User subject to such penalties. A penalty that becomes delinquent may have added to it a delinquency charge equal to the maximum interest permitted by law.

13-15 - Collection

Upon motion of the Board of Commissioners of the Reclamation Authority, any charge and all penalties and delinquency charges thereon shall be collected by lawsuit in the name of the Reclamation Authority. Any such action for collection may include an application for an injunction to prevent repeated and recurring violations of this Ordinance.

13-16 - Enforcement Response Plan

The Manager shall prepare, implement, and, if necessary, periodically update an Enforcement Response Plan in conformance with EPA guidelines contained in 40 CFR Part 403.8(f) (5).

END OF TEXT OF ORDINANCE

Approval and Adoption

THIS ORDINANCE NO. 001 IS APPROVED AND ADOPTED ON: December 8, 2016

Scott Nassif,
Chair VVWRA Board of Commissioners

APPROVED AS TO FORM:

ATTEST:

Piero C. Dallarda of Best Best & Krieger
LLP VVWRA General Counsel

Russ Blewett,
Secretary VVWRA Board of Commissioners

Certification

I, Kristi Casteel, Secretary to the Board of Commissioners (“Commission”) of the Victor Valley Wastewater Reclamation Authority, certify that the foregoing Ordinance was introduced at a regular meeting of the Board of Commissioners on the November 10, 2016, and was adopted by the Commission at a regular meeting held on the December 8, 2016 by the following vote of the Commissioners:

AYES:

NOES:

ABSTAINED:

ABSENT:

IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of the Victor Valley Wastewater Reclamation Authority on this December 8, 2016.

Kristi Casteel
Secretary to the Board of Commissioners

Form of Certificate of Adequacy of Sewerage System

It is hereby understood by all persons signing this certificate that the Member Entity will not consider allowing use of its facilities by this land development without having received the representations contained herein.

I certify that the following statements are true:

1. I hold a currently valid certificate of registration as a Civil Engineer issued pursuant to Section 6700 et. seq. of the Business and Professions Code, State of California. I am further qualified by experience to design sewage systems.
2. The sewerage system has been designed in accordance with good engineering practice and meets all of the requirements of Victor Valley Wastewater Reclamation Authority and the Member Entity having jurisdiction.
3. All design criteria and the materials and methods of construction specified for use in this sewerage system meet or exceed standards adopted and approved by the Victor Valley Wastewater Reclamation Authority and the Member Entity.

Signature

Date

4. The Member Entity hereby agrees that adequate capacity is available or will be made available to accept sewerage contributions from this development within _____ year(s) from the execution date of this certificate.

Member Entity Signature

Date

Table I: Specific Local Pollutant Concentration Limits**Daily Maximum Concentration for Permitted Industrial Dischargers:**

pH	5 to 11
Pollutant	Concentration Limit (mg/l)
Arsenic	1.5
Barium	10.0
Biochemical Oxygen Demand (BOD)	50,000
Boron	1.04
Cadmium	0.2
Chromium, Total	2.0
Copper	2.2
Cyanide	.012
Fluoride	1,000
Iron	200
Lead	1.7
MBAS (Surfactants)	100
Mercury	0.1
Methyl Tert Butyl Ethylene (MTBE)	0.0005
Nickel	2.0
Nitrogen, Ammonia	500
Selenium	1.0
Silver	0.4
Tetrachloroethene (TCE or PCE)	0.53
Toluene	1.53
Total Dissolved Solids (TDS)	1,000
Total Petroleum Hydrocarbons (TPH)	500
Zinc	2.3

Adopted July 25th 2001

Table II: Fee Schedule

Victor Valley Wastewater Reclamation Authority Fee Schedule

Effective December 1st 2019

Connection Fees: \$4000 per EDU*

User Charges: Unit Cost (\$/MG)

FY 18-19	FY 19-20	FY 20-21	FY 21-22	FY 22-23	FY 23-24
\$3,503	\$3,784	\$4,087	\$4,414	\$4,768	\$5,150

High Strength Surcharges:

Refer to the attached **worksheet** for an example of the calculation used to determine the surcharge rate.

FY 15-16: \$3,004

BOD \$/LB Applied to Concentrations above 200 mg/L

TSS \$/LB Applied to Concentrations above 250 mg/L

NH3 \$/LB Applied to Concentrations above 250 mg/L

FY 16-17: \$3,274

BOD \$/LB Applied to Concentrations above 200 mg/L

TSS \$/LB Applied to Concentrations above 250 mg/L

NH3 \$/LB Applied to Concentrations above 250 mg/L

FY 17-18: \$3,503

BOD \$/LB Applied to Concentrations above 200 mg/L

TSS \$/LB Applied to Concentrations above 250 mg/L

NH3 \$/LB Applied to Concentrations above 250 mg/L

FY 18-19: \$3,503

BOD \$/LB **\$0.3685** Applied to Concentrations above 200 mg/L

TSS \$/LB **\$0.2470** Applied to Concentrations above 250 mg/L

NH3 \$/LB **\$4.1368** Applied to Concentrations above 250 mg/L

FY 19-20: \$3,784

BOD \$/LB **\$0.3685** Applied to Concentrations above 200 mg/L

TSS \$/LB **\$0.2470** Applied to Concentrations above 250 mg/L

NH3 \$/LB **\$4.1368** Applied to Concentrations above 250 mg/L

Septage Receiving Fee: \$.0936 per gallon

[Anaerobically Digestible Materials \(ADM\) Tipping Fee: \\$.05 per gallon \(Per Resolution 2021-06\)](#)

*EDU=Equipment Dwelling Unit (245 gallons/day or 20 fixture units)

**Victor Valley Wastewater Reclamation Authority
High Strength Surcharge
Example Worksheet**

Procedure to Determine Annual Surcharge Fee

FOR EXAMPLE ONLY

User Charges from Member Agencies \$ 10,112,000
 Unit User Charge per MG \$2,528.00
 Estimated Treatment Flow (MG) 4.000

	Influent mg/l	Influent lbs/day	Effluent mg/l	Effluent lbs/day	Removal lbs/day	Removal lbs/year	Percent of Cost	Removal Cost/lb	Unit Cost \$
FOR EXAMPLE ONLY									
BOD	400.00	36,559	4.00	366	36,193	13,210,560	35.0%	\$3,539,200	\$0.2679
TSS	300.00	27,419	2.21	202	27,217	9,934,274	25.0%	\$2,528,000	\$0.2545
NH3	30.00	2,742	0.10	9	2,733	997,464	30.0%	\$3,033,600	\$3.0413
Annual Flow - MG per Day		4,380 MG / 365 days	10.96						
							10.0%	\$1,011,200	
							100.0%	\$10,112,000	

	BOD \$/lb	TSS \$/lb	NH3 \$/lb
FOR EXAMPLE ONLY			
Surcharge Rates:	\$0.2679	\$0.2545	\$3.0413
Applied to Concentrations Above:	200 mg/l	250 mg/l	20 mg/l

FORMULAS

lbs/day = flow (mgd) x concentration (mg/l) x weight of water (8.34 lbs/gal)

BOD

Influent (flow mgd) x (influent mg/l) x 8.34 lbs/gal = lbs/day
 Effluent (flow mgd) x (effluent mg/l) x 8.34 lbs/gal = lbs/day

TSS

Influent (flow mgd) x (influent mg/l) x 8.34 lbs/gal = lbs/day
 Effluent (flow mgd) x (effluent mg/l) x 8.34 lbs/gal = lbs/day

NH3

Influent (flow mgd) x (influent mg/l) x 8.34 lbs/gal = lbs/day
 Effluent (flow mgd) x (effluent mg/l) x 8.34 lbs/gal = lbs/day

REMOVAL

Per day: Influent lb/day - Effluent lb/day = Removal lbs/day
 Per year: Removal lb/day x 365 = Removal lb/year

REMOVAL COST

Per lb: Total user cost x 35% = Removal cost/lb
 Per unit: Removal cost/lb / Removal lb/year

Note:

1. BOD, Biochemical Oxygen Demand, use the annual average from the prior year Annual Discharge Monitoring Report
2. TSS, Total Suspended Solids, use the annual average from the prior year Annual Discharge Monitoring Report
3. NH3, Ammonia, use the annual average from the prior year Annual Discharge Monitoring Report
4. MG, Flow in Million Gallons budgeted for upcoming Fiscal Year

Table III: Unit Operations and Maintenance Cost Determination

SEE ATTACHED

Table IV
Pretreatment Program Fees

Wastewater Discharge Permit Application Fee (Class I, II, IV): \$220

Wastewater Discharge Permit Fees

Permit Type	Annual Fee
Class I	\$3,000
Class II	\$3,000
Class III	\$175
Class IV	\$800

Plan Check Fee: \$110

Follow-up Inspection Fee: \$330

Follow-up Compliance Sampling Fee: \$220 plus analytical costs

EXHIBIT A

LARRY WALKER ASSOCIATES REPORT



EXHIBIT B

RESOLUTION 1 | REGARDING SOLID WASTE AND DISPOSAL FEES



**VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report**

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DP*
SUBMITTED BY: Darron Poulsen, General Manager
DATE: July 15, 2021
SUBJECT: **RECOMMENDATION TO SCHEDULE THE SECOND READING OF ORDINANCE 001- RULES AND REGULATIONS FOR SEWER SERVICE**

<input checked="" type="checkbox"/> For Action	<input type="checkbox"/> Fiscal Impact
<input type="checkbox"/> Information Only	<input type="checkbox"/> Account Code:
	<input type="checkbox"/> Funds Budgeted/ Approved:

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners authorize the General Manager to schedule the second reading of Ordinance 001- Rules and Regulations for Sewer Service for August 19, 2021, at 8:00 AM.

PREVIOUS ACTION(S) & BACKGROUND INFORMATION

On direction from the Board, the first reading of Ordinance 001 was scheduled for July 15, 2021. Two public hearings are required to revise an ordinance. Because the Board needs to take action and direct staff to do so, staff is requesting such direction.



VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DP*
SUBMITTED BY: Darron Poulsen, General Manager and Brad Adams, Plant Superintendent
DATE: July 15, 2021
SUBJECT: RECOMMENDATION TO APPROVE THE SECOND AMENDMENT TO THE GAS COLLECTION FACILITIES LEASE AND ENERGY SERVICES AGREEMENT

<input checked="" type="checkbox"/>	For Action	<input checked="" type="checkbox"/>	Fiscal Impact	\$ 1,132,934
<input type="checkbox"/>	Information Only	<input type="checkbox"/>	Account Codes:	TBD
		<input checked="" type="checkbox"/>	Funds Budgeted/Approved	

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners approve the General Manager to execute the Second Amendment to the Gas Collection Facilities Lease and Energy Service Agreement with SoCal Biomethane, LLC upon approval of the amendment by the VVWRA Attorneys.

PREVIOUS ACTION(S)

April 18, 2019, the Board of Commissioners authorized the General Manager to sign the Gas Collection Facilities Lease and Energy Storage Agreement with SoCal Biomethane, LLC.

July 27, 2020, the Board of Commissioners authorized the General Manager to execute the first amendment to the Gas Collection Agreement and contract with SoCal Biomethane, LLC upon approval of the amendment by the VVWRA Attorneys.

BACKGROUND INFORMATION

On May 9, 2019, per the Board of Commissioners approval, the VVWRA General Manger entered into an agreement with SoCal Biomethane. Within the agreement there were agreed upon stipulations whereby VVWRA would receive improvements to the Regional Wastewater Treatment Plant (WWTP) that included, upgrades to the digesters and improvements to the anaerobically digestible material (ADM) and fats, oil, and grease (FOG) collection and processing infrastructure. All the proposed improvements were agreed upon due to their ability to compliment the operational efficiency of the SoCal Biomethane facilities. These SoCal

Biomethane facilities once operational would be able to take the additional biogas from the reconditioned digesters and deliver the biogas to third parties to produce a positive revenue stream. The agreement detailed the necessary financing and cost recovery terms for SoCal Biogas to recover their capital costs associated with the WWTP improvements through an agreed upon cost sharing arrangement. Once VVWRA is able to pay back the capital investment the revenues from the sales of the biogas would then become an additional revenue stream for the Authority that could be used to offset member agency costs for the treatment of the wastewater and also lessen the carbon footprint of the WWTP.

The rehabilitation of the digesters 1, 2, and 3 per the original contract requirements dated May 9, 2019, were completed by December 2019. Upon completion of that work two issues arose that needed resolution before the project could move forward. The first concern was the roof on digester 2 was found to be faulty and in need of replacement, which was not part of the original project scope. The second concern that was not sufficiently addressed or known was how the increased digestive material would impact the drying beds. Both of these concerns required the project to be put on hold in January 2020.

Discussions on how to move forward with replacing the roof on digester 2 and moving the project forward took place over the next few months and a proposed first amendment to the original contract was developed to resolve the concern was approved by the Board on July 27, 2020.

The final scope of work per this Amendment increased the biogas production above the plans in the original Agreement which will increase revenues. The proposed mutually beneficial improvements to the WWTP will enhance treatment operations and provide for greater capacity. The final agreed upon scope of the project included the following WWTP upgrades:

1. Two additional liquid receiving tanks adjacent to Digester 3 plus modifications to Digesters 1,2, and 3 for feeding of this material
2. Membrane roof for Digester 2 plus PSM mixers
3. Three mixer posts and service boxes for Digesters 4 and 5
4. Grade and pave the ADM receiving area to accommodate two receiving stations and provide drainage to the adjacent Equalization Basin.
5. Additional Flare facility to accommodate up to 1200 scfm of biogas
6. New thickened waste activated sludge (TWAS) line from the existing DAF discharge pump to digesters 1, 2, 3, 4, and 5 supported on above ground pipe rack.

During the construction of the work detailed in the first amendment to the contract listed above, additional issues that were not known at the time were found causing the need for additional work and a second amendment to the contract to complete the project. In order to meet the goals of the project and to deal with unforeseen concerns with existing facilities the following scope of work is needed to complete the project.

1. Digester 3 improvements – This change in scope includes removing the existing pump mixing system, retrofitting two Anaergia PSM mixer service boxes to the existing roof, installing new mixer post and pedestals for the mixers, installing two new PSM mixers, and installing one new mixer VFD panel. The scope of work includes all associated mechanical, structural, electrical design and construction activities.
2. 2G Combined Heat and Power (CHP) Natural Gas Retrofit- The VVWRA site has two existing CHPs that currently operate only on biogas. Both CHPs will have new engines

installed that operate only on natural gas. The additional scope of work here includes the procurement, installation, and startup of the new natural gas engines into the two existing CHPs.

3. Sludge and Gas Pipeline Relocation - The existing Digester 1, 2, and 3 area is an older part of the VVWRA facility and many of the underground pipes in this area are old and the remaining useful life is uncertain. Due to this uncertainty, Landlord requested redesign of the planned sludge and gas pipeline in this area to minimize impact on the existing underground piping. This additional scope of work here includes the redesign and additional costs associated with this redesign.

These improvements totaling \$1,132,934 are budgeted in Fiscal Year 21-22 Capital budget. For all of the reasons detailed above, it is recommended that the Board of Commissioners approve the General Manager to execute the Second Amendment to the Gas Collection Facilities Lease and Energy Service Agreement with SoCal Biomethane, LLC upon approval of the amendment by the VVWRA Attorneys.

Attachment(s):

Exhibit 1 – Second Amendment to Gas Collection Facilities Lease and Energy Services Agreement

EXHIBIT 1

**SECOND AMENDMENT
TO
GAS COLLECTION FACILITIES LEASE AND ENERGY SERVICES AGREEMENT**

This Second Amendment to Gas Collection Facilities Lease and Energy Services Agreement ("Amendment"), dated as of June [___], 2021 ("Effective Date") is entered into by and between SOCAL BIOMETHANE, LLC, a Delaware limited liability company ("Tenant"), and VICTOR VALLEY WASTE WATER RECLAMATION AUTHORITY, a Joint Powers Authority and a Public Agency of State of California organized and existing in the County of San Bernardino under and by virtue of the laws of the State of California ("Landlord").

RECITALS

WHEREAS, Landlord and Tenant are parties to that certain Gas Collection Facilities Lease and Energy Services Agreement dated as of May 9, 2019 ("Original Agreement"), as modified by that certain First Amendment dated July 27, 2020 ("First Amendment"). The Original Agreement and the First Amendment are collectively referred to as the "Agreement"; and

WHEREAS, Landlord and Tenant agreed upon certain changes to the WWTP in the First Amendment referred to as the WWTP Upgrades, including upgrades to the digesters and improvements in the ADM collection and processing infrastructure, all of which will complement the operational efficiency of the SoCal Biomethane Facilities by improving the digester's capacity to process additional ADM and sustain additional biogas generation; and

WHEREAS, during the course of construction of the WWTP Upgrades, Landlord and Tenant have discovered additional issues with the digesters and the planned design of various WWTP Upgrades, as well as the need to relocate certain pipelines that are in conflict with the designs and/or future ability to efficiently operate the WWTP; and

WHEREAS, Landlord and Tenant have agreed upon certain additional infrastructure to address such issues (the "Additional Improvements"), a description of which is attached hereto as Exhibit A; and

WHEREAS, Tenant has agreed to perform all work related to the Additional Improvements in connection with its ongoing work under the Agreement on the SoCal Biomethane Facilities; and

WHEREAS, Landlord has agreed to share in the cost of the Additional Improvements;

WHEREAS, the Landlord and Tenant desire to amend the Agreement to account for the financing and construction of the Additional Improvements; and

WHEREAS, the Landlord and Tenant desire to define the "Premises" of the Lease;

NOW THEREFORE, in consideration of the mutual promises set forth below, recitals above, and other good and valuable consideration, the receipt and sufficiency of which are hereby acknowledged, the Parties hereby agree as follows:

1. Premises: SoCal Biomethane Facilities; Pipeline Easement.
 - a. The Premises, as such term is defined in Section 1.1 of the Lease, shall consist of the RNG Plant and the buffer space surrounding the RNG Plant that is depicted on Exhibit B attached hereto.
 - b. For clarification purposes, the SoCal Biomethane Facilities shall include all of the facilities, machinery and equipment associated with the RNG Plant and located within the Premises.
 - c. Tenant acknowledges that Landlord has granted the Pipeline Easement to Southwest Gas for the delivery of biomethane from the Interconnect Facility to the main gas pipeline operated by Southwest Gas.
2. Landlord Contribution. Landlord and Tenant hereby acknowledge the final amount of the Landlord Contribution in the First Amendment was determined to be \$1,142,995 and this amount shall be used as the Landlord Contribution for all purposes contained therein.
3. Additional Improvements. Tenant shall undertake the work necessary to design and construct the Additional Improvements in accordance with the terms of this Amendment, the Additional Improvement Documents and Exhibit C of the Lease.
4. Scope of Work of Additional Improvements. Within thirty (30) days of the execution of this Amendment, Tenant and Landlord will agree in writing on (i) a detailed scope of work for the Additional Improvements; and (ii) the schedule for completion of the Additional Improvements. The scope of work and schedule are collectively referred to herein as the "Additional Improvement Documents". The Additional Improvement Documents will be subject to the approval of Landlord and Tenant, each in their sole discretion. The Additional Improvements will become the property of Landlord upon completion.
5. Financing and Cost Recovery.
 - a. In recognition of the dual benefit of the Additional Improvements, the Landlord will contribute the sum of One Million One Hundred Thirty-Two Thousand, Nine Hundred Thirty Four Dollars (\$1,132,934.00) ("Landlord Allocation"), of which \$250,000 will be allocated to the 2G CHP Natural Gas Retrofit, \$282,934 will be allocated to the sludge and gas pipeline relocation and \$600,000 will be allocated to the cost of the Digester 3 mixing improvements, all as detailed on Exhibit A. Tenant will invoice and Landlord will pay for the Landlord Allocation in six equal monthly payments of One Hundred Eighty Eight Thousand, Eight Hundred Twenty Two and 33/100 dollars (\$188,822.33). The

payments will be invoiced on the first day of August, 2021 and each month thereafter and will be payable by the 30th day of each month.

b. The total cost of the 2G CHP Natural Gas Retrofit is expected to be Five Hundred Thousand Dollars (\$500,000) and Tenant has agreed to pay all costs in excess of the \$250,000 paid by Landlord. Such costs in excess will be added to the capital cost of the SoCal Biomethane Facilities and amortized pursuant to Section 4(b)(iii) of the Lease as a cost item in the calculation of Net Revenue and will thereby reduce the amount of Additional Rent payable to Landlord.

c. It is contemplated that the total cost of the Digester 3 mixing improvements will exceed the Landlord Allocation for such item by Three Hundred Twenty Four Thousand Dollars (\$324,000), subject to adjustment as provided in Section 4(d) hereof ("Project Allocation"). The Project Allocation will be financed by Tenant and will be added to the capital cost of the SoCal Biomethane Facilities and amortized pursuant to Section 4(b)(iii) of the Lease as a cost item in the calculation of Net Revenue and will thereby reduce the amount of Additional Rent payable to Landlord.

d. Landlord and Tenant agree to make reasonable adjustments to the amounts set forth in Sections 4(a), 4(b) and 4(c) to reflect the actual costs of the Additional Improvements. The final actual cost will be determined and subject to audit in the same manner as is set forth in Section 7(c) of the Original Agreement.

e. Upon the occurrence of a Special Termination Event or a termination of the Agreement as a result of Force Majeure pursuant to Section 34 of the Agreement, Landlord agrees that the Residual Capital Cost (as defined in Section 5(e) of the First Amendment), will be increased to include the Project Allocation minus any portion of the amortized capital cost of Tenant's share of the Project Allocation that has been actually recovered prior to such termination pursuant to the Net Revenue calculation set forth in Section 4(b)(iii) of the Agreement.

f. For clarification, Section 5(c) of the First Amendment is hereby amended to provide that the Landlord Contribution will be deducted from the capital cost of the WWTP Upgrade Costs prior to amortization and application to capital cost.

6. Event of Default. A default by Tenant in its obligations under this Amendment shall constitute an Event of Default pursuant to Section 22(a)(v) of the Agreement if not cured within the period set forth therein.

7. Additional Provisions.

a. Landlord will no longer have an obligation to provide electric utility services to the SoCal Biomethane Facilities in accordance with Section 5(b) of the Original Agreement after Tenant has obtained such service through a separate metered connection with Southern California Edison.

b. Landlord will use natural gas in lieu of biogas for the operation of the thermal oxidizer to maximize the availability of biogas for processing and sale by Tenant. Tenant will reimburse Landlord for the additional cost of such natural gas in accordance with the terms of Section 5(a) of the Lease.

c. Landlord and Tenant have determined that there will be an additional incremental treatment to offset an increase in Ferric Chloride in biogas produced by the Digesters due to increased volumes of ADM. Landlord will pay the incremental treatment costs for Ferric Chloride, subject to reimbursement from Tenant as a project cost on an annual basis within sixty (60) days of the end of each calendar year. Landlord will provide Tenant with an annual estimate of such costs and a reconciliation to the actual cost within thirty (30) days of the end of each calendar year.

d. Section 5(h) of the Original Agreement is hereby deleted and replaced with the following:

“(h) Maintenance Obligations of Landlord. Landlord will be responsible for all operating repairs and maintenance of the Digesters, ADM receiving skids, ADM discharge pump and flares during the Term, subject to the warranty of Tenant as set forth on Exhibit C, provided, however, that the warranty of Tenant with respect to the WWTP Upgrades and the Additional Improvements are limited to the warranties contained in Section 2.14 of Exhibit C.”

8. Nature of Amendment. Except as expressly set forth herein, the Agreement shall remain in full force and effect. All terms defined in the Agreement shall have the same meaning when used in this Amendment. This Amendment and the Agreement shall be read together, as one document. In the event there is any inconsistency between the terms hereof and the Agreement, this Amendment shall control.

9. Effective Date; No Defaults. Landlord and Tenant further certify and affirm that as of the date of this Amendment, there exists no default by Landlord of the Agreement or Event of Default as defined in the Agreement, nor any condition, act or event which with the giving of notice or the passage of time or both would constitute any such Landlord default or Event of Default.

[signature page follows]

IN WITNESS WHEREOF, Landlord and Tenant have executed this Amendment as of the date first set forth above.

SOCAL BIOMETHANE, LLC
a Delaware limited liability company

By: _____

Name: Arun Sharma

Title: President

VVWRA:

VICTOR VALLEY WASTEWATER
RECLAMATION AUTHORITY

By: _____

Name: Darron Poulsen

Title: General Manager

EXHIBIT A

SCOPE OF WORK FOR ADDITIONAL IMPROVEMENTS

- Digester 3 Improvements

Digester 3 improvements include removing the existing pump mixing system, retrofitting two Anaergia PSM mixer service boxes to the existing roof, installing new mixer post and pedestals for the mixers, installing two new PSM mixers, and installing one new mixer VFD panel. The scope of work includes all associated mechanical, structural, electrical design and construction activities.


- 2G CHP Natural Gas Retrofit

The VVWRA site has two existing CHPs that currently operate only on biogas. Both CHPs will have new engines installed that operate only on natural gas. The additional scope of work here includes the procurement, installation, and startup of the new natural gas engines into the two existing CHPs.

- Sludge and gas pipeline relocation

The existing Digester 1, 2, and 3 area is an older part of the VVWRA facility and many of the underground pipes in this area are old and the remaining useful life is uncertain. Due to this uncertainty, Landlord requested redesign of the planned sludge and gas pipeline in this area to minimize impact on the existing underground piping. This additional scope of work here includes the redesign and additional costs associated with this redesign.

EXHIBIT B
PREMISES

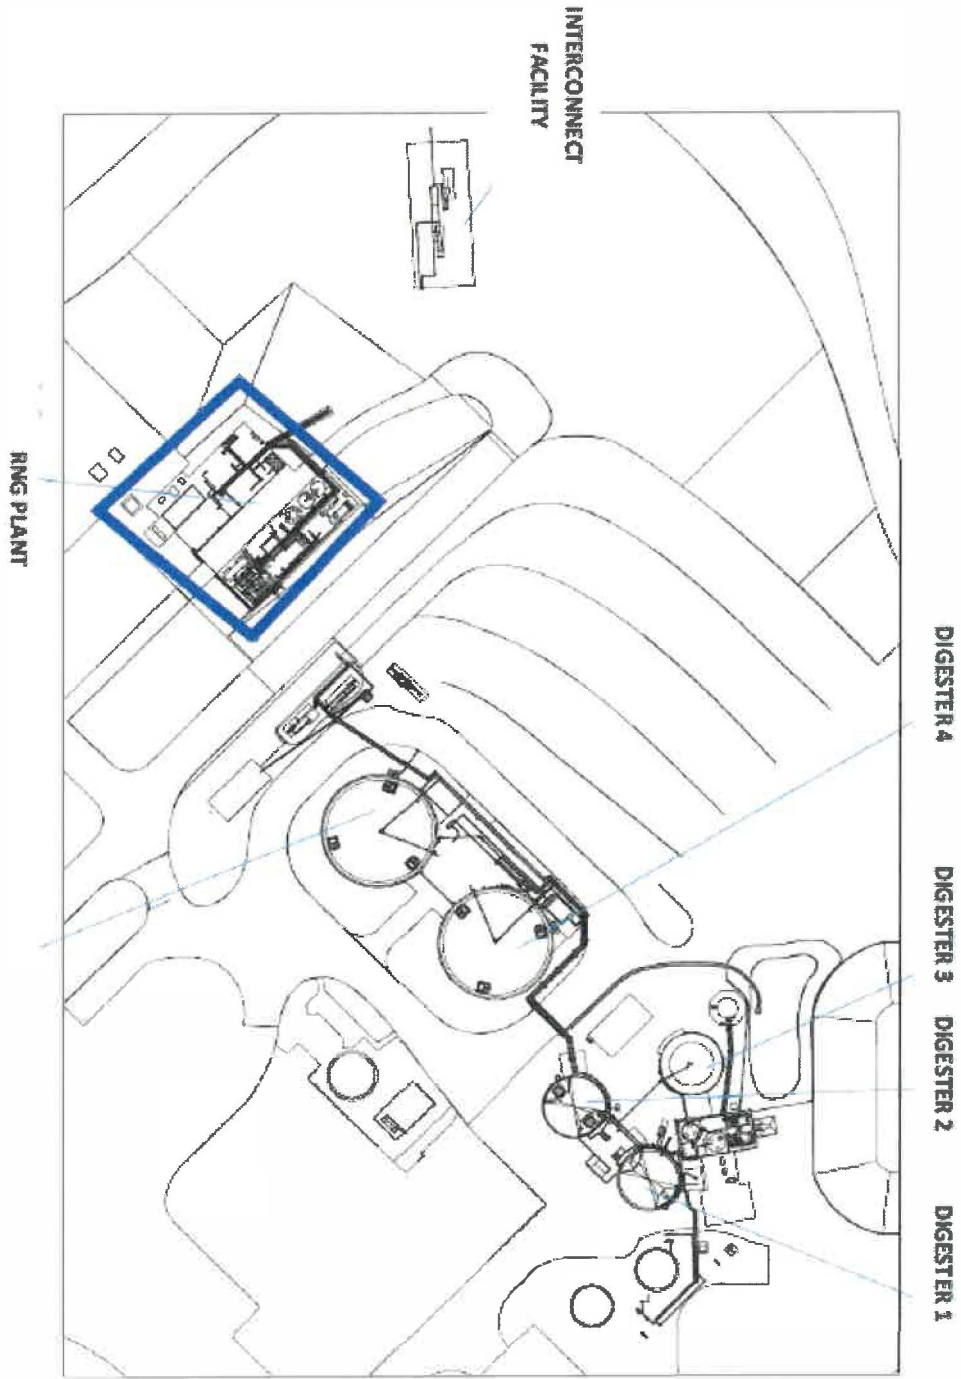



VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DRP*
SUBMITTED BY: Brad Adams, Plant Superintendent
DATE: July 15, 2021
SUBJECT: RECOMMENDATION TO EXTEND THE PROFESSIONAL SERVICES AGREEMENT (PSA) FOR OWNER'S REPRESENTATIVE AND CONSTRUCTION MANAGEMENT SERVICES FOR THE RENEWABLE NATURAL GAS PROJECT TO BIOGAS ENGINEERING (BGE) IN THE AMOUNT OF \$75,000.00

<input checked="" type="checkbox"/>	For Action	<input checked="" type="checkbox"/>	Fiscal Impact	\$ 75,000.00
<input type="checkbox"/>	Information Only	<input type="checkbox"/>	Account Codes:	09-02-535-9000-R134
		<input checked="" type="checkbox"/>	Funds Budgeted/Approved	<i>ck</i>

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners approve the General Manager to extend the Professional Services Agreement (PSA) for Owner's Representative and Construction Management Services for the Renewable Natural Gas Project to Biogas Engineering (BGE) in the amount of \$75,000.00 upon review and approval by legal counsel.

PREVIOUS ACTION(S)

On September 20, 2020, the Board of Commissioners gave authority to the VVWRA General Manger to award a Professional Services Agreement (PSA) for Owner's Representative and Construction Management Services for the Renewable Natural Gas Project to Biogas Engineering (BGE) in the amount of \$168,000.00.

BACKGROUND INFORMATION

On May 09, 2019, the Board of Commissioners gave authority to the VVWRA General Manger to enter into an agreement with SoCal Biomethane for digester upgrades necessary for the digestion of anaerobically digestible material (ADM) and fats, oil, and grease (FOG). As well the construction of the biogas collection and processing infrastructure required for renewable natural gas injection into the Southwest Gas pipeline.

Based on the highly specialized nature of the digester upgrades and biogas conditioning system, VVWRA found it necessary to procure a professional services agreement for Owner's Representative and Construction Management Services with Biogas Engineering for the entirety of the project.

The Renewable Natural Gas project is slated for completion in early October. Given the dynamic nature of a design build project, and the existing VVWRA infrastructure being further in disrepair than previously expected the Board is being asked to approve the second Amendment to the RNG project today. The added work detailed in the scope of the second Amendment to the RNG project will need further oversight to assure proper installation and testing of new facilities. The original budget for BGE to provide project oversight was consumed implementing and verifying design changes, contacting vendors and extra site visits in the original phase of the project. Due to the added scope of the second amendment and work still pending from the first phase of the Project there is a considerable amount of construction that needs to be commissioned and tested, continuing to utilize Biogas Engineering's expertise will ensure VVWRA receives the best possible product.

Staff is seeking approval from the Board of Commissioners to approve the General Manager to extend the Professional Services Agreement (PSA) for Owner's Representative and Construction Management Services for the Renewable Natural Gas Project to Biogas Engineering (BGE) in the amount of \$75,000.00 upon review and approval by legal counsel.



**VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report**

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DP*
SUBMITTED BY: Darron Poulsen, General Manager
DATE: July 15, 2021

SUBJECT: **RECOMMENDATION TO APPROVE ANNUAL ON-CALL CONTRACTS NOT TO EXCEED \$55,000 FOR PUBLIC PROJECT SERVICES TO SELECTED CONTRACTORS UPON REVIEW AND APPROVAL BY LEGAL COUNSEL.**

- | | | | | |
|-------------------------------------|-------------------------|-------------------------------------|---------------------------------|-----------------------------------|
| <input checked="" type="checkbox"/> | For Action | <input checked="" type="checkbox"/> | Fiscal Impact | \$ 55,000 Max Per Contract |
| <input type="checkbox"/> | Information Only | <input checked="" type="checkbox"/> | Account Code: | Multiple Account Codes |
| | | <input checked="" type="checkbox"/> | Funds Budgeted/Approved: | Budgeted <i>ck</i> |

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners approve the General Manager to execute multiple on-call service contracts not to exceed \$55,000.00 for public project services to the selected contractor(s) listed below upon review and approval by legal counsel.

PREVIOUS ACTION(S)

- September 17, 2020- request to approve on call contracts for electrical services
- September 17, 2020- request to approve on call contract for berm and levee repairs
- October 29, 2020- request to approve on call contracts for heating and air services
- December 17, 2020- request to approve on call contracts for IT services

BACKGROUND INFORMATION

To operate VVWRA facilities effectively and efficiently it is often necessary to call upon specialized contractors to perform critical work on assets outside the work capabilities of existing staff. Responding to these critical tasks in a timely manner is often essential to sustain proper operations and to remain in compliance with many regulatory requirements. The VVWRA purchasing policy allows for these types of on call contracts under Section IX, Paragraph A & B of VVWRA procurement policy. Staff has compiled a list of competent contractors with proven track records with VVWRA who can perform the following Work.

List of On-Call Contractors and Services:

Trade	Company Name	Address
Industrial Electric Services	Big Sky Electric, Inc	310 McArthur Way, STE A Upland CA 91786
Industrial Electric Services	Davis Electric, Inc	13556 Douglas St Yucaipa, CA 92399
Industrial Electric Services	Big Bear Electric, Inc.	PO Box 3001 Big Bear City, Ca 92314
Industrial Electric Services	Morrow-Meadows Corporation	620 Reyes Drive, Walnut, CA 91789
Managed IT Services	All CoveredIT	1003 E Brier Drive, Suite 120 San Bernardino CA 92408
Managed IT Services	Netgain Networks	1525 3rd Street Ste. C Riverside, CA 92507
Managed IT Services	Apple Valley Communications	21845 CA-18, Apple Valley, CA 92307
SCADA Integrator	Trimax	565 Explorer Street, Brea, CA 92821
SCADA Integrator	Vertech Industrial Systems	4409 E. Baseline Road, Ste. 127 Phoenix, AZ 85042
HVAC	FHA Services Inc.	12175 Pawnee Road, Apple Valley, Ca 92308
HVAC	Air Controller Environments	10722 Arrow Route, Rancho Cucamonga, Ca 91730
Concrete	Done-Right Concrete Co	11837 Calcite Ave Hesperia, CA 92345
Concrete & Construction	Bergstrom Construction Inc	10232 I Ave #6, Hesperia, CA 92345
Berm & Levy Repair	Graham Equipment	17109 Eureka St, Victorville, CA 92395
IC engines Generators	Collicutt Energy Services	12349 Hawkins St, Santa Fe Springs, CA 90670
IC engines Generators	Valley Power Systems Inc	425 S. Hacienda Blvd City of Industry, CA 91745
General Contractors	Apple Valley Construction	9312 Deep Creek Rd, Apple Valley, CA 92308
General Contractors	Christensen Brothers General Engineering, Inc	21834 Bear Valley Rd, Apple Valley, CA 92308

When the need arises, VVWRA staff will determine which contractor to call based on their responsiveness, availability, proposed costs, and past performance.

Once this on-call or as-needed contract reaches the \$55,000 threshold, it will be terminated without accruing any further costs in excess of the \$55,000 threshold. VVWRA staff will come

back to the board to renew the on-call or as-needed contract according to VVWRA procurement policy.

At this time, staff is requesting that the Board of Commissioners approve the General Manager to execute multiple on-call service contracts not to exceed \$55,000.00 for public project services to the selected contractor(s) listed above upon review and approval by legal counsel.



**VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report**

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DRP*
SUBMITTED BY: Latif Laari, Business Applications Manager
DATE: 7/15/2021
SUBJECT: **APPROVE THE AMENDMENT OF TRIMAX'S PLC
REPLACEMENT PROJECT CONTRACT TO INCLUDE PHASE 3**

<input checked="" type="checkbox"/>	For Action	<input checked="" type="checkbox"/>	Fiscal Impact	\$536,000.00
<input type="checkbox"/>	Information Only	<input checked="" type="checkbox"/>	Account Code: 01-02-515-9000-9999~\$268,000.00	
				09-02-515-9000-9999~\$268,000.00
		<input checked="" type="checkbox"/>	Funds Budgeted/ Approved: YES	<i>sk</i>

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners approve an amendment of Trimax's Programmable Logic Controllers (PLC) replacement project contract to include phase 3 in the amount of \$536,000.00 pending legal review.

PREVIOUS ACTION(S)

- December 19, 2019 the Board of Commissioners approved a contract for the Programmable Logic Controllers (PLC) Replacement Project Phase 1 to Trimax in the amount of \$470,142.00.
- July 16, 2020 the Board of Commissioners approved a contract for the Programmable Logic Controllers (PLC) Replacement Project Phase 2 to Trimax in the amount of \$447,600.00.

BACKGROUND INFORMATION

A thorough condition assessment of the Regional Wastewater Reclamation Plant PLCs was performed by staff in 2018 and reported to the board in April 2019. That report revealed the following:

1. Out of 23 PLC's currently used at the Regional Plant, 12 are older model PLC5 by Allen Bradley. This PLC model has been discontinued by the manufacturer and is now obsolete.
2. Allen Bradley no longer provides support or replacement parts for this specific model.
3. The potential failures of these PLC's could lead to violations of the NPDES and WDR permits.

Utilizing the information identified in the study, staff designed a multiyear project to address the necessary repairs and replacements of 12 obsolete PLC's.

- Phase 1 of the project was developed and approved as part of the fiscal year 2019-20 Capital Budget. The scope for phase I was designed to address the most pressing concerns.
- Phase 2 of the project was developed and approved as part of the fiscal year 2020-21 Capital project.
- Phase 3 is the final phase of this project.

To allow Trimax to continue working on this project uninterrupted, staff recommends the amendment of Trimax's existing contract to include phase 3 in the amount of \$536,000.00

If this contract amendment is approved, Trimax, Inc. will design and provide all needed material, equipment, and labor to replace 4 existing PLC5 and SLC505 PLC cabinets with new ControlLogix and CompactLogix PLC's. The new PLC's will have sufficient cards to communicate with all existing remote sites and will also have provisions for adding future cards, allowing the system to be scalable. The work scope also includes providing new mounting panels, control cabinets, updated PLC programs, modifications to SCADA tags, drawings and documentation, changes to the HMIs, and start-up services. Key performance factors identified for this upgrade include:

- o PLC upgrade for improved speed and distributed access.
- o Elimination of obsolete PLC technology
- o Improved system reliability.
- o Improved system communications speed.
- o Improved system security with wireless communication technology.

Phase 3 PLC Replacement Project List:

PLC#	Area	PLC Name	Cost
1	Returned Activated Sludge	PLC RAS	\$98,900.00
2	Effluent to River	PLC Effluent	\$78,900.00
3	UV Disinfection	PLC UV Disinfection	\$5,080.00
4	PLC Nom	PLC Nom	\$98,000.00
5	Aeration	PLC Aer	\$99,800.00
6	Lagoon Pump Station, Hex and filters 1&2	PLC Blo, Hex and Filters 1&2	\$147,500.00
		Contingency	\$7,820.00
		Total	\$536,000.00



VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
Board of Commissioners Staff Report

TO: VVWRA Board of Commissioners
FROM: Darron Poulsen, General Manager *DRP*
SUBMITTED BY: Kristi Casteel, Executive Assistant *[Signature]*
DATE: July 15, 2021
SUBJECT: RECOMMENDATION TO AMEND THE 2021 BOARD SCHEDULE

<input checked="" type="checkbox"/> For Action	<input type="checkbox"/> Fiscal Impact	\$
<input type="checkbox"/> Information Only	<input type="checkbox"/> Account Code:	
	<input type="checkbox"/> Funds Budgeted/ Approved:	

STAFF RECOMMENDATION

It is recommended that the Board of Commissioners approve the amended 2021 Board Meeting Schedule.

PREVIOUS ACTION(S)

October 29, 2020- 2021 Board Schedule was approved

BACKGROUND INFORMATION

At the June 17, 2021 Board Meeting, it was the consensus of the Board to add an August meeting to the schedule to discuss and decide upon recycled water rates and to continue necessary discussions on the Hesperia Settlement. The amended schedule detailed in Exhibit (1) has a meeting for August 19, 2021.

Attachment(s):

Exhibit | 1 | – 2021 Amended schedule

EXHIBIT 1



**VICTOR VALLEY WASTEWATER RECLAMATION AUTHORITY
BOARD OF COMMISSIONERS
2021
BOARD MEETING SCHEDULE ***

Time: Closed Session: 7:30 AM. Regular Session: 9:00 AM.

Thursday January 21

Thursday February 18

Thursday March 18

Thursday April 15

Thursday May 20

Thursday June 17

Thursday, June 24 (Budget Adoption)

Thursday July 15

Thursday August 19

Thursday September 16

Thursday October 21

Thursday November 18

* VWRA Regular Board Meetings are typically held on the **third Thursday** of the month unless otherwise noticed and posted. Additional Regular or Special Meetings may be scheduled during the year as necessary.

** The October meeting is not the third Thursday due to scheduling conflicts

Approved on: **PROPOSED**